

AC Tech

a member of the **Lenze** Group

Drive for Global Excellence




SCD Series Installation and Operation Manual

TABLE OF CONTENTS

| | | |
|------|---|----|
| 1.0 | GENERAL..... | 1 |
| 2.0 | SCD DIMENSIONS..... | 2 |
| | THROUGH-HOLE MOUNT DIMENSIONS..... | 4 |
| 3.0 | SCD MODEL DESIGNATION CODE..... | 5 |
| 4.0 | SCD SPECIFICATIONS..... | 6 |
| 5.0 | SCD RATINGS..... | 7 |
| 6.0 | INSTALLATION..... | 9 |
| 7.0 | INPUT AC POWER REQUIREMENTS..... | 10 |
| 8.0 | POWER WIRING..... | 13 |
| 9.0 | SCD POWER WIRING DIAGRAM..... | 14 |
| 10.0 | CONTROL WIRING..... | 15 |
| 11.0 | SCD CONTROL WIRING DIAGRAMS..... | 18 |
| 12.0 | INITIAL POWER UP AND MOTOR ROTATION..... | 23 |
| 13.0 | PROGRAMMING THE SCD DRIVE..... | 25 |
| 14.0 | PARAMETER MENU..... | 29 |
| 15.0 | DESCRIPTION OF PARAMETERS..... | 33 |
| 16.0 | TROUBLESHOOTING..... | 49 |
| 17.0 | SCD DISPLAY MESSAGES..... | 51 |
| | APPENDIX A - THROUGH-HOLE MOUNT OPTION..... | 53 |
| | APPENDIX B - DEVICENET™ CONTROL..... | 57 |

THE SCD SUB-MICRO DRIVE

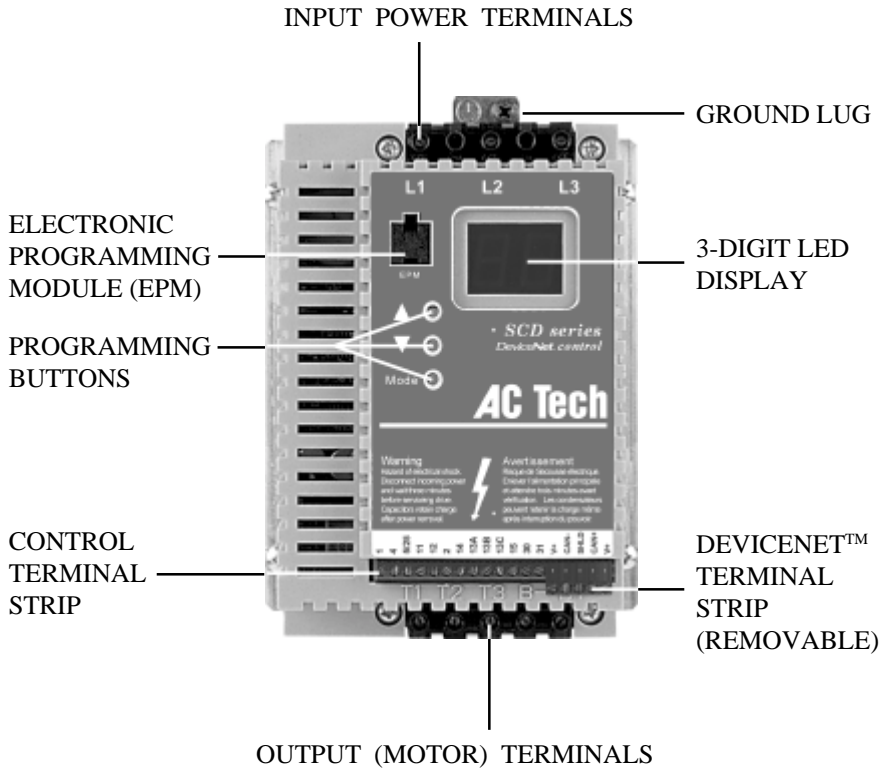

1.0 GENERAL

1.1 PRODUCTS COVERED IN THIS MANUAL

This manual covers the AC Tech SCD Series Variable Frequency Drive.

1.2 PRODUCT CHANGES

AC Technology Corporation reserves the right to discontinue or make modifications to the design of its products without prior notice, and holds no obligation to make modifications to products sold previously. AC Technology Corporation also holds no liability for losses of any kind which may result from this action.

1.3 WARRANTY

AC Technology Corporation warrants the SCD Series AC motor control to be free of defects in material and workmanship for a period of twelve months from the date of sale to the user, or eighteen months from the date of shipment, whichever occurs first. If an SCD motor control, under normal use, becomes defective within the stated warranty time period, contact AC Technology's Service Department for instructions on obtaining a warranty replacement unit. AC Technology Corporation reserves the right to make the final determination as to the validity of a warranty claim, and sole obligation is to repair or replace only components which have been rendered defective due to faulty material or workmanship. No warranty claim will be accepted for components which have been damaged due to mishandling, improper installation, unauthorized repair and/or alteration of the product, operation in excess of design specifications or other misuse, or improper maintenance. AC Technology Corporation makes no warranty that its products are compatible with any other equipment, or to any specific application, to which they may be applied and shall not be held liable for any other consequential damage or injury arising from the use of its products.

This warranty is in lieu of all other warranties, expressed or implied. No other person, firm or corporation is authorized to assume, for AC Technology Corporation, any other liability in connection with the demonstration or sale of its products.


1.4 RECEIVING

Inspect all cartons for damage which may have occurred during shipping. Carefully unpack equipment and inspect thoroughly for damage or shortage. Report any damage to carrier and/or shortages to supplier. All major components and connections should be examined for damage and tightness, with special attention given to PC boards, plugs, knobs and switches.

1.5 CUSTOMER MODIFICATION

AC Technology Corporation, its sales representatives and distributors, welcome the opportunity to assist our customers in applying our products. Many customizing options are available to aid in this function. AC Technology Corporation cannot assume responsibility for any modifications not authorized by its engineering department.

2.0 SCD DIMENSIONS


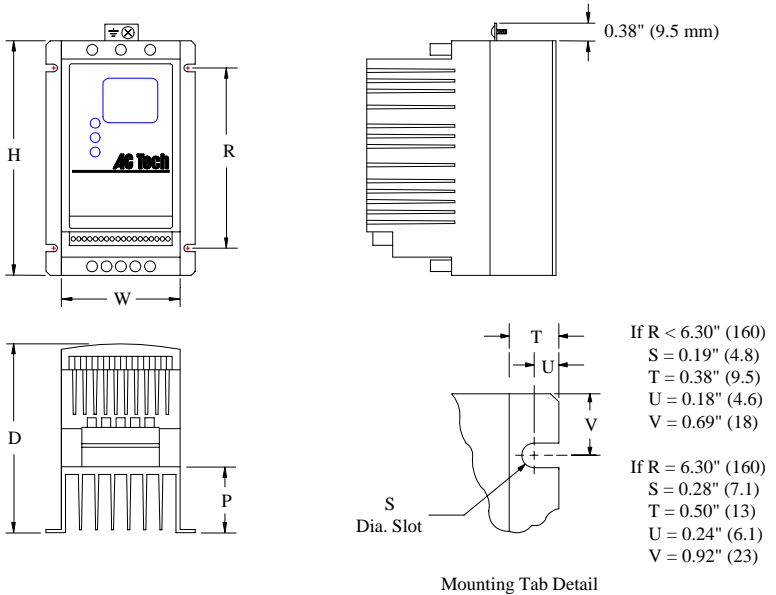


| | | INPUT | | | | | | | |
|------|------|---------|--------|------------|-----------|------------|-----------|------------|--|
| HP | KW | VOLTAGE | MODEL | H | W | D | P | R | |
| 0.25 | 0.18 | 208/240 | SD203Y | 5.75 (146) | 2.88 (73) | 3.94 (100) | 0.80 (20) | 4.37 (111) | |
| 0.5 | 0.37 | 208/240 | SD205Y | 5.75 (146) | 2.88 (73) | 3.94 (100) | 0.80 (20) | 4.37 (111) | |
| | | 400/480 | SD405 | 5.75 (146) | 2.88 (73) | 3.94 (100) | 0.80 (20) | 4.37 (111) | |
| 1 | 0.75 | 208/240 | SD210Y | 5.75 (146) | 2.88 (73) | 4.74 (120) | 1.60 (41) | 4.37 (111) | |
| | | 208/240 | SD210 | 5.75 (146) | 2.88 (73) | 4.74 (120) | 1.60 (41) | 4.37 (111) | |
| | | 400/480 | SD410 | 5.75 (146) | 2.88 (73) | 4.74 (120) | 1.60 (41) | 4.37 (111) | |
| | | 480/590 | SD510 | 5.75 (146) | 2.88 (73) | 4.74 (120) | 1.60 (41) | 4.37 (111) | |
| 1.5 | 1.1 | 208/240 | SD215Y | 5.75 (146) | 3.76 (96) | 5.24 (133) | 1.90 (48) | 4.37 (111) | |
| | | 208/240 | SD215 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 4.37 (111) | |
| | | 400/480 | SD415 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 4.37 (111) | |
| 2 | 1.5 | 208/240 | SD220Y | 5.75 (146) | 3.76 (96) | 6.74 (171) | 3.40 (86) | 4.37 (111) | |
| | | 208/240 | SD220 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 4.37 (111) | |
| | | 400/480 | SD420 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 4.37 (111) | |
| | | 480/590 | SD520 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 4.37 (111) | |

| INPUT | | | | | | | | |
|-------|------|---------|--------|------------|------------|------------|-----------|------------|
| HP | KW | VOLTAGE | MODEL | H | W | D | P | R |
| 3 | 2.2 | 208/240 | SD230Y | 5.75 (146) | 3.76 (96) | 6.74 (171) | 3.40 (86) | 3.25 (83) |
| | | 208/240 | SD230 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 3.06 (78) |
| | | 400/480 | SD430 | 5.75 (146) | 2.88 (73) | 5.74 (146) | 2.60 (66) | 3.06 (78) |
| | | 480/590 | SD530 | 5.75 (146) | 3.76 (96) | 6.74 (171) | 3.40 (86) | 4.37 (111) |
| 5 | 3.7 | 208/240 | SD250Y | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| | | 208/240 | SD250 | 5.75 (146) | 3.76 (96) | 6.74 (171) | 3.40 (86) | 3.25 (83) |
| | | 400/480 | SD450 | 5.75 (146) | 3.76 (96) | 6.74 (171) | 3.40 (86) | 3.25 (83) |
| | | 480/590 | SD550 | 5.75 (146) | 3.76 (96) | 6.74 (171) | 3.40 (86) | 3.25 (83) |
| 7.5 | 5.5 | 208/240 | SD275 | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| | | 400/480 | SD475 | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| | | 480/590 | SD575 | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| 10 | 7.5 | 208/240 | SD2100 | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| | | 400/480 | SD4100 | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| | | 480/590 | SD5100 | 7.75 (197) | 5.02 (128) | 7.18 (182) | 3.40 (86) | 4.81 (122) |
| 15 | 11 | 208/240 | SD2150 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| | | 400/480 | SD4150 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| | | 480/590 | SD5150 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| 20 | 15 | 208/240 | SD2200 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| | | 400/480 | SD4200 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| | | 480/590 | SD5200 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| 25 | 18.5 | 400/480 | SD4250 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |
| | | 480/590 | SD5250 | 9.75 (248) | 6.68 (170) | 8.00 (203) | 3.60 (91) | 6.30 (160) |

2.1

SCD THROUGH-HOLE MOUNT DIMENSIONS

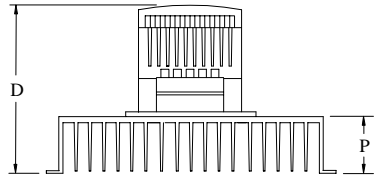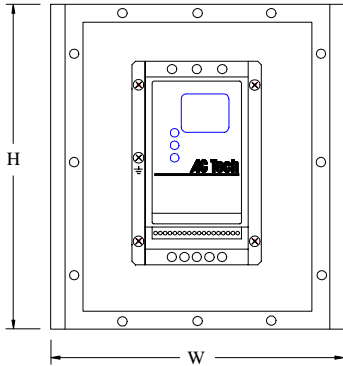

| HP | KW | INPUT | | H | W | D | P |
|-----|------|---------|---------|-------------|-------------|------------|-----------|
| | | VOLTAGE | MODEL | | | | |
| 1 | 0.75 | 208/240 | SD210YF | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| | | 208/240 | SD210F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| | | 400/480 | SD410F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| | | 480/590 | SD510F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| 1.5 | 1.1 | 208/240 | SD215YF | 7.72 (196) | 6.80 (173) | 4.75 (121) | 1.20 (30) |
| | | 208/240 | SD215F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| | | 400/480 | SD415F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| 2 | 1.5 | 208/240 | SD220YF | 7.72 (196) | 6.80 (173) | 4.75 (121) | 1.20 (30) |
| | | 208/240 | SD220F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| | | 400/480 | SD420F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| | | 480/590 | SD520F | 7.72 (196) | 6.80 (173) | 4.55 (116) | 1.20 (30) |
| 3 | 2.2 | 208/240 | SD230YF | 7.72 (196) | 8.54 (217) | 5.30 (135) | 1.75 (44) |
| | | 208/240 | SD230F | 7.72 (196) | 8.54 (217) | 5.10 (130) | 1.75 (44) |
| | | 400/480 | SD430F | 7.72 (196) | 8.54 (217) | 5.10 (130) | 1.75 (44) |
| | | 480/590 | SD530F | 7.72 (196) | 8.54 (217) | 5.30 (135) | 1.75 (44) |
| 5 | 3.7 | 208/240 | SD250YF | 9.59 (244) | 11.14 (283) | 7.65 (194) | 3.60 (91) |
| | | 208/240 | SD250F | 7.72 (196) | 8.54 (217) | 6.30 (160) | 2.75 (70) |
| | | 400/480 | SD450F | 7.72 (196) | 8.54 (217) | 6.30 (160) | 2.75 (70) |
| | | 480/590 | SD550F | 7.72 (196) | 8.54 (217) | 6.30 (160) | 2.75 (70) |
| 7.5 | 5.5 | 208/240 | SD275F | 11.59 (294) | 11.14 (283) | 7.65 (194) | 3.60 (91) |
| | | 400/480 | SD475F | 9.59 (244) | 11.14 (283) | 7.65 (194) | 3.60 (91) |
| | | 480/590 | SD575F | 9.59 (244) | 11.14 (283) | 7.65 (194) | 3.60 (91) |

| HP | KW | INPUT | | | | | |
|----|------|---------|---------|-------------|-------------|------------|-----------|
| | | VOLTAGE | MODEL | H | W | D | P |
| 10 | 7.5 | 208/240 | SD2100F | 15.59 (396) | 11.14 (283) | 7.65 (194) | 3.60 (91) |
| | | 400/480 | SD4100F | 11.59 (294) | 11.14 (283) | 7.65 (194) | 3.60 (91) |
| | | 480/590 | SD5100F | 11.59 (294) | 11.14 (283) | 7.65 (194) | 3.60 (91) |
| 15 | 11 | 208/240 | SD2150F | 18.09 (459) | 11.14 (283) | 8.29 (211) | 3.60 (91) |
| | | 400/480 | SD4150F | 15.59 (396) | 11.14 (283) | 8.29 (211) | 3.60 (91) |
| | | 480/590 | SD5150F | 15.59 (396) | 11.14 (283) | 8.29 (211) | 3.60 (91) |
| 20 | 15 | 400/480 | SD4200F | 18.09 (459) | 11.14 (283) | 8.29 (211) | 3.60 (91) |
| | | 480/590 | SD5200F | 18.09 (459) | 11.14 (283) | 8.29 (211) | 3.60 (91) |
| 25 | 18.5 | 400/480 | SD4250F | 28.50 (724) | 10.34 (263) | 8.39 (213) | 3.70 (94) |
| | | 480/590 | SD5250F | 28.50 (724) | 10.34 (263) | 8.39 (213) | 3.70 (94) |

NOTE: Refer to Appendix A for mounting template dimensions for the Through-hole Mount option.

3.0 SCD MODEL DESIGNATION CODE

The SCD model number gives a full description of the basic drive unit (see example below).

EXAMPLE: SD210Y (SCD Series, 208/240 Vac, 1 HP, single or three phase input)

| | | | | | | |
|---|-----------|----------|-----------|----------|--|--|
| | SD | 2 | 10 | Y | | |
| Series: | | | | | | |
| SD = SCD Series Variable Speed AC Motor Drive with DeviceNet™ | | | | | | |
| Input Voltage: | | | | | | |
| 2 = 208/240 Vac (For 208, 220, 230, and 240 Vac; 50 or 60 Hz) | | | | | | |
| 4 = 400/480 Vac (For 380, 415, 440, 460 and 480 Vac; 50 or 60 Hz) | | | | | | |
| 5 = 480/590 Vac (For 460, 480, 550, 575 and 600 Vac; 50 or 60 Hz) | | | | | | |
| Horsepower: | | | | | | |
| 03 = ¼ Hp 15 = 1½ Hp 50 = 5 Hp 150 = 15 Hp | | | | | | |
| 05 = ½ Hp 20 = 2 Hp 75 = 7½ Hp 200 = 20 Hp | | | | | | |
| 10 = 1 Hp 30 = 3 Hp 100 = 10 Hp 250 = 25 Hp | | | | | | |
| Input: Phase: | | | | | | |
| Y = Single or three phase input | | | | | | |
| <i>No character indicates three phase input only</i> | | | | | | |
| Mounting Style: | | | | | | |
| F = Through-hole mount with special heatsink | | | | | | |
| F1 = Through-hole mount without heatsink (customer supplies heatsink) | | | | | | |
| <i>No character indicates panel or DIN rail mounting</i> | | | | | | |
| Application Specific Options: | | | | | | |
| V = High Frequency Output – up to 1000 Hz | | | | | | |

4.0 SCD SPECIFICATIONS

| | |
|-----------------------------------|---|
| Storage Temperature | -20 to 70 C |
| Ambient Operating Temperature | 0 to 50 C (up to 6 kHz carrier, derate above 6 kHz) |
| Ambient Humidity | < 95% (non-condensing) |
| Maximum Altitude | 3300 ft (1000 m) above sea level (without derating) |
| Input Line Voltages | 208/240 Vac, 400/480 Vac, 480/590 Vac |
| Input Voltage Tolerance | +10%, -15% |
| Input Frequency Tolerance | 48 to 62 Hz |
| Output Wave Form | Sine Coded PWM |
| Output Frequency | 0 - 240 Hz (consult factory for higher output frequencies) |
| Carrier Frequency | 4 kHz to 10 kHz |
| Service Factor | 1.00 (up to 6 kHz carrier, derate above 6 kHz) |
| Efficiency | Up to 98% |
| Power Factor (displacement) | 0.96 or better |
| Overload Current Capacity | 150% for 60 seconds, 180% for 30 seconds |
| Speed Reference Follower | 0-10 VDC, 4-20 mA |
| Control Voltage | 15 VDC |
| Power Supply for Auxiliary Relays | 50 mA at 12 VDC |
| Analog Outputs | 0 - 10 VDC or 2 - 10 VDC: Proportional to frequency or load |
| Digital Outputs | Open-collector outputs: 50 mA at 30 VDC |

4.1 DEVICENET™ ELECTRICAL SPECIFICATIONS

| | |
|-----------------------------|--|
| Supply Voltage | 11 to 25 VDC |
| Current Consumption (max) | 50 mA @ 11 VDC |
| Baud Rates and Max Distance | 125 kbps - 500 m (1640 ft) 250 kbps - 250 m (820 ft) 500 kbps - 100 m (328 ft) |

5.0 SCD RATINGS

| MODEL NUMBER (NOTE 1) | FORMOTORS RATED | | INPUT (50-60 Hz) | | | OUTPUT | HEAT LOSS (WATTS) (NOTE 5) | |
|--|-----------------|------|----------------------|----------------|-------------|--------------------------|----------------------------------|------|
| | HP | KW | INPUT PHASE | CURRENT (AMPS) | POWER (KVA) | CURRENT (AMPS) | STD | THRU |
| | | | | | | | | |
| SD200Y SERIES (NOTE 2) | | | 208 / 240 Vac | | | 0 - 200 / 230 Vac | | |
| SD203Y | 0.25 | 0.18 | 1 | 3.6/3.2 | 0.76 | 1.6/1.4 | 19 | N/A |
| SD203Y | 0.25 | 0.18 | 3 | 1.9/1.7 | 0.71 | 1.6/1.4 | 19 | N/A |
| SD205Y | 0.5 | 0.37 | 1 | 5.4/4.7 | 1.2 | 2.5/2.2 | 26 | N/A |
| SD205Y | 0.5 | 0.37 | 3 | 3.1/2.7 | 1.1 | 2.5/2.2 | 26 | N/A |
| SD210Y | 1 | 0.75 | 1 | 10.6/9.2 | 2.2 | 4.8/4.2 | 49 | 18 |
| SD210Y | 1 | 0.75 | 3 | 5.8/5.1 | 2.1 | 4.8/4.2 | 49 | 18 |
| SD215Y | 1.5 | 1.1 | 1 | 13.9/12.0 | 2.9 | 6.9/6.0 | 82 | 23 |
| SD215Y | 1.5 | 1.1 | 3 | 8.0/6.9 | 2.9 | 6.9/6.0 | 82 | 23 |
| SD220Y | 2 | 1.5 | 1 | 14.8/12.9 | 3.1 | 7.8/6.8 | 86 | 26 |
| SD220Y | 2 | 1.5 | 3 | 9.1/7.9 | 3.2 | 7.8/6.8 | 86 | 26 |
| SD230Y | 3 | 2.2 | 1 | 19.7/17.1 | 4.1 | 11.0/9.6 | 130 | 29 |
| SD230Y | 3 | 2.2 | 3 | 12.4/10.8 | 4.4 | 11.0/9.6 | 130 | 29 |
| SD250Y | 5 | 3.7 | 1 | 29/26 | 6.1 | 17.5/15.2 | 212 | 40 |
| SD250Y | 5 | 3.7 | 3 | 19.6/17.1 | 7.1 | 17.5/15.2 | 212 | 40 |
| SD200 SERIES (NOTE 2) | | | 208 / 240 Vac | | | 0 - 200 / 230 Vac | | |
| SD210 | 1 | 0.75 | 3 | 5.8/5.1 | 2.1 | 4.8/4.2 | 41 | 11 |
| SD215 | 1.5 | 1.1 | 3 | 8.0/6.9 | 2.9 | 6.9/6.0 | 69 | 13 |
| SD220 | 2 | 1.5 | 3 | 9.1/7.9 | 3.3 | 7.8/6.8 | 78 | 15 |
| SD230 | 3 | 2.2 | 3 | 12.4/10.8 | 4.5 | 11.0/9.6 | 117 | 20 |
| SD250 | 5 | 3.7 | 3 | 19.6/17.1 | 7.1 | 17.5/15.2 | 187 | 22 |
| SD275 | 7.5 | 5.5 | 3 | 28/25 | 10.3 | 25/22 | 286 | 31 |
| SD2100 | 10 | 7.5 | 3 | 34/32 | 13.1 | 30/28 | 379 | 39 |
| SD2150 | 15 | 11 | 3 | 54/48 | 20.0 | 48/42 | 476 | 51 |
| SD2200 | 20 | 15 | 3 | 65/61 | 25.4 | 58/54 | 648 | N/A |
| NOTE 1: See Section 3.0 for model number breakdown. | | | | | | | | |
| NOTE 2: The higher current ratings are for 208 Vac input and the lower current ratings are for 240 Vac input. | | | | | | | | |
| NOTE 5: STD = standard unit; THRU = through-hole mount unit. Values are worst-case (not typical) for 6kHz carrier frequency at full speed and full load. | | | | | | | | |

| MODEL NUMBER (NOTE 1) | FOR MOTORS RATED | | INPUT (50-60 Hz) | | | OUTPUT | HEAT LOSS (WATTS) (NOTE 5) | |
|--|------------------|------|----------------------|-----------|-----------|--------------------------|----------------------------------|------|
| | HP | KW | INPUT | CURRENT | POWER | CURRENT (AMPS) | STD | THRU |
| | | | PHASE | (AMPS) | (kVA) | | | |
| SD400 SERIES (NOTE 3) | | | 400 / 480 Vac | | | 0 - 400 / 460 Vac | | |
| SD405 | 0.5 | 0.37 | 3 | 1.6/1.4 | 1.1 | 1.3/1.1 | 26 | N/A |
| SD410 | 1 | 0.75 | 3 | 2.9/2.5 | 2.1 | 2.4/2.1 | 40 | 12 |
| SD415 | 1.5 | 1.1 | 3 | 4.0/3.6 | 3.0 | 3.4/3.0 | 56 | 13 |
| SD420 | 2 | 1.5 | 3 | 4.6/4.0 | 3.3 | 3.9/3.4 | 67 | 14 |
| SD430 | 3 | 2.2 | 3 | 6.2/5.4 | 4.5 | 5.5/4.8 | 100 | 19 |
| SD450 | 5 | 3.7 | 3 | 9.8/8.6 | 7.1 | 8.7/7.6 | 168 | 22 |
| SD475 | 7.5 | 5.5 | 3 | 14.2/12.4 | 10.3 | 12.6/11.0 | 254 | 29 |
| SD4100 | 10 | 7.5 | 3 | 18.1/15.8 | 13.1 | 16.1/14.0 | 310 | 37 |
| SD4150 | 15 | 11 | 3 | 27/24 | 20.0 | 24/21 | 390 | 42 |
| SD4200 | 20 | 15 | 3 | 35/31 | 25.8 | 31/27 | 530 | 57 |
| SD4250 | 25 | 18.5 | 3 | 44/38 | 31.6 | 39/34 | 648 | 72 |
| SD500 SERIES (NOTE 4) | | | 480 / 590 Vac | | | 0 - 460 / 575 Vac | | |
| SD510 | 1 | 0.75 | 3 | 2.2/2.0 | 1.9/2.0 | 1.9/1.7 | 40 | 12 |
| SD520 | 2 | 1.5 | 3 | 4.0/3.5 | 3.3/3.6 | 3.4/3.0 | 67 | 13 |
| SD530 | 3 | 2.2 | 3 | 4.7/4.7 | 3.9/4.8 | 4.2/4.2 | 100 | 14 |
| SD550 | 5 | 3.7 | 3 | 7.4/7.4 | 6.1/7.5 | 6.6/6.6 | 168 | 19 |
| SD575 | 7.5 | 5.5 | 3 | 11.2/11.2 | 9.3/11.4 | 9.9/9.9 | 254 | 29 |
| SD5100 | 10 | 7.5 | 3 | 13.7/13.7 | 11.4/14.0 | 12.2/12.2 | 310 | 37 |
| SD5150 | 15 | 11 | 3 | 22/22 | 18.3/22.5 | 19.0/19.0 | 390 | 42 |
| SD5200 | 20 | 15 | 3 | 27/27 | 22.4/27.6 | 24/24 | 530 | 57 |
| SD5250 | 25 | 18.5 | 3 | 31/31 | 25.8/31.7 | 27/27 | 648 | 72 |
| NOTE 1: See Section 3.0 for model number breakdown. | | | | | | | | |
| NOTE 3: The higher current ratings are for 400 Vac input and the lower current ratings are for 480 Vac input. | | | | | | | | |
| NOTE 4: The higher current ratings are for 480 Vac input and the lower current ratings are for 590 Vac input. | | | | | | | | |
| NOTE 5: STD = standard unit; THRU = through-hole mount unit. Values are worst-case (not typical) for 6kHz carrier frequency at full speed and full load. | | | | | | | | |

6.0 INSTALLATION

NOTE!

SCD drives are intended for inclusion within other equipment, by professional electrical installers. They are not intended for stand-alone operation.

WARNING!

DRIVES MUST NOT BE INSTALLED WHERE SUBJECTED TO ADVERSE ENVIRONMENTAL CONDITIONS SUCH AS: COMBUSTIBLE, OILY, OR HAZARDOUS VAPORS OR DUST; EXCESSIVE MOISTURE OR DIRT; VIBRATION; EXCESSIVE AMBIENT TEMPERATURES. CONSULT AC TECHNOLOGY FOR MORE INFORMATION ON THE SUITABILITY OF A DRIVE TO A PARTICULAR ENVIRONMENT.

SCD models are suitable for UL pollution degree 2 environment only, and MUST be installed in an electrical enclosure which will provide complete mechanical protection and will maintain the internal temperature within the drive's ambient operating temperature rating. All drive models MUST be mounted in a vertical position for proper heatsink cooling.

Maintain a minimum spacing around the drive of at least 1 inch on each side and 2 inches on the top and bottom for units rated up to 5 HP (3.7 kW). For units rated 7.5 - 25 HP (5.5 - 18.5 kW), maintain at least 2 inches on each side and 4 inches on the top and bottom. Allow more spacing if the drive is mounted next to other heat-producing equipment. Do not mount drives above other drives or heat producing equipment. Fans or blowers should be used to insure proper cooling in tight quarters.

In order to properly size an enclosure, the heat generated by the drive(s) must be known. Refer to the HEAT LOSS columns in Section 5.0 - SCD RATINGS. The STD column is for standard units, and the THRU column is for through-hole mount units (drives with the through-hole mount option still generate some heat inside the enclosure that must be taken into account). An enclosure manufacturer can then determine the required enclosure size based on the total heat generated inside the enclosure (from the drive(s) and other heat sources), the maximum allowable temperature inside the enclosure, the maximum ambient temperature outside the enclosure, and the enclosure properties.

The SCD Series is UL approved for solid state motor overload protection. Therefore, a separate thermal overload relay is not required for single motor applications.

6.1 INSTALLATION AFTER A LONG PERIOD OF STORAGE

WARNING!

Severe damage to the drive can result if it is operated after a long period of storage or inactivity without reforming the DC bus capacitors!

If input power has not been applied to the drive for a period of time exceeding three years (due to storage, etc), the electrolytic DC bus capacitors within the drive can change internally, resulting in excessive leakage current. This can result in premature failure of the capacitors if the drive is operated after such a long period of inactivity or storage.

In order to reform the capacitors and prepare the drive for operation after a long period of inactivity, apply input power to the drive for 8 hours prior to actually operating the motor.

6.2 EXPLOSION PROOF APPLICATIONS

Explosion proof motors that are not rated for inverter use lose their certification when used for variable speed. Due to the many areas of liability that may be encountered when dealing with these applications, the following statement of policy applies:

“AC Technology Corporation inverter products are sold with no warranty of fitness for a particular purpose or warranty of suitability for use with explosion proof motors. AC Technology Corporation accepts no responsibility for any direct, incidental or consequential loss, cost, or damage that may arise through the use of its AC inverter products in these applications. The purchaser expressly agrees to assume all risk of any loss, cost, or damage that may arise from such application.”

7.0 INPUT AC POWER REQUIREMENTS

WARNING!

Hazard of electrical shock! Capacitors retain charge after power is removed. Disconnect incoming power and wait until the voltage between terminals B+ and B- is 0 VDC before servicing the drive.

The input voltage must match the nameplate voltage rating of the drive. Voltage fluctuation must not vary by greater than 10% overvoltage or 15% undervoltage.

NOTE: Drives with dual input voltage ratings must be programmed for the proper supply voltage (refer to Parameter 01 - LINE VOLTAGE SELECTION in Section 15.0 - DESCRIPTION OF PARAMETERS).

The drive is suitable for use on a circuit capable of delivering not more than 5,000 RMS symmetrical amperes at 5 HP (3.7 kW) and below, and 18,000 RMS symmetrical amperes at 7.5 - 25 HP (5.5 - 18.5 kW), at the drive's rated voltage.

If the kVA rating of the AC supply transformer is greater than 10 times the input kVA rating of the drive(s), an isolation transformer or 2-3% input line reactor must be added to the line side of the drive(s).

Three phase voltage imbalance must be less than 2.0% phase to phase. Excessive phase to phase imbalance can cause severe damage to the drive's power components.

Motor voltage should match line voltage in normal applications. The drive's maximum output voltage will equal the input voltage. Use extreme caution when using a motor with a voltage rating which is different from the input line voltage.

7.1 INPUT VOLTAGE RATINGS

SD200 Series drives are rated for 208/240 Vac, three phase, 50-60 Hz input. The drive will function with input voltages of 208 to 240 Vac (+10%, -15%), at 48 to 62 Hz.

SD200Y Series drives are rated for 208/240 Vac, single or three phase, 50-60 Hz input. The drive will function with input voltage of 208 to 240 Vac (+10%, -15%), at 48 to 62 Hz.

SD400 Series drives are rated for 400/480 Vac three phase, 50-60 Hz input. The drive will function with input voltages of 400 to 480 Vac (+10%, -15%), at 48 to 62 Hz.

SD500 Series drives are rated for 480/590 Vac, three phase, 50-60 Hz input, and will function with input voltages of 480 to 590 Vac (+10%, -15%), at 48 to 62 Hz.

NOTE: Parameter 01 - LINE VOLTAGE SELECTION must be programmed according to the applied input voltage. See Section 15.0 - DESCRIPTION OF PARAMETERS.

7.2 INPUT FUSING AND DISCONNECT REQUIREMENTS

A circuit breaker or a disconnect switch with fuses must be provided in accordance with the National Electric Code (NEC) and all local codes. Refer to the following tables for proper fuse/circuit breaker ratings and wire sizes.

| INPUT FUSE & CIRCUIT BREAKER RATINGS | | | | | | | |
|--------------------------------------|-----------|----------------------|------------|----------------------|-----------|----------------------|--------|
| 208/240 Vac, 1 phase | | 208/240 Vac, 3 phase | | 400/480 Vac, 3 phase | | 480/590 Vac, 3 phase | |
| MODEL | RATING | MODEL | RATING | MODEL | RATING | MODEL | RATING |
| SD203Y | 10 A | SD203Y | 10 A | | | | |
| SD205Y | 10 A | SD205(Y) | 10 A | SD405 | 10 A | | |
| SD210Y | 15 A | SD210(Y) | 10 A | SD410 | 10 A | SD510 | 10 A |
| SD215Y | 20 A | SD215(Y) | 12 / 10 A | SD415 | 10 A | | |
| SD220Y | 25 / 20 A | SD220(Y) | 15 / 12 A | SD420 | 10 A | SD520 | 10 A |
| SD230Y | 30 / 25 A | SD230(Y) | 20 / 15 A | SD430 | 10 A | SD530 | 10 A |
| SD250Y | 45 / 40 A | SD250(Y) | 30 / 25 A | SD450 | 15 A | SD550 | 12 A |
| | | SD275 | 45 / 40 A | SD475 | 20 A | SD575 | 20 A |
| | | SD2100 | 50 / 50 A | SD4100 | 30 / 25 A | SD5100 | 20 A |
| | | SD2150 | 80 / 75 A | SD4150 | 40 / 40 A | SD5150 | 30 A |
| | | SD2200 | 100 / 90 A | SD4200 | 50 / 45 A | SD5200 | 40 A |
| | | | | SD4250 | 70 / 60 A | SD5250 | 45 A |

NOTE 1: Use UL Class CC fast-acting, current limiting type fuses. Select fuses with low $I^2 T$ values, rated at 200,000 AIC. Recommended fuses are Bussman KTK-R, JJK, and JJS. Similar fuses with equivalent ratings by other manufacturers may also be acceptable.

WIRE SIZE REQUIREMENTS

| 208/240 Vac, 1 phase | | | 208/240 Vac, 3 phase | | | 400/480 Vac, 3 phase | | | 480/590 Vac, 3 phase | | |
|----------------------|-----|-----------------|----------------------|-----|-----------------|----------------------|-----|-----------------|----------------------|-----|-----------------|
| MODEL | AWG | mm ² | MODEL | AWG | mm ² | MODEL | AWG | mm ² | MODEL | AWG | mm ² |
| SD203Y | 14 | 2.5 | SD203Y | 14 | 2.5 | | | | | | |
| SD205Y | 14 | 2.5 | SD205(Y) | 14 | 2.5 | SD405 | 14 | 2.5 | | | |
| SD210Y | 14 | 2.5 | SD210(Y) | 14 | 2.5 | SD410 | 14 | 2.5 | SD510 | 14 | 2.5 |
| SD215Y | 14 | 2.5 | SD215(Y) | 14 | 2.5 | SD415 | 14 | 2.5 | | | |
| SD220Y | 14 | 2.5 | SD220(Y) | 14 | 2.5 | SD420 | 14 | 2.5 | SD520 | 14 | 2.5 |
| SD230Y | 12 | 4.0 | SD230(Y) | 14 | 2.5 | SD430 | 14 | 2.5 | SD530 | 14 | 2.5 |
| SD250Y | 10 | 6.0 | SD250(Y) | 12 | 4.0 | SD450 | 14 | 2.5 | SD550 | 14 | 2.5 |
| | | | SD275 | 10 | 6.0 | SD475 | 14 | 2.5 | SD575 | 14 | 2.5 |
| | | | SD2100 | 8 | 10 | SD4100 | 12 | 4.0 | SD5100 | 14 | 2.5 |
| | | | SD2150 | 6 | 16 | SD4150 | 10 | 6.0 | SD5150 | 10 | 6.0 |
| | | | SD2200 | 4 | 25 | SD4200 | 8 | 10 | SD5200 | 10 | 6.0 |
| | | | | | | SD4250 | 6 | 16 | SD5250 | 8 | 10 |

8.0 POWER WIRING

WARNING!

Hazard of electrical shock! Capacitors retain charge after power is removed. Disconnect incoming power and wait until the voltage between terminals B+ and B- is 0 VDC before servicing the drive.

Note drive input and output current ratings and check applicable electrical codes for required wire type and size, grounding requirements, over-current protection, and incoming power disconnect, before wiring the drive. Size conservatively to minimize voltage drop.

Strip off 0.20 to 0.25 inches (5 to 6 mm) of insulation for input power, output power, and DC Bus wiring.

The input power, output power, and DC Bus terminals must be tightened to a torque of 4.5 lb-in (0.5 Nm).

Input fusing and a power disconnect switch or contactor **MUST** be wired in series with terminals L1, L2, and L3 for three phase input models. For 208/240 Vac single phase input models, use terminals L1 and L2. This disconnect must be used to power down the drive when servicing, or when the drive is not to be operated for a long period of time, but should not be used to start and stop the motor.

Repetitive cycling of a disconnect or input contactor (more than once every two minutes) may cause damage to the drive.

8.1 WIRING FOR SINGLE PHASE OR THREE PHASE INPUT


If the drive is rated for single and three phase input (SD200Y models), wire to terminals L1 and L2 for single phase input, or wire to terminals L1, L2, and L3 for three phase input.

If the drive is rated for three phase input, wire the input to terminals L1, L2, and L3.

All three power output wires, from terminals T1, T2, and T3 to the motor, must be kept tightly bundled and run in a separate conduit away from all other power and control wiring.

It is not recommended to install contactors or disconnect switches between the drive and motor. Operating such devices while the drive is running can potentially cause damage to the drive's power components. If such a device is required, it should only be operated when the drive is in a STOP state. If there is potential for the device to be opened while the drive is running, the drive must be programmed for COAST to stop (see Parameter 4 - STOP METHOD), and an auxiliary contact on the device must be interlocked with the drive's run circuit. This will give the drive a stop command at the same time the device opens, and will not allow the drive to start again until the device is closed.

9.0 SCD POWER WIRING DIAGRAM

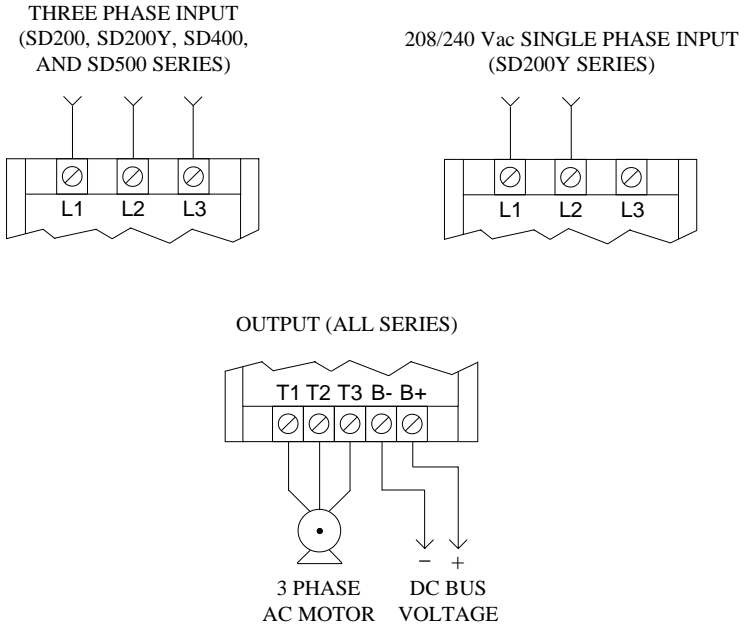

WARNING!

Do not connect incoming AC power to output terminals T1, T2, or T3. Severe damage to the drive will result.

NOTES:

1. WIRE AND GROUND IN ACCORDANCE WITH NEC OR CEC, AND ALL APPLICABLE LOCAL CODES.
2. Motor wires MUST be run in a separate steel conduit away from control wiring and incoming AC power wiring.
3. Do not install contactors between the drive and the motor without consulting AC Technology for more information. Failure to do so may result in drive damage.
4. Use only UL and CSA listed and approved wire.
5. Minimum wire voltage ratings: 300 V for 208 and 240 Vac systems, and 600 V for 400, 480, and 590 Vac systems.
6. Wire gauge must be based on a minimum of 125% of the rated input/output current of the drive, and a minimum 75°C insulation rating. Use copper wire only.
7. Strip off 0.20 to 0.25 inches (5 to 6 mm) of insulation for input power, output power, and DC Bus wiring.

10.0 CONTROL WIRING

10.1 CONTROL WIRING VS. POWER WIRING

External control wiring **MUST** be run in a separate conduit away from all other input and output power wiring. If control wiring is not kept separate from power wiring, electrical noise may be generated on the control wiring that will cause erratic drive behavior. Use twisted wires or shielded cable grounded at the drive chassis **ONLY**. Recommended control wire is Belden 8760 (2-wire) or 8770 (3-wire), or equivalent.

Strip off 0.20 to 0.25 inches (5 to 6 mm) of insulation for control wiring, and torque the control terminals to 2 lb-in (0.2 Nm). Be careful not to overtorque the control terminals, as this will cause damage to the terminal strip. This is not covered under warranty and can only be repaired by replacing the control board.

10.2 TB-2 AND TB-4

The TB-2 terminal is the circuit common for the analog input and analog output functions. If necessary TB-2 may be connected to chassis ground.

The TB-4 terminal is the reference for all of the digital inputs (TB-1, 12, 13A, 13B, 13C). On standard SCD drives, TB-4 is at zero volt potential. Therefore, the digital inputs are active-low.

10.3 SURGE SUPPRESSION ON RELAYS

Current and voltage surges and spikes in the coils of contactors, relays, solenoids, etc, near or connected to the drive, can cause erratic drive operation. Therefore, a snubber circuit should be used on coils associated with the drive. For AC coils, snubbers should consist of a resistor and a capacitor in series across the coil. For DC coils, a free-wheeling or flyback diode should be placed across the coil. Snubbers are typically available from the manufacturer of the device.

10.4 START/STOP CONTROL

There are various control schemes that allow for 2-wire and 3-wire Start/Stop circuits. Refer to the wiring diagrams in Section 11.0 - SCD CONTROL WIRING DIAGRAMS

10.5 SPEED REFERENCE SIGNALS

The drive allows for three analog speed reference inputs:

- | | |
|-----------|---|
| SPEED POT | Connect the wiper of a speed pot (rated 2.5k Ω up to 10k Ω) to terminal TB-5/25, and connect the high and low end leads to terminals TB-11 and TB-2, respectively. |
| 0-10 VDC | Wire the positive to terminal TB-5/25 and the negative to terminal TB-2. TB-5/25 input impedance is 120 kilohms when programmed for 0-10 VDC input. |
| 4-20 mA | Wire the positive to terminal TB-5/25 and the negative to terminal TB-2. TB-5/25 input impedance is 100 ohms when programmed for 4-20 mA. |

NOTE: When the drive is powered down, the input impedance of terminal TB-5/25 becomes 57 kilohms. If TB-5/25 was programmed as a 4-20 mA input, the 4-20 mA source will suddenly encounter a high input impedance.

10.6 SPEED REFERENCE SELECTION

If only one speed reference is required, set Parameter 05 - STANDARD SPEED SOURCE to the desired speed reference. The selections are: KEYPAD (the ▲ and ▼ buttons on the front of the drive), PRESET SPEED #1 (Parameter 31), a 0-10 VDC signal, or a 4-20 mA signal.

If multiple speed references are required, terminals 13A, 13B, and 13C can be programmed to select other speed references in addition to the STANDARD SPEED SOURCE (Parameter 05). When the TB-13 terminal is closed to TB-4, the drive will follow the selected speed reference. If a speed reference is not selected using TB-13A, 13B, or 13C, speed control will default back to the source programmed in STANDARD SPEED SOURCE.

When using the DeviceNet interface, speed reference selection can be done as described above. However, DeviceNet can override the selected speed reference and directly control the drive speed. Refer to Appendix B - DEVICENET CONTROL for more information.

0 - 10 VDC and 4 - 20 mA INPUT SIGNALS

TB-13A, TB-13B, and TB-13C can all be programmed to select a 0-10 VDC or 4-20 mA analog speed reference input.

PRESET SPEEDS

TB-13A can be programmed to select PRESET SPEED #1, TB-13B to select PRESET SPEED #2, and TB-13C to select PRESET SPEED #3. There are a total of seven preset speeds, which are activated by different combinations of contact closures between TB-13A, 13B, 13C and TB-4. Refer to Parameters 31-37 in Section 15.0 - DESCRIPTION OF PARAMETERS.

JOG

TB-13B can be programmed to select either JOG FORWARD or JOG REVERSE. The Jog speed is set by PRESET SPEED #2. Close TB-13B to TB-4 to JOG, and open the contact to STOP.

WARNING!

When operating in JOG mode, the STOP terminal (TB-1) and the STOP key (on the optional remote keypad) **WILL NOT** stop the drive. To stop the drive, remove the JOG command.

JOG REVERSE will operate the drive in reverse rotation even if ROTATION DIRECTION (Parameter 17) is set to FORWARD ONLY.

NOTE: If the drive is commanded to JOG while running, the drive will enter JOG mode and run at PRESET SPEED #2. When the JOG command is removed, the drive will STOP.

MOTOR OPERATED POT (MOP) / FLOATING POINT CONTROL

TB-13B and TB-13C are used for this function, which controls the drive speed using contacts wired to the terminal strip. Program TB-13B for DECREASE FREQ (05), and program TB-13C for INCREASE FREQ (05). Closing TB-13B to TB-4 will cause the speed setpoint to decrease until the contact is opened. Closing TB-13C to TB-4 will cause the speed setpoint to increase until the contact is opened. The INCREASE FREQ function will only operate while the drive is running.

NOTE: If TB-13A, TB-13B, and TB-13C are all programmed to select speed references, and two or three of the terminals are closed to TB-4, the higher terminal has priority and will override the others. For example, if TB-13A is programmed to select 0-10VDC, and TB-13C is programmed to select PRESET SPEED #3, closing both terminals to TB-4 will cause the drive to respond to PRESET SPEED #3, because TB-13C overrides TB-13A.

The exception to this is the MOP function, which requires the use of TB-13B and TB-13C. This leaves TB-13A to be used for some other function. If TB-13A is programmed for a speed reference, and TB-13A is closed to TB-4, TB-13A will override the MOP function.

10.7 ANALOG OUTPUT SIGNALS

Terminal TB-30 can provide a 0-10 VDC or a 2-10 VDC signal proportional to output frequency or load, and TB-31 can provide the same signals proportional to load only. The 2-10 VDC signal can be converted to a 4-20 mA signal using a resistor in series with the signal such that the total load resistance is 500 Ohms. Refer to Parameters 08 and 09 in Section 15.0 - DESCRIPTION OF PARAMETERS.


NOTE: These analog output signals cannot be used with “loop-powered” devices that derive power from a 4-20 mA signal.

10.8 DRIVE STATUS DIGITAL OUTPUTS

There are two open-collector outputs at terminals TB-14 and TB-15. The open-collector circuits are current-sinking types rated at 30 VDC and 50 mA maximum.

The open-collector outputs can be programmed to indicate one of various drive status conditions. Refer to Parameters 06 and 13 in Section 15.0 - DESCRIPTION OF PARAMETERS.


The diagram below illustrates how the 12 VDC power supply at TB-11 can be used with the open-collector output to drive an external relay:

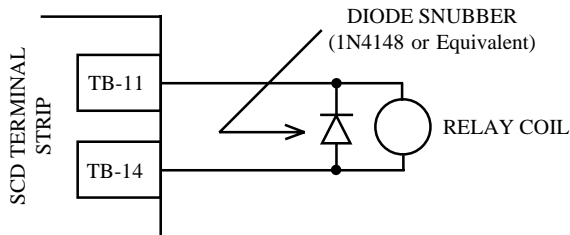

11.0 SCD CONTROL WIRING DIAGRAMS

11.1 SCD TERMINAL STRIP

Shown below is the terminal strip on the main control board, along with a brief description of the function of each terminal.

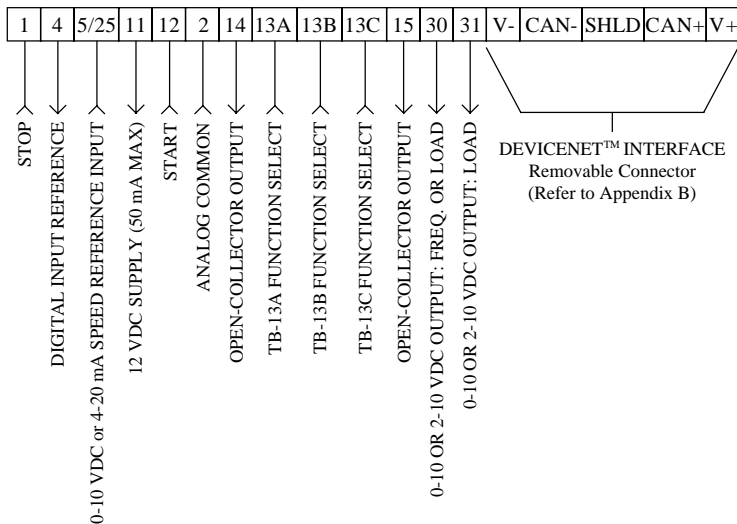


NOTE: The function of terminals TB-13A, TB-13B, TB-13C, TB-14, TB-15, TB-30, and TB-31 are dependent on the programming of certain parameters. Refer to Sections 14.0 - PARAMETER MENU and 15.0 - DESCRIPTION OF PARAMETERS.

Additional information on operating the drive from the terminal strip can be found in Section 10.0 - CONTROL WIRING. The following diagrams provide a quick reference to wire the drive for the most common configurations.

11.2 TWO-WIRE START/STOP CONTROL

Shown below is the wiring diagram for a typical two-wire start/stop control scheme, using one maintained contact (such as that from a PLC) for RUN and STOP commands.

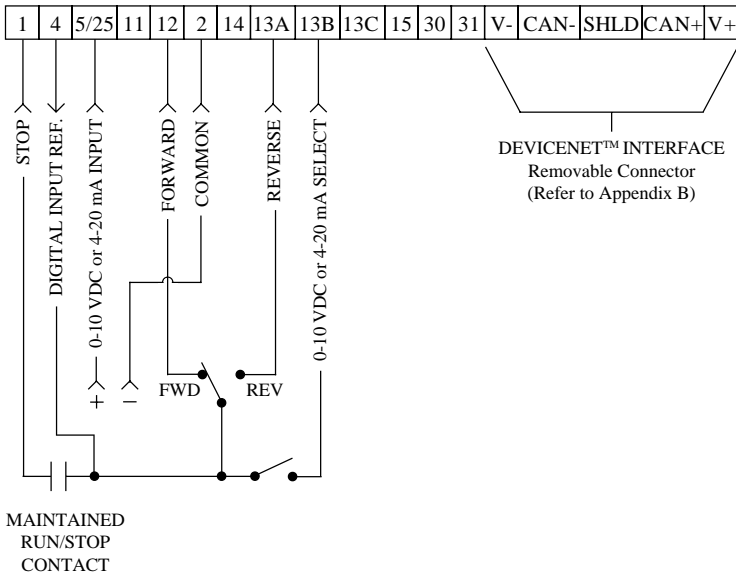


NOTES:

1. Close TB-1 to TB-4 to RUN, and open TB-1 to TB-4 to STOP.
2. If reverse direction is also required, ROTATION DIRECTION (Parameter 17) must be set to FORWARD AND REVERSE (02), and TB-13A (Parameter 10) must be set to START REVERSE (06). If reverse direction is not required, TB-12 must be wired directly to TB-4.
3. For 0-10 VDC or 4-20 mA speed control, use one of the following methods:
 1. Program one of the TB-13 terminals (13A, 13B, or 13C) for 0-10 VDC (02) or 4-20 mA (03). When that TB-13 terminal is closed to TB-4, the drive will respond to the selected speed reference signal. If that TB-13 terminal is not closed to TB-4, the drive will respond to the speed control source selected in Parameter 05 - STANDARD SPEED SOURCE. This method must be used if it is necessary to toggle between two speed sources.
 2. Program Parameter 05 - STANDARD SPEED SOURCE for 0-10 VDC (03) or 4-20 mA (04). This method is preferable if only one speed source is required, as this method leaves the TB-13 terminals free to be used for other functions.

11.3 ALTERNATE TWO-WIRE START/STOP CONTROL

Shown below is the wiring diagram for an alternate two-wire start/stop control scheme, using one maintained contact for RUN FORWARD and another maintained contact for RUN REVERSE.

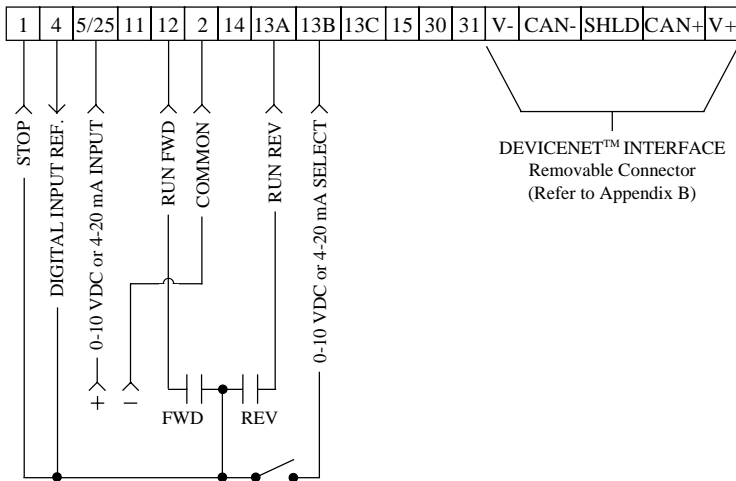


DEVICENET™ INTERFACE
Removable Connector
(Refer to Appendix B)

NOTES:

1. For this control scheme, TB-13A MUST be set to RUN REVERSE (05), even if REVERSE direction is not required. Refer to Parameter 10 - TB13A FUNCTION.
2. Close TB-12 to TB-4 to RUN in forward direction, and open TB-12 to TB-4 to STOP.
3. If reverse direction is also required, ROTATION DIRECTION (Parameter 17) must be set to FORWARD AND REVERSE (02). Close TB-13A to TB-4 to RUN in REVERSE, and open TB-13A to TB-4 to STOP. If TB-12 and TB-13A are both closed to TB-4, the drive will STOP.
4. For 0-10 VDC or 4-20 mA speed control, use one of the following methods:
 1. Program one of the TB-13 terminals (13A, 13B, or 13C) for 0-10 VDC (02) or 4-20 mA (03). When that TB-13 terminal is closed to TB-4, the drive will respond to the selected speed reference signal. If that TB-13 terminal is not closed to TB-4, the drive will respond to the speed control source selected in Parameter 05 - STANDARD SPEED SOURCE. This method must be used if it is necessary to toggle between two speed reference sources.
 2. Program Parameter 05 - STANDARD SPEED SOURCE for 0-10 VDC (03) or 4-20 mA (04). This method is preferable if only one speed reference source is required, as this method leaves the TB-13 terminals free to be used for other functions.

11.4 THREE-WIRE START/STOP CONTROL

Shown below is the wiring diagram for a typical three-wire start/stop control scheme, using momentary contacts (such as pushbuttons) for START and STOP commands.

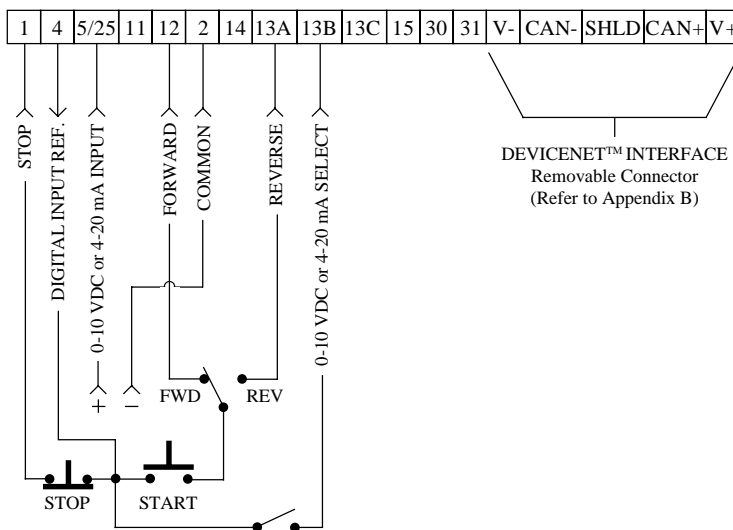


NOTES:

1. Momentarily close TB-12 to TB-4 to START the drive in forward direction, and momentarily open TB-1 to TB-4 to STOP the drive.
2. If reverse direction is also required, ROTATION DIRECTION (Parameter 17) must be set to FORWARD AND REVERSE (02), and TB-13A (Parameter 10) must be set to START REVERSE (06). If the FWD/REV switch is changed while the drive is running, the drive will not change direction until the START button is pushed. If reverse direction is not required, the other side of the START pushbutton must be wired directly to TB-12.
3. For 0-10 VDC or 4-20 mA speed control, use one of the following methods:
 1. Program one of the TB-13 terminals (13A, 13B, or 13C) for 0-10 VDC (02) or 4-20 mA (03). When that TB-13 terminal is closed to TB-4, the drive will respond to the selected speed reference signal. If that TB-13 terminal is not closed to TB-4, the drive will respond to the speed control source selected in Parameter 05 - STANDARD SPEED SOURCE. This method must be used if it is necessary to toggle between two speed sources.
 2. Program Parameter 05 - STANDARD SPEED SOURCE for 0-10 VDC (03) or 4-20 mA (04). This method is preferable if only one speed source is required, as this method leaves the TB-13 terminals free to be used for other functions.

11.5 SPEED POT AND PRESET SPEED CONTROL

Shown below is the wiring for SPEED POT and/or PRESET SPEED control, and either a two-wire or three-wire start/stop circuit:

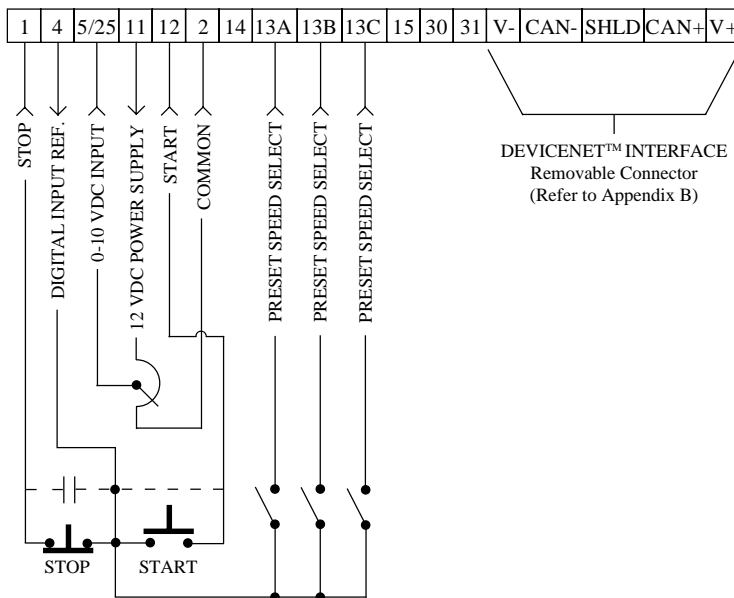

NOTES:

1. Program the PRESET SPEEDS (Parameters 31-37) to the desired values.
2. Program TB-13A (Parameter 10) to PRESET SPEED #1 (04), TB-13B (Parameter 11) to PRESET SPEED #2 (04), and TB-13C (Parameter 12) to PRESET SPEED #3 (04). To select a preset speed, close the appropriate TB-13 terminal(s) to TB-2 (refer to Parameters 31-37 for the Preset Speed Activation table).
3. If reverse rotation is also required, TB-13A cannot be used as a PRESET SPEED SELECT. TB-13A must be programmed to select RUN REVERSE (05) or START REVERSE (06), leaving only TB-13B and TB-13C to select preset speeds.
4. For speed pot control, program Parameter 05 - STANDARD SPEED SOURCE for 0-10 VDC (03). If none of the preset speeds are selected (all of the TB-13 terminals are open), the drive will respond to the speed pot.

12.0 INITIAL POWER UP AND MOTOR ROTATION

WARNING!

DO NOT connect incoming AC power to output terminals T1, T2, and T3! Severe damage to the drive will result. Do not continuously cycle input power to the drive more than once every two minutes. Damage to the drive will result.

WARNING!

Hazard of electrical shock! Wait three minutes after disconnecting incoming power before servicing drive. Capacitors retain charge after power is removed.

WARNING!

Severe damage to the drive can result if it is operated after a long period of storage or inactivity without reforming the DC bus capacitors!

If input power has not been applied to the drive for a period of time exceeding three years (due to storage, etc), the electrolytic DC bus capacitors within the drive can change internally, resulting in excessive leakage current. This can result in premature failure of the capacitors if the drive is operated after such a long period of inactivity or storage.

In order to reform the capacitors and prepare the drive for operation after a long period of inactivity, apply input power to the drive for 8 hours prior to actually operating the motor.

Before attempting to operate the drive, motor, and driven equipment, be sure all procedures pertaining to installation and wiring have been properly followed.



Disconnect the driven load from the motor. Verify that the drive input terminals (L1, L2, and L3) are wired to the proper input voltage per the nameplate rating of the drive.

Energize the incoming power line. The LED display will flash a three digit number (322 in the example below) that identifies the parameter version contained in the drive. The display should then read "--", which indicates that the drive is in a STOP condition. This is shown below:

Apply input power

Display flashes parameter version (300-399)

Display then reads "--"



Follow the procedure below to check the motor rotation. This procedure assumes that the drive has been powered up for the first time, and that none of the parameters have been changed.

1. Use the ▼ button to decrease the speed setpoint to 00.0 Hz. The left decimal point will illuminate as the speed setpoint is decreased. If the ▼ button is held down, the speed setpoint will decrease by tenths of Hz until the next whole Hz is reached, and then it will decrease by one Hz increments. Otherwise, each push of the ▼ button will decrease the speed setpoint by a tenth of a Hz.

Once 00.0 Hz is reached, the display will toggle between “00.0” and “- - -”, which indicates that the drive is in a STOP condition with a speed setpoint of 00.0 Hz.

2. Give the drive a START command. This can be done using one of several wiring methods described in Section 11.0 - SCD CONTROL WIRING DIAGRAMS. Once the START command is issued, the display will read “00.0”, indicating that the drive is in a RUN condition with a speed setpoint of 00.0 Hz.
3. Use the ▲ button to increase the speed setpoint until the motor starts to rotate. The left decimal point will light as the speed setpoint is increased. If the ▲ button is held down, the speed setpoint will increase by tenths of Hz until the next whole Hz is reached, and then it will increase by one Hz increments. Otherwise, each push of the button will increase the speed setpoint by a tenth of a Hz.
4. If the motor is rotating in the wrong direction, give the drive a STOP command and remove power from the drive. Wait three minutes for the bus capacitors to discharge, and swap any two of the motor wires connected to T1, T2, and T3.

NOTE: The drive is phase insensitive with respect to incoming line voltage. This means that the drive will operate with any phase sequence of the incoming three phase voltage. Therefore, to change the motor rotation, the phases must be swapped at the drive output terminals or at the motor.

13.0 PROGRAMMING THE SCD DRIVE

The drive may be programmed by one of three methods: using the three buttons and 3-digit LED display on the front of the drive, programming the Electronic Programming Module (EPM) using the optional EPM Programmer, and through the DeviceNet interface (refer to Appendix B). This section describes programming the drive using the buttons and display, which are shown below:




To enter the PROGRAM mode to access the parameters, press the **Mode** button. This will activate the PASSWORD prompt (if the password has not been disabled). The display will read "00" and the upper right-hand decimal point will be blinking, as shown below:

Press **Mode**

Display reads "00"

Upper right decimal point blinks





Use the **▲** and **▼** buttons to scroll to the password value (the factory default password is "225") and press the **Mode** button. Once the correct password value is entered, the display will read "P01", which indicates that the PROGRAM mode has been accessed at the beginning of the parameter menu (P01 is the first parameter). This is shown below:

Use **▲** and **▼** to scroll to the password value

Press **Mode** to enter password


Parameter menu is accessed at the first parameter



NOTE: If the display flashes “Er”, the password was incorrect, and the process to enter the password must be repeated.

Use the ▲ and ▼ buttons to scroll to the desired parameter number. In the example below, Parameter 19 is being displayed, which is the ACCELERATION TIME of the drive:


Use ▲ and ▼ to scroll to the desired parameter number (the example is Parameter 19 - ACCELERATION TIME)



Once the desired parameter number is found, press the **Mode** button to display the present parameter setting. The upper right-hand decimal point will begin blinking, indicating that the present parameter setting is being displayed, and that it can be changed by using the ▲ and ▼ buttons.


Press **Mode** to display present parameter setting (example setting is 20.0)

Upper right decimal point blinks



Use ▲ and ▼ to change setting (example setting changed to 30.0)

Press **Mode** to store new setting



Pressing the **Mode** will store the new setting and also exit the PROGRAM mode. To change another parameter, press the **Mode** key again to re-enter the PROGRAM mode (the parameter menu will be accessed at the parameter that was last viewed or changed before exiting). If the **Mode** key is pressed within two minutes of exiting the PROGRAM mode, the password is not required access the parameters. After two minutes, the password must be entered in order to access the parameters again.

13.1 SETTING VALUES IN TENTHS OF UNITS ABOVE 100

Parameter settings and the keypad speed command can always be adjusted in tenths of unit increments from 0.0 to 99.9. Above 100 however, values can be set in whole units or tenths of units, depending on the setting of Parameter 16 - UNITS EDITING.


If Parameter 16 - UNITS EDITING is set to WHOLE UNITS (02), parameter values and the keypad speed command can only be adjusted by whole unit increments above 100. For example, Parameter 19 - ACCELERATION TIME could not be set to 243.7 seconds. It could only be set to 243 or 244 seconds. Likewise, the keypad speed command (set using the ▲ and ▼ buttons) could not be set to 113.4 Hz. It could only be set to 113 or 114 Hz.

If, however, Parameter 16 - UNITS EDITING is set to TENTHS OF UNITS (01), parameter values and the keypad speed command can be adjusted in tenths of unit increments up to a value of 1000 (above 1000, whole unit increments only). Each push of the ▲ or ▼ button will adjust the value by one tenth of a unit. If the ▲ or ▼ button is pressed and held, the value will increment by tenths of units until the next whole unit is reached, and then the value will increment by whole units.

When a value above 100 is being adjusted by tenths of units, the value is shifted to the left by one digit so that the tenths portion of the value can be displayed. This results in the first digit (reading from left to right) of the value disappearing from the display. Also, the lower decimal point will blink to indicate that the actual value is above 100. Once the value is no longer being adjusted, the value will shift back to the right and the tenths portion of the value will disappear.


In the example below, Parameter 19 - ACCELERATION TIME is presently set to 243.0 seconds, and is being increased to 243.7 seconds.

Go to Parameter 19 and press **Mode**
to see present setting ("243" seconds)




Upper right decimal point blinks

Press ▲ button to see tenths portion
Value shifts to the left ("2" disappears)



Upper right decimal point and lower
decimal point blink

Press ▲ button to scroll up to "43.7"



Press **Mode** to store new value

Every SC Series drive has an Electronic Programming Module (EPM) installed on the main control board. The EPM stores the user's parameter settings and special OEM default settings (if programmed). The EPM is removable, allowing it to be installed in another drive for quick set-up. For example, if a drive is being replaced with a new one, the EPM can be taken out of the first drive and installed in the new drive. Downtime is minimized because the new drive does not require programming - it is ready to run when the EPM is installed.

The SC Series drive contains two or three sets of parameter values, depending on whether the drive has been programmed with optional OEM default settings. The first set of values is the factory default settings, which are permanently stored on the main control board and cannot be changed. The second set of values is the user settings, which are stored in the EPM. When the drive leaves the factory, the user settings are the same as the factory default settings, but the user settings can be changed to configure the drive for a particular application. The optional third set of values is the OEM default settings, which are also stored in the EPM. OEM default settings are typically used in cases where many drives are used for the same application, which requires that all of the drives have the same parameter settings. The OEM default settings cannot be changed without the optional EPM Programmer. The drive can be programmed to operate according to the user settings or the OEM default settings (see Parameter 48 in Section 15.0).

NOTE: The drive will not operate without the EPM installed. The drive will display "F1" if the EPM is missing or damaged.

WARNING!

Do not remove the EPM while power is applied to the drive. Damage to the EPM and/or drive may result.

An EPM Programmer is available as an option from AC Tech, which has the ability to quickly and easily program many SC Series drives for the same configuration. Once a "master" EPM is programmed with the desired parameter settings, the EPM Programmer can copy those settings to other EPMs, allowing many drives to be configured very quickly. Please consult the EPM Programmer Instruction Manual or contact the factory for more information.

If the OEM settings in the EPM become corrupted, the drive will operate normally, until an attempt is made to perform a RESET OEM using Parameter 48 - PROGRAM SELECTION. The drive will then flash "GF" to indicate that the OEM settings are no longer valid. This will require that the EPM be re-programmed using the optional EPM Programmer.

If the OEM settings and the user settings are both corrupted, the drive will display "GF" immediately and the drive will require a RESET 60 or RESET 50 using Parameter 48 - PROGRAM SELECTION. Once the RESET is performed, the parameters can then be programmed individually to match the OEM default settings. This will allow the drive to operate as if it were in OEM mode, even though it is actually operating in USER mode. Refer to Parameter 48 in Section 15.0 - DESCRIPTION OF PARAMETERS.

NOTE: The drive will also display "GF" if a RESET OEM or OPERATE WITH OEM SETTINGS is attempted when the drive is not equipped with the OEM default option.

14.0 PARAMETER MENU

| NO. | PARAMETER NAME | RANGE OF ADJUSTMENT | FACTORY DEFAULT (NOTE 1) |
|----------|------------------------------|--|-----------------------------|
| 01 | LINE VOLTAGE | HIGH (01), LOW (02) | HIGH (01) |
| 02 | CARRIER FREQUENCY | 4kHz (01), 6 kHz (02), 8 kHz (03), 10 kHz (04) | 6 kHz (02) |
| 03 | START METHOD | NORMAL (01), START ON POWER UP (02), START WITH DC BRAKE (03), AUTO RESTART WITH DC BRAKE (04), FLYING RESTART 1 (05), FLYING RESTART 2 (06), FLYING RESTART 3 (07) | NORMAL (01) |
| 04 | STOP METHOD | COAST (01), COAST WITH DC BRAKE (02), RAMP (03), RAMP WITH DC BRAKE (04) | COAST (01) |
| 05 | STANDARD SPEED SOURCE | KEYPAD (01), PRESET #1 (02), 0-10 VDC (03), 4-20 mA (04) | KEYPAD (01) |
| 06 13 | TB-14 OUTPUT TB-15 OUTPUT | NONE (01), RUN (02), FAULT (03), INVERSE FAULT (04), FAULT LOCKOUT (05), AT SET SPEED (06), ABOVE PRESET #3 (07), CURRENT LIMIT (08), AUTO SPEED (09), REVERSE (10) | NONE (01) NONE (01) |
| 08 | TB-30 OUTPUT | NONE (01), 0-10 VDC FREQ (02), 2-10 VDC FREQ (03), 0-10 VDC LOAD (04), 2-10 VDC LOAD (05) | NONE (01) |
| 09 | TB-31 OUTPUT | NONE (01), 0-10 VDC LOAD (02), 2-10 VDC LOAD (03), DYNAMIC BRAKING (04) | NONE (01) |
| 10 | TB-13A FUNCTION SELECT | NONE (01), 0-10 VDC (02), 4-20 mA (03), PRESET SPEED #1 (04), RUN REVERSE (05), START REVERSE (06), EXTERNAL FAULT (07), Factory Reserved (08), DB FAULT (09), AUXILIARY STOP (10), ACCEL/DECCEL #2 (11) | NONE (01) |
| 11 | TB-13B FUNCTION SELECT | NONE (01), 0-10 VDC (02), 4-20 mA (03), PRESET SPEED #2 (04), DECREASE FREQ (05), JOG FORWARD (06), JOG REVERSE (07), AUXILIARY STOP (08) | NONE (01) |

NOTE 1: Factory defaults are shown for a 60 Hz base frequency. See Parameter 48 for 50 Hz base frequency.

PARAMETER MENU (CONT'D)

| NO. | PARAMETER NAME | RANGE OF ADJUSTMENT | FACTORY DEFAULT (NOTE 1) |
|------------|---------------------------|---|-------------------------------------|
| 12 | TB-13C FUNCTION SELECT | NONE (01), 0-10 VDC (02), 4-20 mA (03), PRESET SPEED #3 (04), INCREASE FREQ (05), EXTERNAL FAULT (06), Factory Reserved (07), DB FAULT (08), ACCEL/DECEL #2 (09) | NONE (01) |
| 13 | TB-15 OUTPUT | (SEE PARAMETER 6 - TB-14 OUTPUT) | NONE (01) |
| 14 | CONTROL | TERMINAL STRIP & DEVICENET (01), DEVICENET ONLY (02), | TERMINAL STRIP & DEVICENET (01) |
| 16 | UNITS EDITING | TENTHS OF UNITS (01), WHOLE UNITS (02) | WHOLE UNITS (02) |
| 17 | ROTATION | FORWARD ONLY (01), FORWARD AND REVERSE (02) | FORWARD ONLY (01) |
| 19 | ACCELERATION TIME | 0.1 - 3600.0 SEC | 20.0 SEC |
| 20 | DECELERATION TIME | 0.1 - 3600.0 SEC | 20.0 SEC |
| 21 | DC BRAKE TIME | 0.0 - 3600.0 SEC | 0.0 SEC |
| 22 | DC BRAKE VOLTAGE | 0.0 - 30.0 % | 0.0 % |
| 23 | MINIMUM FREQUENCY | 0.0 - MAXIMUM FREQUENCY | 0.0 Hz |
| 24 | MAXIMUM FREQUENCY | MINIMUM FREQ - 240.0 Hz (NOTE 2) | 60.0 Hz |
| 25 | CURRENT LIMIT | 30 - 180 % (NOTE 3) | 180% |
| 26 | MOTOR OVERLOAD | 30 - 100 % | 100% |
| 27 | BASE FREQUENCY | 25.0 - 500.0 Hz (NOTE 4) | 60.0 Hz |
| 28 | FIXED BOOST | 0.0 - 30.0 % | 1.00% |
| 29 | ACCEL BOOST | 0.0 - 20.0 % | 0.00% |
| 30 | SLIP COMPENSATION | 0.0 - 5.0 % | 0.00% |
| 31-37 | PRESET SPEEDS | 0.0 - MAXIMUM FREQUENCY | 0.0 Hz |
| 38 | SKIP BANDWIDTH | 0.0 - 10.0 Hz | 0.0 Hz |
| 39 | SPEED SCALING | 0.0 - 6500.0 | 0 |

NOTE 1: Factory defaults are shown for a 60 Hz base frequency. See Parameter 48 for 50 Hz base frequency.

NOTE 2: Maximum setting is 999.9 Hz on drives with High Output Frequency option. Consult the factory.

NOTE 3: If LINE VOLTAGE is set to LOW, maximum setting is 150%.

NOTE 4: Maximum setting is 1300.0 Hz (factory default is 999.9) on drives with High Output Frequency option. Consult the factory.

PARAMETER MENU (CONT'D)

| NO. | PARAMETER NAME | RANGE OF ADJUSTMENT | FACTORY DEFAULT (NOTE 1) |
|------------|-----------------------|---|-------------------------------------|
| 40 | FREQUENCY SCALING | 3.0 - 2000.0 Hz | 60.0 Hz |
| 41 | LOAD SCALING | 10 - 200 % | 200 % |
| 42 | ACCEL / DECEL #2 | 0.1 - 3600.0 SEC | 20.0 SEC |
| 44 | PASSWORD | 000 - 999 | 225 |
| 47 | CLEAR HISTORY | MAINTAIN (01), CLEAR (02) | MAINTAIN (01) |
| 48 | PROGRAM SELECTION | USER SETTINGS (01), OEM SETTINGS (02), RESET OEM (03), RESET 60 (04), RESET 50 (05), TRANSLATE (06) | USER SETTINGS (01) |
| 50 | FAULT HISTORY | (VIEW-ONLY) | (N/A) |
| 51 | SOFTWARE CODE | (VIEW-ONLY) | (N/A) |
| 52 | DC BUS VOLTAGE | (VIEW-ONLY) | (N/A) |
| 53 | MOTOR VOLTAGE | (VIEW-ONLY) | (N/A) |
| 54 | LOAD | (VIEW-ONLY) | (N/A) |
| 55 | 0-10 VDC INPUT | (VIEW-ONLY) | (N/A) |
| 56 | 4-20 mA INPUT | (VIEW-ONLY) | (N/A) |
| 57 | TB STRIP STATUS | (VIEW-ONLY) | (N/A) |
| 58 | KEYPAD STATUS | (VIEW-ONLY) | (N/A) |
| 59 | TB-30 OUTPUT | (VIEW-ONLY) | (N/A) |
| 60 | TB-31 OUTPUT | (VIEW-ONLY) | (N/A) |
| 85 | MOTOR RATED RPM | 1 - 65000 RPM | 1800 RPM |
| 86 | MOTOR RATED AMPS | 0.0 - 999.9 AMPS | 100.0 AMPS |
| 87 | MOTOR RATED VOLTS | 0 - 1000 VOLTS | 100 VOLTS |
| 88 | MOTOR RATED FREQ | 0 - 1000 Hz | 60 Hz |
| 89 | DRIVE RATED AMPS | 0.0 - 999.9 AMPS | 100.0 AMPS |
| 90 | DRIVE RATED VOLTS | 0 - 1000 VOLTS | 100 VOLTS |

NOTE 1: Factory defaults are shown for a 60 Hz base frequency. See Parameter 48 for 50 Hz base frequency.

PARAMETER MENU (CONT'D)

| NO. | PARAMETER NAME | RANGE OF ADJUSTMENT | FACTORY DEFAULT (NOTE 1) |
|------------|-----------------------|---|-------------------------------------|
| C00 | DNET NODE ADDRESS | 0 - 63 | 63 |
| C01 | DNET BAUD RATE | 125 kbps (0), 250 kbps (1), 500 kbps (2) | 125 kbps (0) |
| C02 | DNET LOSS ACTION | FAULT & STOP (0), IGNORE (1), AC TECH (2) | FAULT & STOP (0) |
| C03 | DNET OUTPUT ASSY | 1 BASIC CONTACTOR (1), 2 BASIC OVERLOAD (2), 3 BASIC MOTOR STARTER (3), 4 EXTENDED CONTACTOR (4), 5 EXTENDED MOTOR STARTER (5), 20 BASIC SPEED CONTROL (6), 21 EXTENDED SPEED CONTROL (7), 100 EXTENDED SPEED CONTROL Hz (8) | 20 BASIC SPEED CONTROL (6) |
| C04 | DNET INPUT ASSY | 50 BASIC OVERLOAD (1), 51 EXTENDED OVERLOAD (2) 52 BASIC MOTOR CONTROL (3), 53 EXTENDED MOTOR CONTROL 1 (4), 54 EXTENDED MOTOR CONTROL 2 (5), 70 BASIC SPEED CONTROL (6), 71 EXTENDED SPEED CONTROL (7), 101 EXTENDED SPEED CONTROL Hz (8), 102 CUSTOM ASSEMBLY (9) | 70 BASIC SPEED CONTROL (6) |
| C05 | DNET CUSTOM ASSY 0 | 0 - 150 | 0 |
| C06 | DNET CUSTOM ASSY 1 | 0 - 150 | 0 |
| C07 | DNET CUSTOM ASSY 2 | 0 - 150 | 0 |
| C08 | DNET CUSTOM ASSY 3 | 0 - 150 | 0 |
| C09 | DNET MOTOR TYPE | NON-STANDARD MOTOR (0), PM DC MOTOR (1), FC DC MOTOR (2), PM SYNCH. MOTOR (3), FC SYNCH. MOTOR (4), SWITCHED RELUCT. (5), WOUND ROTOR INDUCTION (6), SQUIRREL CAGE INDUCTION (7), STEPPER MOTOR (8), SINUSOIDAL PMBL (9), TRAPEZOIDAL PMBL (10) | SQUIRREL CAGE INDUCTION (7) |
| C10 | DNET DIAGNOSTICS | (READ ONLY) | (N/A) |

15.0 DESCRIPTION OF PARAMETERS

P01 LINE VOLTAGE SELECTION

This calibrates the drive for the actual applied input voltage, and can be set to HIGH (01) or LOW (02). Refer to the table below for the proper setting depending on the input voltage.

| MODEL | RATED INPUT VOLTAGE | INPUT PHASE | APPLIED INPUT VOLTAGE | PARAMETER SETTING |
|--------|---------------------|-------------|-----------------------|-------------------|
| SF200Y | 208 / 240 Vac | 1 or 3 | 220 - 240 Vac | HIGH (01) |
| | | 1 or 3 | 200 - 208 Vac | LOW (02) |
| SF200 | 208 / 240 Vac | 3 | 220 - 240 Vac | HIGH (01) |
| | | 3 | 200 - 208 Vac | LOW (02) |
| SF400 | 400 / 480 Vac | 3 | 440 - 480 Vac | HIGH (01) |
| | | 3 | 380 - 415 Vac | LOW (02) |
| SF500 | 480 / 590 Vac | 3 | 575 - 600 Vac | HIGH (01) |
| | | 3 | 460 - 480 Vac | LOW (02) |

NOTE: If this parameter is changed while the drive is running, the new value will not take effect until the drive is stopped.

P02 CARRIER FREQUENCY

This sets the switching rate of the output IGBT's. Increasing the carrier frequency will result in less audible motor noise. Available settings are: 4 kHz, 6 kHz, 8 kHz, and 10 kHz.

| PARAMETER SETTING | CARRIER FREQUENCY | MAXIMUM OUTPUT FREQUENCY (NOTE 1) | AMBIENT OR OUTPUT DERATE (NOTE 2) |
|-------------------|-------------------|-----------------------------------|-----------------------------------|
| 01 | 4 kHz | 240.0 Hz (400.0 Hz) | 50 C or 100% |
| 02 | 6 kHz | 240.0 Hz (600.0 Hz) | 50 C or 100% |
| 03 | 8 kHz | 240.0 Hz (999.9 Hz) | 43 C or 92% |
| 04 | 10 kHz | 240.0 Hz (999.9 Hz) | 35 C or 82% |

NOTE 1: For drives with the High Output Frequency option, the carrier frequency also determines the maximum output frequency (shown in parenthesis).

NOTE 2: The SCD drive is fully rated up to 6 kHz carrier frequency. If the 8 kHz or 10 kHz carrier frequency is selected, the drive's ambient temperature rating OR output current rating must be derated to the value shown in the table above.

NOTE 3: If this parameter is changed while the drive is running, the change will not take effect until the drive is stopped. Therefore, the allowable maximum frequency for drives with the High Output Frequency option (see NOTE 1) will not change if the carrier frequency is changed while the drive is running.

P03 START METHOD

WARNING!

Automatic starting of equipment may cause damage to equipment and/or injury to personnel! Automatic start should only be used on equipment that is inaccessible to personnel.

- 01 **NORMAL:** The drive will start when the appropriate contact is closed on the terminal strip, or by pressing the START key on the optional remote keypad. See Parameter 14.
- 02 **START ON POWER UP:** The drive will automatically start upon application of input power.
- 03 **START WITH DC BRAKE:** When a START command is given, the drive will apply DC BRAKE VOLTAGE (Parameter 22) for the duration of DC BRAKE TIME (Parameter 21) prior to starting the motor to ensure that the motor is not turning.
- 04 **AUTO RESTART WITH DC BRAKING:** Upon a START command, after a fault, or upon application of power, the drive will apply DC BRAKE VOLTAGE (Parameter 22) for the duration of DC BRAKE TIME (Parameter 21) prior to starting (or restarting) the motor.
- 05 **FLYING RESTART 1: LOW performance.** Slowest synchronization and lowest current level. This setting results in the smoothest synchronization.
- 06 **FLYING RESTART 2: MEDIUM performance.** Faster synchronization and higher current level. This setting allows faster synchronization while retaining smoothness.
- 07 **FLYING RESTART 3: HIGH performance.** Fastest synchronization and highest current level. This setting allows the fastest synchronization, but sacrifices smoothness.

The FLYING RESTART 1 - 3 settings allow the drive to start into a spinning load after a fault or upon application of input power. They differ in the time required to find the motor and the amount of current required to synchronize with it. The faster the drive attempts to find the motor, the more current is required.

When programmed for auto-restart, the drive will attempt three restarts after a fault. The interval between restart attempts is 15 seconds for setting 04, and 2 seconds for settings 05, 06 and 07. During the interval between restart attempts, the display will read "SP" to indicate Start Pending. If all three restart attempts fail, the drive will trip into FAULT LOCKOUT (displayed "LC") and require a manual reset. Refer to Section 16.0 - TROUBLESHOOTING.

NOTE: Settings 02 and 04 - 07 require a two-wire start/stop circuit to operate. The RUN contact must remain closed for the power-up start and auto-restart functions to operate.

P04 STOP METHOD

- 01 **COAST TO STOP:** When a STOP command is given, the drive shuts off the output to the motor, allowing it to coast freely to a stop.
- 02 **COAST WITH DC BRAKE:** When a stop command is given, the drive will activate DC braking (after a delay of up to 2 seconds, depending on frequency) to help decelerate the load. Refer to Parameters: 21 - DC BRAKE TIME, and 22 - DC BRAKE VOLTAGE.
- 03 **RAMP TO STOP:** When a stop command is given, the drive will decelerate the motor to a stop at the rate determined by Parameter 20 - DECELERATION TIME.
- 04 **RAMP WITH DC BRAKE:** When a stop command is given, the drive will decelerate the motor down to 0.2 Hz (at the rate set by Parameter 20 - DECELERATION TIME) and then activate DC braking according to the settings of Parameters 21 - DC BRAKE TIME and 22 - DC BRAKE VOLTAGE. This is used to bring the load to a final stop, as the motor may still be turning slightly after the drive stops.

P05 STANDARD SPEED SOURCE

This selects the speed reference source when the drive is in STANDARD speed mode. The following speed references can be selected:

- 01 **KEYPAD:** Use the ▲ and ▼ buttons to scroll to the desired speed.
- 02 **PRESET SPEED #1:** The drive will operate at the frequency set into Parameter 31.
- 03 **0 - 10 VDC:** The drive will respond to a 0-10 VDC signal wired to TB-2 and TB-5/25.
- 04 **4 - 20 mA:** The drive will respond to a 4-20 mA signal wired to TB-2 and TB-5/25.

P06 TB-14 OPEN COLLECTOR OUTPUT

This selects the status indication for the open-collector output at TB-14. The terms “open” and “close” refer to the state of the internal transistor that activates the circuit. When the transistor is “closed”, TB-14 is at the same potential as TB-2, allowing current to flow.

- 01 **NONE:** Disables the open-collector output.
- 02 **RUN:** Closes upon a START command. Opens if the drive is in a STOP state, the drive faults, or input power is removed. DC braking is considered a STOP state.
- 03 **FAULT:** Closes if there is no fault condition. Opens if the drive faults, or input power is removed.
- 04 **INVERSE FAULT:** Closes if the drive faults. Opens if there is no fault condition.
- 05 **FAULT LOCKOUT:** Closes when input power is applied. Opens if three restart attempts are unsuccessful, or if input power is removed.

- 06 AT SET SPEED: Closes if the drive is within ± 0.5 Hz of the speed setpoint.
- 07 ABOVE PRESET SPEED #3: Closes if the output frequency exceeds the PRESET SPEED #3 setting. Opens if the output frequency is equal to or less than PRESET SPEED #3 (Parameter 33).
- 08 CURRENT LIMIT: Closes if the output current exceeds the CURRENT LIMIT setting. Opens if the output current is equal to or less than CURRENT LIMIT (see Parameter 25).
- 09 AUTOMATIC SPEED MODE: Closes if an AUTOMATIC (terminal strip) speed reference is active. Opens if a STANDARD (Parameter 5) speed reference is active.
- 10 REVERSE: Closes when reverse rotation is active. Opens when forward rotation is active. (see Parameter 17 - ROTATION DIRECTION).

P08 TB-30 ANALOG OUTPUT

Terminal TB-30 can be used as an analog output proportional to either output frequency or load. FREQUENCY SCALING (Parameter 40) or LOAD SCALING (Parameter 41) can be used to scale the output signal.

- 01 NONE
- 02 0-10 VDC FREQ
- 03 2-10 VDC FREQ
- 04 0-10 VDC LOAD
- 05 2-10 VDC LOAD

NOTE: The 2-10 VDC signal can be converted to a 4-20 mA signal by connecting a resistor in series with the signal such that the total load resistance is 500 Ohms. However, this output cannot be used with devices that derive power from a 4-20 mA signal.

P09 TB-31 ANALOG OUTPUT

Terminal TB-31 can be used as an analog output proportional to load, or as the control signal to activate the optional external Dynamic Braking module. LOAD SCALING (Parameter 41) can be used to scale the output signal when TB-31 is used as an analog output proportional to load.

- 01 NONE
- 02 0-10 VDC LOAD
- 03 2-10 VDC LOAD
- 04 DYNAMIC BRAKING: TB-31 becomes the “trigger” that activates the optional external Dynamic Braking module. Refer to the instructions included with the Dynamic Braking option.

NOTE: The 2-10 VDC signal can be converted to a 4-20 mA signal by connecting a resistor in series with the signal such that the total load resistance is 500 Ohms. However, this output cannot be used with devices that derive power from a 4-20 mA signal.

P10 TB-13A FUNCTION SELECT

This selects the function of terminal TB-13A. Closing TB-13A to TB-4 (or opening in the case of settings 7 and 10) activates the selected function. The following functions can be selected:

- 01 NONE: Disables the TB-13A function.
- 02 0-10 VDC: Selects a 0-10 VDC signal (at TB-5/25) as the AUTO speed reference input.
- 03 4-20 mA: Selects a 4-20 mA signal (at TB-5/25) as the AUTO speed reference input.
- 04 PRESET SPEED #1: Selects PRESET SPEED #1 as the AUTO speed reference. The drive will operate at the frequency programmed into Parameter 31.
- 05 RUN REVERSE: Close TB-13A to TB-4 to RUN in the reverse direction, and open to STOP. This setting forces TB-12 to act as RUN FWD, requiring a maintained contact to RUN in the forward direction. TB-1 must be closed to TB-4 for this function to operate.
- 06 START REVERSE: Momentarily close TB-13A to TB-4 to START the drive in the reverse direction. Momentarily open TB-1 to TB-4 to STOP. This setting forces TB-12 to act as START FWD, requiring a momentary contact to START in the forward direction.
- 07 EXTERNAL FAULT: Sets TB-13A as a normally closed external fault input. If TB-13A is open with respect to TB-4, the drive will fault.
- 08 Factory Reserved: Equivalent to NONE (01).
- 09 DB FAULT: Sets TB-13A as a dynamic braking fault input when using the optional dynamic braking module. When this input is activated by the dynamic braking module, the drive will trip into a "dF" fault and the motor will coast to a stop. Refer to the manual included with the Dynamic Braking option.
- 10 AUXILIARY STOP: When TB-13A is opened with respect to TB-4, the drive will decelerate to a STOP (even if STOP METHOD is set to COAST) at the rate set into Parameter 42 - ACCEL/DECEL #2.
- 11 ACCEL/DECEL #2: Selects the acceleration and deceleration time programmed into Parameter 42 - ACCEL/DECEL #2.

NOTE: In order for the RUN REVERSE and START REVERSE functions to operate, Parameter 17 - ROTATION DIRECTION must be set to FORWARD AND REVERSE (02).

P11 TB-13B FUNCTION SELECT

This selects the function of terminal TB-13B. Closing TB-13B to TB-4 (or opening in the case of setting 08) activates the selected function. The following functions can be selected:

- 01 NONE: Disables the TB-13B function.

- 02 0-10 VDC: Selects a 0-10 VDC signal (at TB-5/25) as the AUTO speed reference input.
- 03 4-20 mA: Selects a 4-20 mA signal (at TB-5/25) as the AUTO speed reference input.
- 04 PRESET SPEED #2: Selects PRESET SPEED #2 as the AUTO speed reference. The drive will operate at the frequency programmed into Parameter 32.
- 05 DECREASE FREQUENCY: Decreases the speed setpoint when using the MOP function. Refer to Section 10.6.
- 06 JOG FORWARD: Jog in the forward direction. In this mode, the drive will JOG at the speed programmed into Parameter 32 - PRESET SPEED #2.
- 07 JOG REVERSE: Jog in the reverse direction. In this mode, the drive will JOG at the speed programmed into Parameter 32 - PRESET SPEED #2.

WARNING!

When operating in JOG mode, the STOP terminal (TB-1), the AUXILIARY STOP function (see setting 08), and the STOP key on the optional remote keypad **WILL NOT** stop the drive. To stop the drive, remove the JOG command.

JOG REVERSE will operate the drive in reverse rotation even if ROTATION DIRECTION (Parameter 17) is set to FORWARD ONLY.

- 08 AUXILIARY STOP: When TB-13B is opened with respect to TB-4, the drive will decelerate to a STOP (even if STOP METHOD is set to COAST) at the rate set into Parameter 42 - ACCEL/ DECEL #2.

NOTE: If the drive is commanded to JOG while running, the drive will enter JOG mode and run at PRESET SPEED #2. When the JOG command is removed, the drive will STOP.

P12 TB-13C FUNCTION SELECT

This selects the function of terminal TB-13C. Closing TB-13C to TB-4 (or opening in the case of setting 06) activates the selected function. The following functions can be selected:

- 01 NONE: Disables the TB-13C function.
- 02 0-10 VDC: Selects a 0-10 VDC signal (at TB-5/25) as the AUTO speed reference input.
- 03 4-20 mA: Selects a 4-20 mA signal (at TB-5/25) as the AUTO speed reference input.
- 04 PRESET SPEED #3: Selects PRESET SPEED #3 as the AUTO speed reference. The drive will operate at the frequency programmed into Parameter 33.
- 05 INCREASE FREQUENCY: Increases the speed setpoint when using the MOP function. Refer to Section 10.6.

- 06 EXTERNAL FAULT: Sets TB-13C as a normally closed external fault input. If TB-13C is open with respect to TB-4, the drive will fault.
- 07 Factory Reserved: Equivalent to NONE (01).
- 08 DB FAULT: Sets TB-13C as a dynamic braking fault input when using the optional dynamic braking module. When this input is activated by the dynamic braking module, the drive will trip into a "dF" fault and the motor will coast to a stop. Refer to the manual included with the Dynamic Braking option.
- 09 ACCEL/DECEL #2: Selects the acceleration and deceleration time programmed into Parameter 42 - ACCEL/DECEL #2.

P13 TB-15 OPEN COLLECTOR OUTPUT

This selects the status indication for the open-collector output at TB-15, and has the same selections as Parameter 6 - TB-14 OPEN COLLECTOR OUTPUT.

P14 CONTROL

This selects the source of START/STOP and direction commands.

- 01 TERMINAL STRIP & DEVICENET: The drive can be controlled from the terminal strip, or can be controlled using DeviceNet serial communications.
- 02 DEVICENET ONLY: The drive can only be controlled using DeviceNet serial communications.

P16 UNITS EDITING

This allows parameter and keypad speed editing in whole units or tenths of units above 100. Below 100, the value can always be changed by tenths of units.

- 01 TENTHS OF UNITS: The value can always be changed by tenths of units (up to a value of 1000). If the ▲ or ▼ button is pressed and held, the value will change by tenths of units until the next whole unit is reached, and then the value will change by whole units. Refer to Section 13.1.
- 02 WHOLE UNITS: The value can be changed by tenths of units until 99.9 is reached. Above 99.9, the value will change in whole unit increments only. Below a value of 100, if the ▲ or ▼ button is pressed and held, the value will change by tenths of units until the next whole unit is reached, and then the value will change by whole units.

P17 ROTATION DIRECTION

- 01 FORWARD ONLY: The drive will only allow rotation in the forward direction. However, JOG REVERSE (see Parameter 11) will still operate even if FORWARD ONLY is selected.
- 02 FORWARD AND REVERSE: The drive will allow rotation in both directions.

P19 ACCELERATION TIME

This parameter sets the acceleration rate for all of the speed reference sources (keypad, speed pot, 4-20 mA, 0-10 VDC, jog, MOP, and preset speeds). This setting is the time to accelerate from 0 Hz to the BASE FREQUENCY (Parameter 27).

P20 DECELERATION TIME

This parameter sets the deceleration rate for all of the speed reference sources (keypad, speed pot, 4-20 mA, 0-10 VDC, jog, MOP, and preset speeds). This setting is the time to decelerate from BASE FREQUENCY to 0 Hz. If the drive is set for COAST TO STOP (setting 01 or 02 in Parameter 04), this parameter will have no effect when a STOP command is given.

P21 DC BRAKE TIME

This determines the length of time that the DC braking voltage is applied to the motor. The DC BRAKE TIME should be set to the lowest value that provides satisfactory operation in order to minimize motor heating.

P22 DC BRAKE VOLTAGE

This sets the magnitude of the DC braking voltage, in percentage of the nominal DC Bus voltage (DC Bus = input AC voltage X 1.414). The point at which the DC braking is activated depends on the selected STOP METHOD (Parameter 04):

If COAST WITH DC BRAKE is selected, the DC braking is activated after a time delay of up to 2 seconds, depending on the output frequency at the time of the STOP command. In this case, the DC braking is the only force acting to decelerate the load.

If RAMP WITH DC BRAKE is selected, braking is activated when the output frequency reaches 0.2 Hz. In this case, the drive decelerates the load to a near stop and the DC braking is used to bring the load to a final stop.

P23 MINIMUM FREQUENCY

This sets the minimum output frequency of the drive for all speed reference sources except the PRESET SPEEDS (Parameters 31-37).

When using a 0-10 VDC or 4-20 mA analog speed reference signal, this parameter also sets the drive speed that corresponds to the minimum analog input (0 VDC or 4 mA).

NOTE: If this parameter is changed while the drive is running, the new value will not take effect until the drive is stopped.

P24 MAXIMUM FREQUENCY

This sets the maximum output frequency of the drive for all speed reference sources, and is used with MINIMUM FREQUENCY (Parameter 23) to define the operating range of the drive.

When using a 0-10 VDC or 4-20 mA analog speed reference signal, this parameter also sets the drive speed that corresponds to the maximum analog input (10 VDC or 20 mA).

NOTE 1: On drives equipped with the High Output Frequency option, this parameter can be set up to 999.9 Hz.

NOTE 2: If this parameter is changed while the drive is running, the new value will not take effect until the drive is stopped.

P25 CURRENT LIMIT

This sets the maximum allowable output current of the drive. The maximum setting is either 180% or 150%, depending on whether LINE VOLTAGE SELECTION (Parameter 01) is set to HIGH or LOW.

The drive will enter current limit when the load demands more current than the CURRENT LIMIT setting. When this happens, the drive will reduce the output frequency in an attempt to reduce the output current. When the overload condition passes, the drive will accelerate the motor back up to the speed setpoint.

P26 MOTOR OVERLOAD

The SCD Series is UL approved for solid state motor overload protection, and therefore does not require a separate thermal overload relay for single motor applications.

The drive contains an adjustable thermal overload circuit that protects the motor from excessive overcurrent. This circuit allows the drive to deliver up to 150% current for one minute. If the overload circuit “times out”, the drive will trip into an OVERLOAD fault (displayed as “PF”).

MOTOR OVERLOAD should be set to the ratio (in percent) of the motor current rating to the drive current rating in order to properly protect the motor. See the example below.

Example: A 3 HP, 480 Vac drive with a 4.8 Amp rating is operating a 2 HP motor with a current rating of 3.4 Amps. Dividing the motor current rating by the drive current rating yields 71% ($3.4 / 4.8 = 0.71 = 71\%$), so this parameter should be set to 71%.

P27 BASE FREQUENCY

The BASE FREQUENCY determines the V/Hz ratio by setting the output frequency at which the drive will output full voltage to the motor. In most cases, the BASE FREQUENCY should be set to match the motor’s rated frequency.


Example: A 460 Vac, 60 Hz motor requires a V/Hz ratio of 7.67 ($460 \text{ V} / 60 \text{ Hz} = 7.67 \text{ V/Hz}$) to produce full torque. Setting the BASE FREQUENCY to 60 Hz causes the drive to output full voltage (460 Vac) at 60 Hz, which yields the required 7.67 V/Hz. Output voltage is proportional to output frequency, so the 7.67 V/Hz ratio is maintained from 0 - 60 Hz, allowing the motor to produce full torque from 2 Hz (below 2 Hz there is less torque due to slip) up to 60 Hz.

NOTE: If this parameter is changed while the drive is running, the new value will not take effect until the drive is stopped.

P28 FIXED BOOST

FIXED BOOST increases starting torque by increasing the output voltage when operating below half of the base frequency, which increases the V/Hz ratio (see diagram below). For better out-of-the-box performance, SCD Series drives are shipped with a setting that is different from the factory default, as seen in the table below. If a factory reset is performed, FIXED BOOST will default to 1.0 %.

| HP | FACTORY SETTING | HP | FACTORY SETTING |
|----------|-----------------|-----|-----------------|
| 0.25 - 1 | 5.3 % | 7.5 | 2.7 % |
| 1.5 | 4.4 % | 10 | 2.4 % |
| 2 | 4.4 % | 15 | 2.2 % |
| 3 | 3.6 % | 20 | 2.0 % |
| 5 | 3.0 % | 25 | 1.8 % |

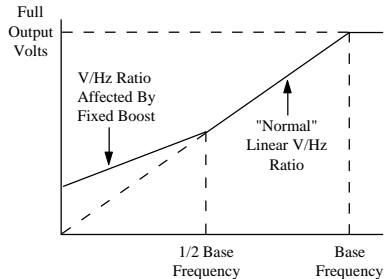

P29 ACCELERATION BOOST

ACCELERATION BOOST helps accelerate high-inertia loads. During acceleration, the output voltage is increased to increase motor torque. Once the motor reaches the new speed setpoint, the boost is turned off and the output voltage returns to the normal value.

P30 SLIP COMPENSATION

SLIP COMPENSATION is used to counteract changes in motor speed (slip) caused by changes in load. In a standard AC induction motor, the shaft speed decreases as load increases, and increases as load decreases. By increasing or decreasing the output frequency in response to an increasing or decreasing load, the slip is counteracted and speed is maintained. Most standard NEMA B motors have a 3% slip rating.

P31-P37 PRESET SPEED #1 - #7

Preset speeds are activated by contact closures between TB-4 and TB-13A, 13B, and 13C. The TB-13 terminals must be programmed as preset speed selects using Parameters 10-12.

NOTE 1: Preset speeds can operate below the frequency defined by the minimum frequency parameter (Parameter 23). The range of adjustment for the preset speeds is from 0 Hz to the maximum frequency (Parameter 24).

Refer to the table below for activation of the preset speeds using the TB-13 terminals.

| SPEED# | TB - 13A | TB - 13B | TB - 13C |
|--------|----------|----------|----------|
| 1 | CLOSED | OPEN | OPEN |
| 2 | OPEN | CLOSED | OPEN |
| 3 | OPEN | OPEN | CLOSED |
| 4 | CLOSED | CLOSED | OPEN |
| 5 | CLOSED | OPEN | CLOSED |
| 6 | OPEN | CLOSED | CLOSED |
| 7 | CLOSED | CLOSED | CLOSED |

NOTE 2: When a TB-13 terminal is programmed for a function other than a preset speed select, it is considered OPEN for the table above.

Preset Speed #6 and #7 can also be used as skip frequencies to restrict the drive from operating at frequencies that cause vibration in the system. See Parameter 38 below.

P38 SKIP BANDWIDTH

The SCD drive has two skip frequencies that can be used to lock out critical frequencies that cause mechanical resonance in the system. Once SKIP BANDWIDTH is set to a value other than 0.0 Hz, the skip frequencies are enabled. When the skip frequency function is enabled, PRESET SPEED #6 and #7 are used as the skip frequencies. SKIP BANDWIDTH sets the range above the skip frequencies that the drive will not operate within.

Example: The critical frequency is 23 Hz, and it is desired to skip a frequency range of 3 Hz above and below the critical frequency (therefore the skip range is 20 to 26 Hz). PRESET SPEED #6 or #7 would be set to 20 Hz, and the SKIP BANDWIDTH would be set to 6.0 Hz.

If the drive is running at a speed below the skip range, and it is given a speed command that is within the skip range, the drive will accelerate to the start of the skip range (20 Hz in the example) and run at that speed until the speed command is greater than or equal to the "top" of the skip range. The drive will then accelerate through the skip range to the new speed. Likewise, if the drive is running at a speed above the skip range, and it is given a speed command that is within the skip range, the drive will decelerate to the "top" of the skip range (26 Hz in the example) and run at that speed until the speed command is less than or equal to the "bottom" of the skip range. The drive will then decelerate through the skip range to the new speed.

NOTE: PRESET SPEEDS #6 and #7 can still be used as preset speeds even if they are also being used as skip frequencies.

P39 SPEED SCALING

This scales the display to indicate speed or user units other than frequency. This parameter should be set to the desired display value when the drive output is 60 Hz. The highest setting is 6500, and the highest value that can be displayed is 6553.6.

Example: A machine produces 175 parts per hour when the motor is running at 60 Hz. Setting the SPEED SCALING to 175 will calibrate the drive's display to read 175 when the motor is running at 60 Hz. This is a linear function, so at 30 Hz the display would read 87.5, and at 120 Hz, the display would read 350.

NOTE: If SPEED SCALING is set such that the maximum displayable value (6553.6) is exceeded, the display will flash "9999" to indicate that the value is out of range. For example, if SPEED SCALING is set to 6000, the drive will display 6000 when it is running at 60 Hz. If the speed is increased past 65.5 Hz (at 65.5 Hz, the scaled value would be 6550), the display will flash "9999" because a scaled value above 6553.6 cannot be displayed.

P40 FREQUENCY SCALING

This scales the analog output signal at TB-30 when it is configured for a frequency output. This setting is the output frequency that is indicated when the output signal measures 10 VDC.

Example: A 0-5 VDC signal is required to indicate 0-60 Hz. Setting this parameter to 120 Hz would yield 10 VDC at 120 Hz, and 5 VDC at 60 Hz. If the drive only operates up to 60 Hz, the output signal at TB-30 is limited to the desired 0-5 VDC.

P41 LOAD SCALING

This scales the analog output signal at TB-30 and/or TB-31 when they are configured for a load output. This setting is the load (in %) that is indicated when the output signal measures 10 VDC.

Example: A 0-10 VDC signal is required to indicate 0-150% load. Setting this parameter to 150% will yield 10 VDC at 150% load.

P42 ACCEL / DECEL #2

This parameter sets the second acceleration and deceleration rate of the drive. To activate this acceleration and deceleration rate, use terminal TB-13A, TB-13B or T-13C. TB-13A and TB-13B can be set to AUXILIARY STOP which will cause the drive to decelerate to a stop according to the time programmed in this parameter. TB-13C can be set to ACCEL/DECEL #2, which causes the drive to accelerate and decelerate according to the time programmed in this parameter.

P44 PASSWORD

This allows the PASSWORD to be changed to any number between 000 and 999. Setting PASSWORD to 000 disables the password function.

NOTE: The factory default password is 225.

P47 CLEAR FAULT HISTORY

01 MAINTAIN: Maintains the FAULT HISTORY (Parameter 50) entries for troubleshooting.

02 CLEAR: Erases the FAULT HISTORY (Parameter 50) entries.

P48 PROGRAM SELECTION

This is used to select whether the drive will operate according to the user settings or the optional OEM default settings, and to reset the parameters to default settings. Refer to Section 13.2.

- 01 OPERATE WITH USER SETTINGS: The drive will operate according to the user settings. Operation in USER mode allows the parameter values to be changed to suit any application.
- 02 OPERATE WITH OEM DEFAULTS: The drive will operate according to the optional OEM default settings, which configure the drive for a specific application. When operating in OEM mode, the parameter values can be viewed, but not changed. If an attempt is made to change a parameter setting, the display will flash "GE". If the drive is not programmed with OEM default settings, the display will flash "GF" if this option is selected.
- 03 RESET OEM: Resets the user parameters to the OEM default settings. If the drive is not programmed with OEM default settings, the display will flash "GF" if this option is selected.
- 04 RESET 60: Resets the user parameters to the factory defaults for a 60 Hz base frequency.
- 05 RESET 50: Resets the user parameters to the factory defaults for a 50 Hz base frequency. Parameters 24, 27, and 40 will reset to 50.0 Hz.
- 06 TRANSLATE: If an EPM from a drive with a previous parameter version is installed in a new drive, the new drive will function like the previous version drive, but none of the parameter settings can be changed ("cE" will be displayed if this is attempted). The TRANSLATE function converts the EPM to the new parameter version so that the parameters can be changed, but it also retains the old parameter settings so the new drive will operate like the old drive without having to re-program all of the parameters.

NOTE 1: If the user parameters are reset to the OEM defaults (using the RESET OEM option), and then OPERATE WITH USER SETTINGS is selected, the USER settings will be the same as the OEM default settings. This allows the drive to operate as if it was in OEM mode, but the parameter values can be changed. This is useful if some of the OEM default settings need to be fine-tuned for proper operation. The new parameter values are not actually stored as new OEM default settings however; they are simply stored as new USER settings. Therefore, if the parameters are reset to the OEM defaults again, the parameters that were changed will be reset to their "old" value. The optional EPM Programmer is required to change OEM default settings. Refer to Section 13.2.

NOTE 2: Only the TRANSLATE (06) function can be performed while the drive is running. The display will flash "Er" if an attempt is made to select any other function while the drive is running.

P50 FAULT HISTORY

The FAULT HISTORY stores the last eight faults that tripped the drive. Refer to Section 16.0 - TROUBLESHOOTING for a list of the faults and possible causes.

Use the ▲ and ▼ buttons to scroll through the fault entries. The far left digit of the display will be the fault number and the remaining two digits will be the fault code. The faults are stored from newest to oldest, with the first fault shown being the most recent.

The display will read “_ _” if the FAULT HISTORY does not contain any fault messages.

P51 SOFTWARE VERSION

This displays the software version number for the control board software. This information is useful when contacting the factory for programming or troubleshooting assistance.

The software version is displayed in two parts which alternate. The first part is the software version, and the second part is the revision number. For example, if the display shows "79-" and "-03", this indicates that the drive contains the third revision of version 79 software.

P52 DC BUS VOLTAGE

This displays the DC bus voltage in percent of nominal. Nominal DC bus voltage is determined by multiplying the drive's nameplate input voltage rating by 1.4.

P53 MOTOR VOLTAGE

This displays the output voltage in percent of the drive's nameplate output voltage rating.

P54 MOTOR LOAD

This displays the motor load in percent of the drive's output current rating.

P55 0-10 VDC ANALOG INPUT


This displays the level of the 0-10 VDC analog input signal at TB-5/25. A reading of 100% indicates a 10 VDC input at TB-5/25.

P56 4-20 mA ANALOG INPUT

This displays the level of the 4-20 mA analog input signal at TB-5/25. A reading of 20% indicates a 4 mA input at TB-5/25, and a reading of 100% indicates a 20 mA input at TB-5/25.


P57 TERMINAL STRIP STATUS

This indicates the status of several terminals using the vertical segments of the LED display. An illuminated segment indicates that the particular terminal is closed with respect to TB-4. The CHARGE RELAY is not a terminal, and should always be illuminated. See the diagram below:

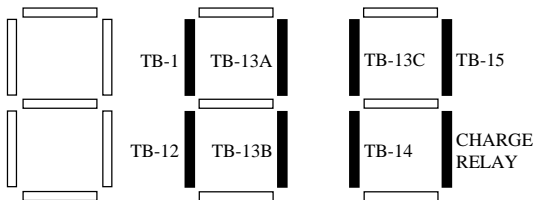

P58 KEYPAD AND PROTECTION STATUS

This indicates the status of the buttons on the keypad, and the status of the protective circuitry in the drive, using the horizontal segments of the LED. An illuminated segment indicates that the corresponding button is pressed, or the protective circuit is active. See the diagram below:

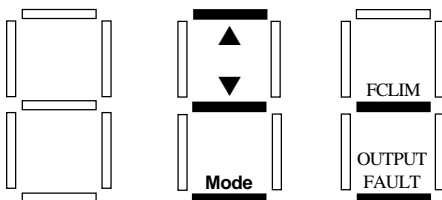

NOTE: FCLIM is an abbreviation for Fast Current Limit.

P59 TB-30 ANALOG OUTPUT

This displays the level of the analog output signal at TB-30. A reading of 100% indicates that the output is 10 VDC.

P60 TB-31 ANALOG OUTPUT

This displays the level of the analog output signals at TB-31. A reading of 100% indicates that the output is 10 VDC.

P85 MOTOR RATED RPM

When using the DeviceNet interface, this must be set to match the nameplate RPM of the motor.

P86 MOTOR RATED CURRENT

When using the DeviceNet interface, this must be set to match the nameplate full load amperage (FLA) rating of the motor.

P87 MOTOR RATED VOLTAGE

When using the DeviceNet interface, this must be set to match the nameplate voltage rating of the motor.

P88 MOTOR RATED FREQUENCY

When using the DeviceNet interface, this must be set to match the nameplate frequency rating of the motor.

P89 DRIVE RATED CURRENT

When using the DeviceNet interface, this must be set to match the nameplate output current rating of the drive.

P90 DRIVE RATED VOLTAGE

When using the DeviceNet interface, this must be set to match the nameplate maximum output voltage rating of the drive.

Example: A 5 Hp, 400/480 Vac SCD drive (SD450) is being used with a 5 Hp, 230/460 Vac, 60 Hz, 1800 RPM motor that is rated 7.1 amps. Parameters 85-90 would be set as follows:

| | | |
|-----|-----------------------|-----------|
| P85 | MOTOR RATED RPM | 1800 RPM |
| P86 | MOTOR RATED CURRENT | 7.1 AMPS |
| P87 | MOTOR RATED VOLTAGE | 460 VOLTS |
| P88 | MOTOR RATED FREQUENCY | 60 Hz |
| P89 | DRIVE RATED CURRENT | 7.6 AMPS |
| P90 | DRIVE RATED VOLTAGE | 480 VOLTS |

C00 DEVICENET NODE ADDRESS

C01 DEVICENET BAUD RATE

C02 DEVICENET LOSS ACTION

C03 DEVICENET OUTPUT ASSEMBLY SELECTION

C04 DEVICENET INPUT ASSEMBLY SELECTION

C05 DEVICENET CUSTOM INPUT ASSEMBLY WORD 0

C06 DEVICENET CUSTOM INPUT ASSEMBLY WORD 1

C07 DEVICENET CUSTOM INPUT ASSEMBLY WORD 2

C08 DEVICENET CUSTOM INPUT ASSEMBLY WORD 3

C09 DEVICENET MOTOR TYPE

C10 DEVICENET DIAGNOSTICS

NOTE: Refer to Appendix B - DeviceNet Control for more information on Parameters 85-90 and C00 - C10.


16.0 TROUBLESHOOTING

To aid in troubleshooting, Parameters 50 through 60 can be accessed without entering the PASSWORD. Simply press the **Mode** button twice to “skip” over the PASSWORD prompt, and “P50” will be displayed to indicate that the parameter menu has been entered and Parameter 50 (FAULT HISTORY) can be viewed. The **▲** and **▼** buttons can then be used to scroll from Parameter 50 to Parameter 60. Once the desired parameter is found, press the **Mode** button to view its “contents”. When finished, press **Mode** to exit the parameter menu. An example is shown below:

Press **Mode** once


Display reads "00"

Upper right decimal point blinks




Press **Mode** again

Display reads "P50" (FAULT HISTORY)



Use **▲** and **▼** to scroll to the desired parameter number


(In this example Parameter 54 has been selected, which is MOTOR LOAD)



Press **Mode** to view parameter contents
(77 = 77% LOAD)

Upper right decimal point blinks

Press **Mode** again to exit



In the example above, Parameter 54 - MOTOR LOAD is being viewed. The “77” in the example indicates that the load on the motor is 77% of the output current rating of the drive.

The table below lists the fault conditions that will cause the drive to shut down, as well as some possible causes. Please contact the factory for more information on troubleshooting faults.

| FAULT MESSAGES | |
|-----------------------|--|
| FAULT | DESCRIPTION & POSSIBLE CAUSES |
| AF | High Temperature Fault: Ambient temperature is too high; Cooling fan has failed (if equipped). |
| CF | Control Fault: A blank EPM, or an EPM with corrupted data has been installed. Perform a factory reset using Parameter 48 - PROGRAM SELECTION. |
| cF | Incompatibility Fault: An EPM with an incompatible parameter version has been installed. Either remove the EPM or perform a factory reset (Parameter 48) to change the parameter version of the EPM to match the parameter version of the drive. |
| dF | Dynamic Braking Fault: The drive has sensed that the dynamic braking resistors are overheating and shuts down to protect the resistors. |
| EF | External Fault: TB-13A and/or TB-13C is set as an External Fault input and TB-13A and/or TB-13C is open with respect to TB-2. Refer to Parameter 10 and/or 12. |
| GF | Data Fault: User data and OEM defaults in the EPM are corrupted. |
| HF | High DC Bus Voltage Fault: Line voltage is too high; Deceleration rate is too fast; Overhauling load. For fast deceleration or overhauling loads, dynamic braking may be required. |
| JF | Network Fault: The watchdog timer has timed out, indicating that the network link has been lost. |
| LF | Low DC Bus Voltage Fault: Line voltage is too low. |
| nF | DeviceNet Fault: The DeviceNet master has commanded the drive to trip into a fault. |
| OF | Output Transistor Fault: Phase to phase or phase to ground short circuit on the output; Failed output transistor; Boost settings are too high; Acceleration rate is too fast. |
| PF | Current Overload Fault: VFD is undersized for the application; Mechanical problem with the driven equipment. |
| SF | Single-phase Fault: Single-phase input power has been applied to a three-phase drive. |
| UF | Start Fault: Start command was present when the drive was powered up. Must wait 2 seconds after power-up to apply Start command if START METHOD is set to NORMAL. |
| F1 | EPM Fault: The EPM is missing or damaged. |
| F2 - F9, Fo | Internal Faults: The control board has sensed a problem - consult factory. |

To clear a fault, issue a STOP command on the terminal strip. The fault will only clear if the condition that caused the fault has passed. For example, if the drive trips on a LOW DC BUS VOLTAGE FAULT (LF) due to low input voltage, the fault cannot be cleared until the input voltage returns to a normal level.

If the drive is programmed to automatically restart after a fault (see Parameter 03), the drive will attempt to restart three times after a fault (the drive will not restart after CF, cF, GF, F1, F2-F9, or Fo faults). If all three restart attempts are unsuccessful, the drive will trip into FAULT LOCKOUT (LC), which requires a manual reset as described above.

17.0 SCD DISPLAY MESSAGES

The following describes the various displays and messages that can appear on the SCD drive.

17.1 SPEED DISPLAY

If the drive is in a STOP state (indicated by "- -" on the display), and the commanded speed is changed, the display will show the commanded speed, and the upper left decimal point will turn on solid. About five seconds after a change is made, the display will begin to alternate between the commanded speed value and the "- -" display. If the **Mode** button is pressed, the display will stop alternating and show the "- -" display only.

When the drive is given a START command, the displayed speed will start increasing as the drive accelerates up to the commanded speed. If the commanded speed is changed while the drive is running, the display will show the commanded speed rather than the actual speed, until the actual speed reaches the commanded speed.

If the commanded speed is changed faster than the drive can accelerate or decelerate, the upper left decimal point will blink to indicate that the the drive is accelerating or decelerating to the new speed. Once the actual speed reaches the commanded speed, the upper left decimal point will turn on solid for 5 seconds and then turn off to indicate that the commanded speed has been reached, and that the display is now showing the actual speed.

17.2 CHANGING THE SPEED REFERENCE SOURCE

When the speed source is changed while the drive is running, the display will flash the message for the new speed source to indicate that the new speed source is active. Also, if the drive is being controlled from a speed source other than the ▲ and ▼ buttons (0-10 VDC, 4-20 mA, etc), and one of the ▲ or ▼ buttons is pressed, the display will flash the present speed source message to indicate that the ▲ and ▼ buttons are invalid.

Example 1: The drive is running and the present speed source is the keypad. TB-13A is programmed to select a 4-20 mA signal as the speed source. When TB-13A is closed to TB-4, the display will flash "EI" to indicate that the speed source has changed to the 4-20 mA signal. If the contact between TB-13A and TB-4 is opened, the display will flash "CP" to indicate that the speed source has changed back to the ▲ and ▼ buttons.

Example 2: The speed source is a 0-10 VDC signal. If the ▲ or ▼ button is pushed, the display will flash "EU" to indicate that the present speed source is the 0-10 VDC signal and that the ▲ and ▼ buttons are invalid.

Refer to the table below for the possible speed reference source displays:


SPEED SOURCE DISPLAYS

| DISPLAY | DESCRIPTION |
|-----------|--|
| CP | CONTROL PAD: Speed is set using the ▲ and ▼ buttons on the front of the drive. |
| EI | EXTERNAL CURRENT: Speed is controlled by a 4-20 mA signal wired to TB-25 and TB-2. |
| EU | EXTERNAL VOLTAGE: Speed is controlled by a 0-10 VDC signal wired to TB-5 and TB-2. |
| JG | JOG: The drive is in Jog mode, and the speed is set by Preset Speed #2 (Parameter 32). |
| dn | DEVICENET: Speed is controlled from the DeviceNet interface. |
| OP | MOP (Motor Operated Pot): Contacts wired to TB-13B and TB-13C are used to increase and decrease the drive speed. |
| Pr1 - Pr7 | PRESET SPEEDS #1-7: Speed is set by the indicated Preset Speed (Parameters 31-37). |

NOTE: The speed source displays will flash when the speed reference source is changed while the drive is running to indicate that the new speed reference source is active.

17.3 STATUS AND WARNING MESSAGES

STATUS AND WARNING MESSAGES

| DISPLAY | DESCRIPTION |
|--|--|
| br | DC BRAKING: The DC braking circuit is activated. |
| CL | CURRENT LIMIT: The output current has exceeded the CURRENT LIMIT setting (Parameter 25) and the drive is reducing the output frequency to reduce the output current. If the drive remains in CURRENT LIMIT for too long, it can trip into a CURRENT OVERLOAD fault (PF). |
| Er | ERROR: Invalid data has been entered or an invalid command was attempted. |
| GE | "GE" will be displayed if an attempt is made to change the OEM default settings when the drive is operating in the OEM mode (see Parameter 48). |
| GF | If "GF" is displayed when a RESET OEM is attempted, it indicates that the OEM defaults in the EPM are corrupted. If "GF" is displayed upon power-up, it indicates that the OEM defaults and the user settings in the EPM are corrupted. Refer to Section 13.2. |
| LC | FAULT LOCKOUT: The drive has failed three restart attempts and now requires a manual reset. |
| SP | START PENDING: "SP" blinks during the interval between restart attempts. |
|  | DECEL OVERRIDE (both upper decimal points blinking): The drive has stopped decelerating to avoid tripping into an HF fault due to regenerative energy from the motor. |


APPENDIX A - THROUGH-HOLE MOUNT OPTION

The Through-Hole Mount option for the SCD drive allows the drive to be mounted with the heatsink outside of the enclosure for better heat dissipation. This is done by using a special heatsink that mounts to the outside of the enclosure. The drive (which has a flat plate instead of a heatsink) is mounted to the heatsink from the inside of the enclosure. This requires cutting a hole in the enclosure that is slightly smaller than the heatsink. Up to NEMA 4X can be achieved with this option. Panel cutout and mounting hole dimensions are provided below for the different drive sizes.

NOTE 1: The temperature inside the enclosure must be maintained at 50°C or less, and the ambient temperature outside of the enclosure must be 40°C or less. Refer to Section 5.0 - SCD RATINGS for heat loss information.

NOTE 2: Cutout view is shown from the drive side (inside) of the panel.

THROUGH-HOLE DRAWING FOR MODELS UP TO 10 HP (7.5 kW)

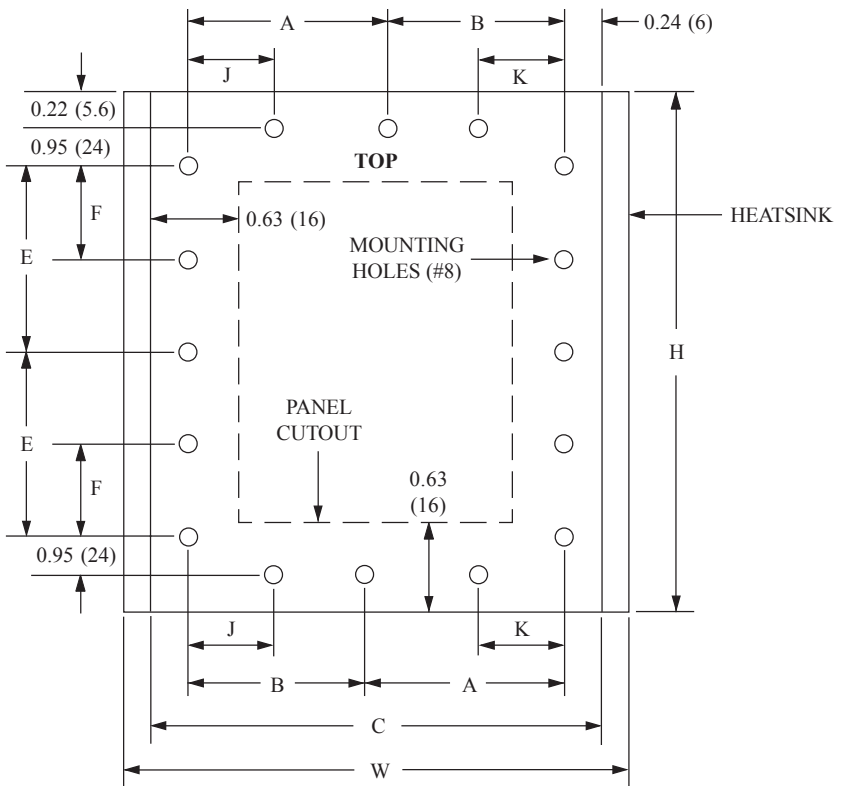

THROUGH-HOLE MOUNT DIMENSIONS FOR MODELS UP TO 10 HP (7.5 kW)


| HP (kW) | MODEL | H | W | A | B | C | E | F | J | K |
|--------------|---------|------------|-------|------|------|-------|------|------|------|------|
| 1 (0.75) | SD210YF | 7.72 (196) | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD210F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD410F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD510F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| 1.5 (1.1) | SD215YF | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD215F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD415F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| 2 (1.5) | SD220YF | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD220F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD420F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| | SD520F | 7.72 | 6.80 | 2.76 | 2.76 | 6.00 | 2.69 | N/A | N/A | N/A |
| 3 (2.2) | SD230YF | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| | SD230F | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| | SD430F | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| | SD530F | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| 5 (3.7) | SD250YF | 9.59 | 11.14 | 5.06 | 4.60 | 10.14 | 3.63 | N/A | 2.32 | 2.32 |
| | SD250F | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| | SD450F | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| | SD550F | 7.72 | 8.54 | 3.80 | 3.46 | 7.74 | 2.69 | N/A | 1.72 | 1.75 |
| 7.5 (5.5) | SD275F | 11.59 | 11.14 | 5.06 | 4.60 | 10.14 | 4.63 | 2.31 | 2.32 | 2.32 |
| | SD475F | 9.59 | 11.14 | 5.06 | 4.60 | 10.14 | 3.63 | N/A | 2.32 | 2.32 |
| | SD575F | 9.59 | 11.14 | 5.06 | 4.60 | 10.14 | 3.63 | N/A | 2.32 | 2.32 |
| 10 (7.5) | SD2100F | 15.59 | 11.14 | 5.06 | 4.60 | 10.14 | 6.63 | 3.31 | 1.94 | 2.32 |
| | SD4100F | 11.59 | 11.14 | 5.06 | 4.60 | 10.14 | 4.63 | 2.31 | 2.32 | 2.32 |
| | SD5100F | 11.59 | 11.14 | 5.06 | 4.60 | 10.14 | 4.63 | 2.31 | 2.32 | 2.32 |

NOTE 1: The N/A indication for dimensions F, J, and K indicate that the heatsinks for these models have fewer mounting holes than shown in the drawing.

NOTE 2: For mm, multiply inches listed above by 25.4.

THROUGH-HOLE DRAWING FOR 15 HP (11 kW) AND 20 HP (15 kW) MODELS

This drawing applies to the following models only: SD2150F, SD4150F, SD5150F, SD4200F, and SD5200F.

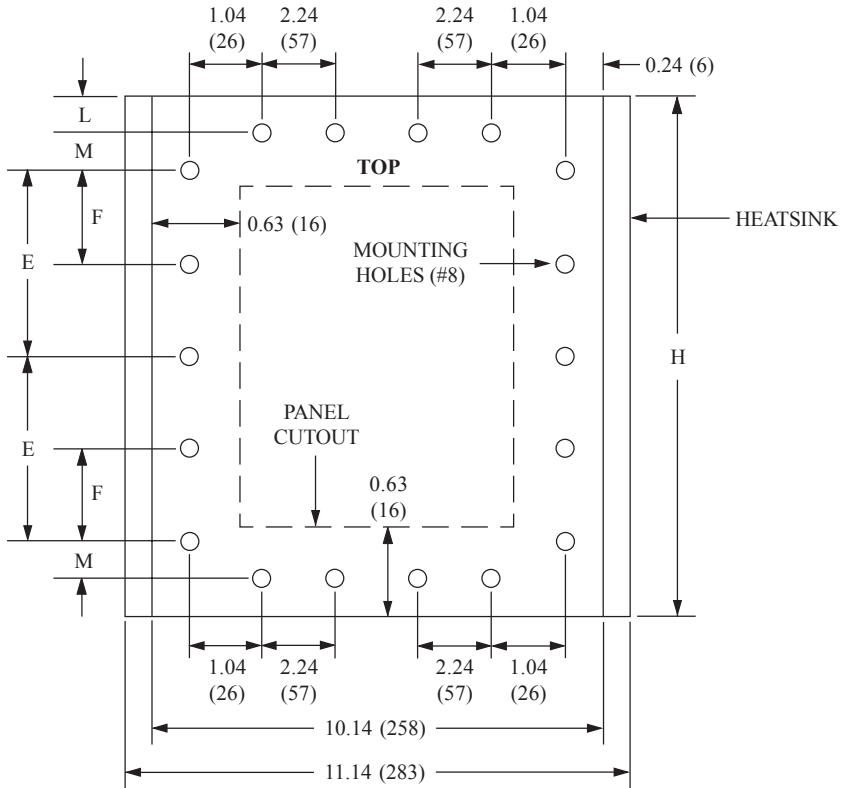


THROUGH-HOLE CUTOUT DIMENSIONS FOR 15 HP (11 kW) & 20 HP (15 kW) MODELS

| HP (kW) | MODEL | H | E | F | L | M |
|---------|---------|-------------|------------|-----------|------------|-----------|
| 15 | SD2150F | 18.09 (459) | 6.03 (153) | 3.02 (77) | 0.50 (13) | 2.52 (64) |
| (11) | SD4150F | 15.59 (396) | 6.03 (153) | 3.31 (84) | 0.22 (5.6) | 0.95 (24) |
| | SD5150F | 15.59 (396) | 6.03 (153) | 3.31 (84) | 0.22 (5.6) | 0.95 (24) |
| 20 | SD4200F | 18.09 (459) | 6.03 (153) | 3.02 (77) | 0.50 (13) | 2.52 (64) |
| (15) | SD5200F | 18.09 (459) | 6.03 (153) | 3.02 (77) | 0.50 (13) | 2.52 (64) |

THROUGH-HOLE MOUNT DRAWING FOR 25 HP (18.5 kW) MODELS

This drawing applies to SD4250F and SD5250F models only.

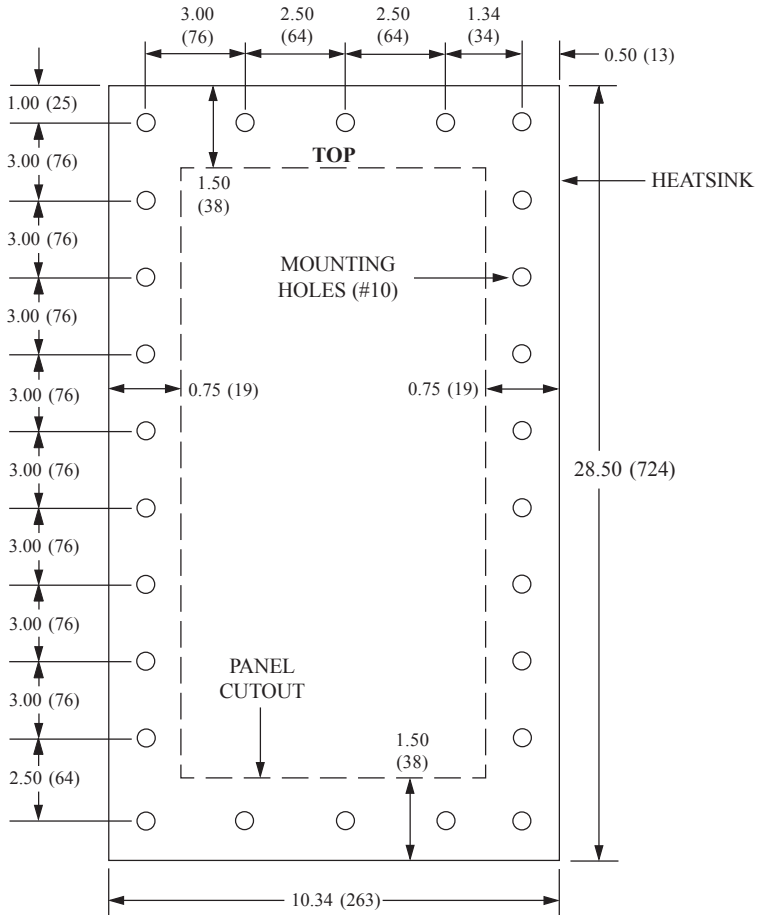

APPENDIX B - DEVICENET™ CONTROL

TABLE OF CONTENTS

| | | |
|------------|--|----|
| B.1 | GENERAL | 58 |
| B.2 | INITIAL CONFIGURATION | 58 |
| B.3 | BASIC MODE OF OPERATION | 59 |
| | SAMPLE SETUP AND WIRING FOR DEVICENET™ CONTROL..... | 59 |
| | SAMPLE OF SETUP AND TEST RUNS USING RSNETWORX™..... | 60 |
| B.4 | DEVICENET™ IMPLEMENTATION FOR SCD SERIES DRIVES | 61 |
| B.5 | CLASS IMPLEMENTATION DETAILS | 62 |
| | IDENTITY OBJECT - CLASS 0x01..... | 62 |
| | MESSAGE ROUTER OBJECT - CLASS 0x02..... | 62 |
| | DEVICENET OBJECT - CLASS 0x03..... | 63 |
| | ASSEMBLY OBJECT - CLASS 0x04..... | 64 |
| | DEVICENET CONNECTION OBJECT - CLASS 0x05..... | 65 |
| | PARAMETER OBJECT - CLASS 0x0F..... | 69 |
| | PARAMETER GROUP OBJECT - CLASS 0x10..... | 73 |
| | MOTOR DATA OBJECT - CLASS 0x28..... | 77 |
| | CONTROL SUPERVISOR OBJECT - CLASS 0x29..... | 77 |
| | AC / DC DRIVE OBJECT - CLASS 0x2A..... | 80 |
| | ACKNOWLEDGE HANDLER OBJECT - CLASS 0x2B..... | 81 |
| B.6 | DESCRIPTION OF DEVICENET™ PARAMETERS | 81 |
| B.7 | NETWORK TROUBLESHOOTING | 94 |


DeviceNet is a Trademark of the Open DeviceNet Vendor Association, Inc.
RSNetWorx is a Trademark of Rockwell Software, Inc.

B.1 GENERAL

The following information is provided to allow the SCD Series drive to operate on a DeviceNet™ network; it is not intended to explain how DeviceNet™ itself works. Therefore, a working knowledge of DeviceNet™ is assumed, as well as familiarity with the operation of the SCD Series drive.

B.2 INITIAL CONFIGURATION

The SCD Series drive is equipped with a 5 pin female connector that should be used for connecting to the DeviceNet™ network. The wires should be connected as shown:

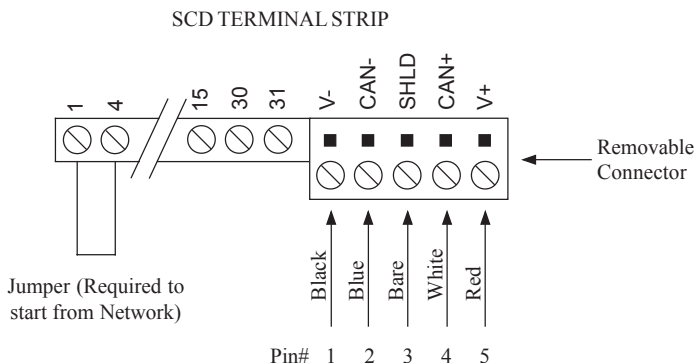

NOTE 1: Make sure the SCD drive is powered down and the network power supply is OFF before wiring to the connector.

NOTE 2: After wiring the connector, make sure the network power supply is ON before applying power to the drive. Applying power to the drive without the network power supply will cause the DeviceNet™ module to enter a non-recoverable fault: "DeviceNet Power Lost".

Once the wiring is complete and the network power supply is ON and SCD drive is powered up, program the address and network baud rate to the required values. Do this using the programming buttons on the front of the drive (refer to Section 13.0 - PROGRAMMING THE SCD DRIVE) to set the following parameters:

| | |
|------------------------------|--|
| C00 - DEVICENET NODE ADDRESS | Range is 0 to 63 (default = 63) |
| C01 - DEVICENET BAUD RATE | 0 = 125 kbps, 1 = 250 kbps, 2 = 500 kbps (default = 125) |

Once these parameters are set, cycle power to the drive. This will make the address and baud rate parameters take effect. Also, during power-up (and resets), the SCD drive will perform the following functions:

1. Power up initializations; sets all variables and states.
2. Sets the MAC address and baud rate base on values programmed in EEPROM.
3. Checks for duplicate node address to verify that its own address is unique on the network.

If the power-up or reset sequence fails, the SCD drive will enter DeviceNet failure mode. In that case, the drive will not be accessible to the network, but can still be operated in terminal mode. This failure state is indicated in parameter C10 DIAGNOSTIC by number "093" (refer to Section B.6 and B.7 for details on parameter C10).

B.3 BASIC MODE OF OPERATION

The SCD Series Drive can operate under DeviceNet™ control in any terminal configuration shown in Section 11.0 of this manual. The DeviceNet Master can take control any time by setting the Network Control bit (attribute 5 in Control Supervisor Object - see supported Objects and attributes on following pages).

B.3.1 SAMPLE SETUP AND WIRING FOR DEVICENET™ CONTROL

This example uses Explicit or I/O Polled messaging for Run Forward/Reverse and speed control.

NOTE: Terminal 1 must be closed to terminal 4 in order to start the drive through the DeviceNet™ interface.

PARAMETER SET-UP:

Parameters can be setup using the drive keypad, EPM Programmer, or DeviceNet™ configuration tool (for example RSNWorx™) that uses EDS file provided by AC Technology.

The following parameters should be set as a minimum:

- P17 ROTATION DIRECTION - Set this parameter to FORWARD & REVERSE (02) if operation in both directions is required.
- P85 MOTOR NOMINAL SPEED AT RATED FREQUENCY (RPM)
- P86 MOTOR RATED CURRENT (0.1 A)
- P87 MOTOR RATED VOLTAGE (V)
- P88 MOTOR RATED FREQUENCY (Hz)
- P89 DRIVE RATED CURRENT (0.1 A)
- P90 DRIVE RATED VOLTAGE (V)
- C00 DEVICENET NODE ADDRESS (0 - 63)
- C01 DEVICENET BAUD RATE (125, 250, 500 kbps)
- C03 DEVICENET OUTPUT ASSEMBLY SELECTION - Set this parameter to select output assembly for Polled connection. The following selections are available:

- 1 = "1 Basic Contactor"
- 2 = "2 Basic Overload"
- 3 = "3 Basic Motor Starter"
- 4 = "4 Ext. Contactor"
- 5 = "5 Ext. Motor Starter"
- 6 = "20 Basic Speed Ctrl"
- 7 = "21 Ext. Speed Ctrl RPM"
- 8 = "100 Ext.Speed Ctrl Hz"
- 9 = "103 Preset Speed Ctrl"

The most versatile assemblies are #21 (selection 7) and #100 (selection 8). They allow RUN FORWARD and RUN REVERSE control as well as speed control. Refer to Section B.6 for more assembly details.

- C04 DEVICENET INPUT ASSEMBLY SELECTION - Set this parameter for Polled, COS or Cyclic I/O connection. Refer to Section B.6 for more assembly details.

NOTE: If Parameter C00 - NETWORK ADDRESS or C01 - BAUD RATE have been changed, the drive must be reset by cycling power or by issuing a RESET command via the DeviceNet™ network before the new values take effect.

To simplify setup and assist in maintaining the DeviceNet™ network, the EDS file supporting the SCD Series drive is available from AC Technology. To obtain a copy of the appropriate EDS file, please contact AC Technology Corp, or visit the AC Tech website at: www.actechdrives.com.

B.3.2 SAMPLE OF SETUP AND TEST RUNS USING RSNETWORK™ FOR DEVICENET

1. Make all necessary DeviceNet™ network connections.
2. Using "EDS Hardware Installation Tool" register the EDS file for SCD family of drives.
3. Switch mode to ONLINE. After browsing through all available addresses on the network, "AC Tech SCD Drive" should appear at the programmed address.
4. To access the drive parameters double click on the drive icon.
5. After uploading parameters from the SCD drive, they can be edited and downloaded back to the drive. SCD drive parameters accessed through the drive keypad are mapped starting at location ID #41, to simplify programming they have a drive parameter number in front of their name.
For example: Parameter ID #42 corresponds to drive parameter "#2 Carrier Select"
 Parameter ID #43 corresponds to drive parameter "#3 Start Method"

DeviceNet™ parameter IDs #1 to #40 are only accessible through the network connection.

To assist in Network Controlled test runs, the EDS file consists of parameters that permit triggering RUN commands by changing the parameter values.

ID #20 - Control Source: Must be set to NETWORK CONTROL before RUN FWD or RUN REV will be accepted. This parameter is mapped to Control Supervisor Object 0x29-1-5.

ID #21 - Run Forward: If terminals 1 and 4 are closed the drive will RUN FORWARD. This parameter is mapped to Control Supervisor Object 0x29-1-3.

ID #22 - Run Reverse: If terminals 1 and 4 are closed and Parameter #17 - ROTATION is set to FORWARD AND REVERSE, the drive will RUN REVERSE. This parameter is mapped to Control Supervisor Object 0x29-1-4.

NOTE: RUN and STOP commands must be triggered according to the table in Section B.5.9.

ID #25 - Speed Reference: To set the speed reference via the network, set this parameter to NETWORK REFERENCE. This parameter is mapped to AC/DC Drive Object 0x2A-1-4.

ID #26 - Network Reference Frequency: Controls the drive speed reference if parameter ID #25 is set to NETWORK REFERENCE. This parameter is mapped to Parameter Object 0x0F-26-1.

WARNING!

Make sure it is safe to operate the driven equipment prior to starting the SCD Series drive from the network. Damage to equipment and/or injury to personnel can result!

B.4 DEVICENET™ IMPLEMENTATION FOR THE SCD SERIES DRIVE

The following describes the DeviceNet™ network protocol implementation on the SCD Series drive. The SCD Drive can be operated as a slave device on a DeviceNet™ network. It supports Explicit Messages and the following I/O messages of the predefined master/slave connection set:

- Polled
- Bit Strobe
- Changed of state
- Cyclic

NOTE: It does not support the Explicit Unconnected Message Manager!

To assist in verifying data integrity, attribute Configuration Consistency Value of the Identity Object has been implemented.

To simplify setup and operation, implemented classes and behavior conform to the AC DRIVE profile as specified in the ODVA DeviceNet™ standard.

To assist in recovery from Communication Faulted condition, Offline Connection Set messages are supported. The SCD supports the following Group 4 message types:

Group 4 Message ID 2C - Communication Faulted Response Message

Group 4 Message ID 2D - Communication Faulted Request Message

Using these messages, the user will be able to identify a faulted drive and when possible, re-establish communication without disconnecting the network or resetting the drive. After receiving "Identify Request Message" while in Communication Faulted state, the two upper decimal points on the drive's display will flash and the display will indicate "Idn".

The following baud rates are available: 125 kbps, 250 kbps, 500 kbps

The SCD drive supports the following object classes:

- | | |
|---|---|
| 1. Identity Object - Class 0x01 | 7. Parameter Group Object -Class 0x10 |
| 2. Message Router Object - Class 0x02 | 8. Motor Data Object - Class 0x28 |
| 3. DeviceNet Object - Class 0x03 | 9. Control Supervisor Object - Class 0x29 |
| 4. Assembly Object - Class 0x04 | 10. AC/DC Drive Object - Class 0x2A |
| 5. DeviceNet Connection Object - Class 0x05 | 11. Acknowledge Handler Object - Class 0x2B |
| 6. Parameter Object - Class 0x0F | |

B.5 CLASS IMPLEMENTATION DETAILS

B.5.1 IDENTITY OBJECT - CLASS 0x01

| IDENTITY CLASS ATTRIBUTES | | | | |
|---------------------------|-------------|--------------------------|----------------|-----------------------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| INSTANCE 1 | | | | |
| 1 | GET | VENDOR ID | UINT | 587 |
| 2 | GET | DEVICE TYPE | UINT | 2 (AC drive) |
| 3 | GET | PRODUCT CODE | UINT | 1 (SCD drive) |
| 4 | GET | MAJOR REV. MINOR REV. | USINT USINT | 2 1 |
| 5 | GET | STATUS | USINT | 4 = Configured 5 = Owned |
| 6 | GET | SERIAL NUMBER | UDINT | Unique 32-bit number |
| 7 | GET | PRODUCT NAME | ASCII String | "AC Tech SCD Drive" |
| 9 | GET | CONFIG. CONSISTENCY | UINT | EEPROM Checksum |

| IDENTITY CLASS SERVICES | | | |
|-------------------------|-----------------|----------|----------------------|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x05 | NO | YES | RESET |

B.5.2 MESSAGE ROUTER OBJECT - CLASS 0x02

| MESSAGE ROUTER CLASS ATTRIBUTES | | | | |
|---------------------------------|-------------|-------------------------------|---------------|-----------------------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| INSTANCE 1 | | | | |
| 1 | GET | CLASS LIST | ARRAY | List of Implemented Classes |
| 2 | GET | MAXIMUM NUMBER OF CONNECTIONS | UINT | 1 |
| 3 | GET | CURRENTLY USED CONNECTIONS | UINT | 1 |
| 4 | GET | CURRENTLY USED ID's | Array of UINT | List of Connection ID |

| MESSAGE ROUTER CLASS SERVICES | | | | |
|--------------------------------------|-----------------|----------|----------------------|--|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME | |
| | CLASS | INSTANCE | | |
| 0x0E | YES | YES | Get_Attribute_Single | |

B.5.3 DEVICENET OBJECT - CLASS 0x03

| DEVICENET CLASS ATTRIBUTES | | | | |
|-----------------------------------|-------------|--|---------------|------------------------------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 2 |
| INSTANCE 1 | | | | |
| 1 | GET | NODE ADDRESS | USINT | 0 to 63 |
| 2 | GET | DATA RATE | USINT | 0 to 2 |
| 3 | GET/SET | BOI | BOOL | 0 = Hold in Error 1 = Reset CAN |
| 4 | GET/SET | BUS-OFF COUNTER | USINT | 0 to 255 |
| 5 | GET | ALLOCATION INFO ALLOC. CHOICE MASTER ADDRESS | BYTE USINT | Allocation Byte 0 to 63 Address |

| DEVICENET CLASS SERVICES | | | | |
|---------------------------------|-----------------|----------|--------------------------------------|--|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME | |
| | CLASS | INSTANCE | | |
| 0x0E | YES | YES | Get_Attribute_Single | |
| 0x10 | NO | YES | Set_Attribute_Single | |
| 0x4B | NO | YES | Allocate_Master/Slave_Connection_Set | |
| 0x4C | NO | YES | Release_Master/Slave_Connection_Set | |

B.5.4 ASSEMBLY OBJECT - CLASS 0x04

| ASSEMBLY CLASS ATTRIBUTES | | | | |
|------------------------------|-------------|--------------------------------|-----------------------|-------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 2 |
| 2 | GET | MAXIMUM NUMBER OF INSTANCES | USINT | 20 |
| INSTANCES (See Below) | | | | |
| 1 | GET | NUMBER OF MEMBER | USINT | 1 |
| 3 | GET/SET | DATA | INSTANCE DEPENDENT | |

| INSTANCE NUMBER AND NAME | ACCESS RULE FOR ATTRIBUTE #3 DATA |
|--------------------------------------|-----------------------------------|
| INSTANCE 1 = BASIC CONTACTOR | GET / SET |
| INSTANCE 2 = BASIC OVERLOAD | GET / SET |
| INSTANCE 3 = BASIC MOTOR STARTER | GET / SET |
| INSTANCE 4 = EXTENDED CONTACTOR | GET / SET |
| INSTANCE 5 = EXTENDED MOTOR STARTER | GET / SET |
| INSTANCE 20 = BASIC SPEED CONTROL | GET / SET |
| INSTANCE 21 = EXT. SPEED CONTROL | GET / SET |
| INSTANCE 100 = EXT. SPEED CONTROL Hz | GET / SET |
| INSTANCE 103 = PRESET SPEED CONTROL | GET / SET |
| INSTANCE 50 = BASIC OVERLOAD | GET |
| INSTANCE 51 = EXTENDED OVERLOAD | GET |
| INSTANCE 52 = BASIC MOTOR CONTROL | GET |
| INSTANCE 53 = EXT. MOTOR CONTROL 1 | GET |
| INSTANCE 54 = EXT. MOTOR CONTROL 2 | GET |
| INSTANCE 70 = BASIC SPEED CONTROL | GET |
| INSTANCE 71 = EXT. SPEED CONTROL | GET |
| INSTANCE 101 = EXT. SPEED CONTROL Hz | GET |
| INSTANCE 102 = CUSTOM ASSEMBLY | GET |
| INSTANCE 104 = CUSTOM ASSEMBLY | GET |
| INSTANCE 105 = CUSTOM ASSEMBLY | GET |

| ASSEMBLY CLASS SERVICES | | | |
|-------------------------|-----------------|----------|----------------------|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x05 | NO | YES | RESET |

B.5.5 DEVICENET CONNECTION OBJECT - CLASS 0x05

| DEVICENET CONNECTION CLASS ATTRIBUTES | | | | |
|---|--------------------|-------------------------------|------------------|---|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| INSTANCE 1 - EXPLICIT MESSAGE INSTANCE | | | | |
| 1 | GET | STATE | USINT | 0 = Nonexistent 1 = Configuring 3 = Established 4 = Timed Out 5 = Deferred Delete |
| 2 | GET | INSTANCE TYPE | USINT | 0 = Explicit |
| 3 | GET | TRANSPORT CLASS TRIGGER | USINT | 0x83 |
| 4 | GET | PRODUCED CONNECTION ID | UINT | |
| 5 | GET | CONSUMED CONNECTION ID | UINT | |
| 6 | GET | INITIAL COMM. CHARACTERISTICS | USINT | 0x21 |
| 7 | GET | PRODUCED CONNECTION SIZE | UINT | 80 (max) |
| 8 | GET | CONSUMED CONNECTION SIZE | UINT | 80 (max) |
| 9 | GET /SET | EXPECTED PACKET RATE | UINT | Timer Resolution of 2 ms |
| 12 | GET /SET | WATCHDOG ACTION | UINT | 1 = Auto Delete 3 = Deferred Delete |
| 13 | GET | PRODUCED CONN. PATH LENGTH | UINT | 0 |
| 14 | GET | PRODUCED CONNECTION PATH | | Null (No Data) |
| 15 | GET | CONSUMED CONN. PATH LENGTH | UINT | 0 |
| 16 | GET | CONSUMED CONNECTION PATH | | Null (No Data) |
| 17 | GET | INHIBIT TIME | USINT | 0 |

| DEVICENET CONNECTION CLASS ATTRIBUTES | | | | |
|---|--------------------|-------------------------------|------------------|--|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 2 - POLLED I/O MESSAGE CONNECTION | | | | |
| 1 | GET | STATE | USINT | 0 = Nonexistent 1 = Configuring 3 = Established 4 = Timed Out |
| 2 | GET | INSTANCE TYPE | USINT | 1 = I/O Connection |
| 3 | GET | TRANSPORT CLASS TRIGGER | USINT | 0x82 |
| 4 | GET | PRODUCED CONNECTION ID | UINT | |
| 5 | GET | CONSUMED CONNECTION ID | UINT | |
| 6 | GET | INITIAL COMM. CHARACTERISTICS | USINT | 0x01 |
| 7 | GET | PRODUCED CONNECTION SIZE | UINT | 0 to 8 |
| 8 | GET | CONSUMED CONNECTION SIZE | UINT | 0 to 4 |
| 9 | GET / SET | EXPECTED PACKET RATE | UINT | Timer Resolution of 2 ms |
| 12 | GET / SET | WATCHDOG ACTION | UINT | 0 = Time Out 1 = Auto Delete 2 = Auto Reset |
| 13 | GET | PRODUCED CONN. PATH LENGTH | UINT | 3 |
| 14 | GET | PRODUCED CONNECTION PATH | | 0x63 (Hex String) Hex String - Assembly # |
| 15 | GET | CONSUMED CONN. PATH LENGTH | UINT | 3 |
| 16 | GET | CONSUMED CONNECTION PATH | | 0x63 (Hex String) Hex String - Assembly # |
| 17 | GET | INHIBIT TIME | USINT | 0 |

| DEVICENET CONNECTION CLASS ATTRIBUTES | | | | |
|--|--------------------|-------------------------------|------------------|--|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 3 - BIT STROBE | | | | |
| 1 | GET | STATE | USINT | 0 = Nonexistent 1 = Configuring 3 = Established 4 = Timed Out |
| 2 | GET | INSTANCE TYPE | USINT | 1 = I/O Connection |
| 3 | GET | TRANSPORT CLASS TRIGGER | USINT | 0x82 |
| 4 | GET | PRODUCED CONNECTION ID | UINT | |
| 5 | GET | CONSUMED CONNECTION ID | UINT | |
| 6 | GET | INITIAL COMM. CHARACTERISTICS | USINT | 0x02 |
| 7 | GET | PRODUCED CONNECTION SIZE | UINT | 0 to 8 |
| 8 | GET | CONSUMED CONNECTION SIZE | UINT | 8 |
| 9 | GET / SET | EXPECTED PACKET RATE | UINT | Timer Resolution of 2 ms |
| 12 | GET / SET | WATCHDOG ACTION | UINT | 0 = Time Out 1 = Auto Delete 2 = Auto Reset |
| 13 | GET | PRODUCED CONN. PATH LENGTH | UINT | 3 |
| 14 | GET | PRODUCED CONNECTION PATH | | 0x63 (Hex String) Hex String - Assembly # |
| 15 | GET | CONSUMED CONN. PATH LENGTH | UINT | 3 |
| 16 | GET | CONSUMED CONNECTION PATH | | 0x63 (Hex String) Hex String - Assembly # |
| 17 | GET | INHIBIT TIME | USINT | 0 |

| DEVICENET CONNECTION CLASS ATTRIBUTES | | | | |
|---|--------------------|-------------------------------|------------------|--|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 4 - CHANGE OF STATE / CYCLIC INSTANCE | | | | |
| 1 | GET | STATE | USINT | 0 = Nonexistent 1 = Configuring 3 = Established 4 = Timed Out |
| 2 | GET | INSTANCE TYPE | USINT | 1 = I/O Connection |
| 3 | GET | TRANSPORT CLASS TRIGGER | USINT | 0x00 or 0x02 for Cyclic 0x10 or 0x12 for COS |
| 4 | GET | PRODUCED CONNECTION ID | UINT | |
| 5 | GET | CONSUMED CONNECTION ID | UINT | |
| 6 | GET | INITIAL COMM. CHARACTERISTICS | USINT | 0x01 or 0x0F |
| 7 | GET | PRODUCED CONNECTION SIZE | UINT | 0 to 8 |
| 8 | GET | CONSUMED CONNECTION SIZE | UINT | 0 |
| 9 | GET / SET | EXPECTED PACKET RATE | UINT | Timer Resolution of 2 ms |
| 12 | GET / SET | WATCHDOG ACTION | UINT | 0 = Time Out 1 = Auto Delete 2 = Auto Reset |
| 13 | GET | PRODUCED CONN. PATH LENGTH | UINT | 3 |
| 14 | GET | PRODUCED CONNECTION PATH | | 0x63 (Hex String) HexString - Assembly # |
| 15 | GET | CONSUMED CONN. PATH LENGTH | UINT | 3 |
| 16 | GET | CONSUMED CONNECTION PATH | | 0x63 (Hex String) HexString - Assembly # |
| 17 | GET / SET | INHIBIT TIME | USINT | 0 |

DEVICENET CONNECTION CLASS SERVICES

| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
|-----------------|-----------------|----------|----------------------|
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x10 | NO | YES | Set_Attribute_Single |

B.5.6 PARAMETER OBJECT - CLASS 0x0F**PARAMETER CLASS ATTRIBUTES**

NUMBER OF INSTANCES (PARAMETERS): 150

| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
|-------------------------|-------------|-------------------------------|-----------|-------------|
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 2 |
| 2 | GET | NO. OF INSTANCES | UINT | 150 |
| 8 | GET | PARAMETER CLASS DESCRIPTOR | WORD | 0x03 |
| 9 | GET | CONFIGURATION ASSEMBLY # | UINT | 0 |
| 10 | GET | NATIVE LANGUAGE | UINT | 0 = English |
| INSTANCE 1 - 150 | | | | |
| 1 | GET / SET | PARAMETER VALUE | | |
| 2 | GET | LINK PATH SIZE | USINT | 0 to 2 |
| 3 | GET | LINK PATH | DNET PATH | |
| 4 | GET | DESCRIPTOR | WORD | |
| 5 | GET | DATA TYPE | USINT | |
| 6 | GET | DATA SIZE | USINT | |

NOTE: See next page for Parameter List**PARAMETER CLASS SERVICES**

| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
|-----------------|-----------------|----------|----------------------|
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x10 | NO | YES | Set_Attribute_Single |

PARAMETER OBJECT INSTANCE (PARAMETER LIST)

NOTE: THE SAME PARAMETERS ARE PRESENT IN THE EDS FILE

| ID NO. | PARAMETER | OBJECT MAPPING |
|--------|--|----------------|
| 1 | OUTPUT FREQUENCY (0.1 Hz) | 0x0F-1-1 |
| 2 | OUTPUT VOLTAGE (V) | 0x2A-1-17 |
| 3 | OUTPUT CURRENT (100mA) | 0x2A-1-9 |
| 4 | OUTPUT POWER (W) | 0x2A-1-15 |
| 5 | INPUT VOLTAGE (V) | 0x2A-1-16 |
| 6 | COMMANDED FREQUENCY (0.1 Hz) | 0x0F-6-1 |
| 7 | PRESENT FAULT DNET CODE | 0x29-1-13 |
| 8 | PRESENT FAULT NAME | 0x0F-8-1 |
| 9- 16 | RESERVED | |
| 17 | BUS OFF ERROR | 0x03-1-3 |
| 18 | BUS OFF COUNT | 0x03-1-4 |
| 19 | DEVICENET IDLE MODE | 0x0F-19-1 |
| 20 | CONTROL SOURCE | 0x29-1-5 |
| 21 | RUN FORWARD | 0x29-1-3 |
| 22 | RUN REVERSE | 0x29-1-4 |
| 23 | FAULT RESET | 0x29-1-12 |
| 24 | DEVICENET PRESET COMMAND | 0x0F-24-1 |
| 25 | SPEED REFERENCE | 0x2A-1-4 |
| 26 | NETWORK REFERENCE FREQUENCY | 0x0F-26-1 |
| 27 | STATUS OF RUN/STOP CONTROL SRC | 0x29-1-15 |
| 28 | STATUS OF SPEED REFERENCE | 0x2A-1-29 |
| 29 | ACTUAL DIRECTION | 0x0F-29-1 |
| 30 | RUN STATE | 0x0F-30-1 |
| 31 | SPEED SOURCE | 0x0F-31-1 |
| 32 | RESERVED | |
| 33 | AT REFERENCE STATUS | 0x2A-1-3 |
| 34 | RESERVED | |
| 35 | COS STATUS | 0x0F-35-1 |
| 36 | COS MASK | 0x0F-36-1 |
| 37 | RESERVED | |
| 38 | KEYPAD COMMAND FREQUENCY | 0x0F-38-1 |
| 39 | RESERVED | |
| 40 | ACT EEPROM VERSION - PARAMETER VERSION ID NUMBER | 0x0F-40-1 |

| ID NO. | PARAMETER | OBJECT MAPPING |
|--------|---------------------------------------|----------------|
| 41 | ACT PARAMETER 1 LINE VOLTAGE | 0x0F-41-1 |
| 42 | ACT PARAMETER 2 CARRIER | 0x0F-42-1 |
| 43 | ACT PARAMETER 3 START | 0x0F-43-1 |
| 44 | ACT PARAMETER 4 STOP | 0x0F-44-1 |
| 45 | ACT PARAMETER 5 STANDARD SPEED SOURCE | 0x0F-45-1 |
| 46 | ACT PARAMETER 6 TB14 OUTPUT FUNCTION | 0x0F-46-1 |
| 47 | ACT RESERVED 7 TORQUE SELECTION | 0x0F-47-1 |
| 48 | ACT PARAMETER 8 TB30 OUTPUT FUNCTION | 0x0F-48-1 |
| 49 | ACT PARAMETER 9 TB31 OUTPUT FUNCTION | 0x0F-49-1 |
| 50 | ACT PARAMETER 10 TB13A INPUT FUNCTION | 0x0F-50-1 |
| 51 | ACT PARAMETER 11 TB13B INPUT FUNCTION | 0x0F-51-1 |
| 52 | ACT PARAMETER 12 TB13C INPUT FUNCTION | 0x0F-52-1 |
| 53 | ACT PARAMETER 13 TB15 OUTPUT FUNCTION | 0x0F-53-1 |
| 54 | ACT PARAMETER 14 CONTROL | 0x0F-54-1 |
| 55 | ACT RESERVED 15 | |
| 56 | ACT PARAMETER 16 UNITS EDITING | 0x0F-56-1 |
| 57 | ACT PARAMETER 17 AVAILABLE DIRECTION | 0x0F-57-1 |
| 58 | ACT RESERVED 18 | |
| 59 | ACT PARAMETER 19 ACCELERATION TIME | 0x0F-59-1 |
| 60 | ACT PARAMETER 20 DECELERATION TIME | 0x0F-60-1 |
| 61 | ACT PARAMETER 21 DC BRAKE TIME | 0x0F-61-1 |
| 62 | ACT PARAMETER 22 DC BRAKE VOLTS | 0x0F-62-1 |
| 63 | ACT PARAMETER 23 MINIMUM FREQUENCY | 0x0F-63-1 |
| 64 | ACT PARAMETER 24 MAXIMUM FREQUENCY | 0x0F-64-1 |
| 65 | ACT PARAMETER 25 CURRENT LIMIT | 0x0F-65-1 |
| 66 | ACT PARAMETER 26 MOTOR OVERLOAD | 0x0F-66-1 |
| 67 | ACT PARAMETER 27 BASE FREQUENCY | 0x0F-67-1 |
| 68 | ACT PARAMETER 28 FIXED BOOST | 0x0F-68-1 |
| 69 | ACT PARAMETER 29 ACCEL BOOST | 0x0F-69-1 |
| 70 | ACT PARAMETER 30 SLIP COMPENSATION | 0x0F-70-1 |
| 71 | ACT PARAMETER 31 PRESET SPEED #1 | 0x0F-71-1 |
| 72 | ACT PARAMETER 32 PRESET SPEED #2 | 0x0F-72-1 |
| 73 | ACT PARAMETER 33 PRESET SPEED #3 | 0x0F-73-1 |
| 74 | ACT PARAMETER 34 PRESET SPEED #4 | 0x0F-74-1 |
| 75 | ACT PARAMETER 35 PRESET SPEED #5 | 0x0F-75-1 |
| 76 | ACT PARAMETER 36 PRESET SPEED #6 | 0x0F-76-1 |
| 77 | ACT PARAMETER 37 PRESET SPEED #7 | 0x0F-77-1 |
| 78 | ACT PARAMETER 38 SKIP BANDWIDTH | 0x0F-78-1 |
| 79 | ACT PARAMETER 39 SPEED SCALING | 0x0F-79-1 |

| ID NO. | PARAMETER | | OBJECT MAPPING |
|-----------|---------------|-------------------------------------|----------------|
| 80 | ACT PARAMETER | 40 TB30 MAX SCALING | 0x0F-80-1 |
| 81 | ACT RESERVED | 41 TB31 MAX SCALING | 0x0F-81-1 |
| 82 | ACT PARAMETER | 42 SECOND ACCEL/DECEL TIME | 0x0F-82-1 |
| 83 | ACT RESERVED | 43 | |
| 84 | ACT PARAMETER | 44 PASSWORD | 0x0F-84-1 |
| 85 - 86 | ACT RESERVED | 45 - 46 | |
| 87 | ACT PARAMETER | 47 CLEAR FAULT HISTORY | 0x0F-87-1 |
| 88 | ACT PARAMETER | 48 FACTORY PARAMETERS | 0x0F-88-1 |
| 89 | ACT RESERVED | 49 | |
| 90 | ACT PARAMETER | 50 READ ONLY: FAULT HISTORY | 0x0F-90-1 |
| 91 | ACT PARAMETER | 51 READ ONLY: SW VERSION | 0x0F-91-1 |
| 92 | ACT PARAMETER | 52 READ ONLY: BUS VOLTAGE | 0x0F-92-1 |
| 93 | ACT RESERVED | 53 READ ONLY: MOTOR VOLTAGE | 0x0F-93-1 |
| 94 | ACT PARAMETER | 54 READ ONLY: BUS CURRENT | 0x0F-94-1 |
| 95 | ACT PARAMETER | 55 READ ONLY: 0-10 VDC ANALOG INPUT | 0x0F-95-1 |
| 96 | ACT PARAMETER | 56 READ ONLY: 4-20 MA ANALOG INPUT | 0x0F-96-1 |
| 97 | ACT PARAMETER | 57 READ ONLY: DIGITAL INPUT | 0x0F-97-1 |
| 98 | ACT PARAMETER | 58 READ ONLY: DIGITAL OUTPUT | 0x0F-98-1 |
| 99 | ACT PARAMETER | 59 READ ONLY: ANALOG OUTPUT TB30 | 0x0F-99-1 |
| 100 | ACT PARAMETER | 60 READ ONLY: ANALOG OUTPUT TB31 | 0x0F-100-1 |
| 101 - 124 | ACT RESERVED | 61 - 84 | |
| 125 | ACT PARAMETER | 85 MOTOR SPEED AT RATED FREQ | 0x28-1-15 |
| 126 | ACT PARAMETER | 86 MOTOR RATED CURRENT | 0x28-1-6 |
| 127 | ACT PARAMETER | 87 MOTOR RATED VOLTAGE | 0x28-1-7 |
| 128 | ACT PARAMETER | 88 MOTOR RATED FREQUENCY | 0x28-1-9 |
| 129 | ACT PARAMETER | 89 DRIVE RATED CURRENT | 0x0F-129-1 |
| 130 | ACT PARAMETER | 90 DRIVE RATED VOLTAGE | 0x0F-130-1 |
| 131 - 139 | ACT RESERVED | 91 - 99 | |
| 140 | ACT PARAMETER | C00 DEVICENET NODE ADDRESS | 0x0F-140-1 |
| 141 | ACT PARAMETER | C01 DEVICENET BAUD RATE | 0x0F-141-1 |
| 142 | ACT PARAMETER | C02 ACTION ON LOSS OF DEVICENET | 0x29-1-16 |
| 143 | ACT PARAMETER | C03 DNET OUTPUT ASSEMBLY SELECT. | 0x0F-143-1 |
| 144 | ACT PARAMETER | C04 DNET INPUT ASSEMBLY SELECTION | 0x0F-144-1 |
| 145 | ACT PARAMETER | C05 DNET CUSTOM INPUT ASSEMBLY 0 | 0x0F-145-1 |
| 146 | ACT PARAMETER | C06 DNET CUSTOM INPUT ASSEMBLY 1 | 0x0F-146-1 |
| 147 | ACT PARAMETER | C07 DNET CUSTOM INPUT ASSEMBLY 2 | 0x0F-147-1 |
| 148 | ACT PARAMETER | C08 DNET CUSTOM INPUT ASSEMBLY 3 | 0x0F-148-1 |
| 149 | ACT PARAMETER | C09 DEVICENET MOTOR TYPE | 0x28-1-3 |
| 150 | ACT PARAMETER | C10 DEVICENET DIAGNOSTICS | 0x0F-150-1 |

B.5.7 PARAMETER GROUP OBJECT - CLASS 0x10

| PARAMETER GROUP CLASS ATTRIBUTES | | | | |
|----------------------------------|-------------|---------------------------------|--------------|-------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| 2 | GET | NUMBER OF INSTANCES | UINT | 4 |
| 8 | GET | NATIVE LANGUAGE | UINT | 0 = English |
| INSTANCE 1 - 3 | | | | |
| 1 | GET | GROUP NAME | SHORT STRING | |
| 2 | GET | NUMBER OF MEMBERS IN THE GROUP | UINT | |
| 3 | GET | 1st PARAMETER IN THE GROUP | UINT | |
| 4 | GET | 2nd PARAMETER IN THE GROUP | UINT | |
| n | GET | (n-2) th PARAMETER IN THE GROUP | UINT | |

The SCD parameters that are accessible through the network are separated into 4 groups: Monitor and Control, Program, DNET Config, and Motor Data. The same groups are implemented in the EDS file.

IMPLEMENTED PARAMETER GROUPS:

| GROUP 1 - INSTANCE 1 | | | |
|------------------------------------|--------------------------------|----|-----------------------------|
| NAME: "MONITOR AND CONTROL" | | | |
| ID | PARAMETER | ID | PARAMETER |
| 1 | OUTPUT FREQUENCY (0.1 Hz) | 30 | RUN STATE |
| 2 | OUTPUT VOLTAGE (V) | 31 | SPEED SOURCE |
| 3 | OUTPUT CURRENT (100mA) | 33 | AT REFERENCE STATUS |
| 4 | OUTPUT POWER (W) | 20 | CONTROL SOURCE |
| 5 | INPUT VOLTAGE (V) | 21 | RUN FORWARD |
| 6 | COMMANDED FREQUENCY (0.1 Hz) | 22 | RUN REVERSE |
| 7 | PRESENT FAULT DNET CODE | 23 | FAULT RESET |
| 8 | PRESENT FAULT NAME | 24 | DEVICENET PRESET COMMAND |
| 27 | STATUS OF RUN/STOP CONTROL SRC | 25 | SPEED REFERENCE |
| 28 | STATUS OF SPEED REFERENCE | 26 | NETWORK REFERENCE FREQUENCY |
| 29 | ACTUAL DIRECTION | 38 | KEYPAD COMMAND FREQUENCY |

GROUP 2 - INSTANCE 2**NAME: "PROGRAM"**

| ID NO. | PARAMETER |
|--------|--|
| 40 | ACT EEPROM VERSION - PARAMETER VERSION IDENTIFICATION NUMBER |
| 41 | ACT PARAMETER 1 LINE VOLTAGE |
| 42 | ACT PARAMETER 2 CARRIER |
| 43 | ACT PARAMETER 3 START |
| 44 | ACT PARAMETER 4 STOP |
| 45 | ACT PARAMETER 5 STANDARD SPEED SOURCE |
| 46 | ACT PARAMETER 6 TB14 OUTPUT FUNCTION |
| 47 | ACT RESERVED 7 TORQUE SELECTION |
| 48 | ACT PARAMETER 8 TB30 OUTPUT FUNCTION |
| 49 | ACT PARAMETER 9 TB31 OUTPUT FUNCTION |
| 50 | ACT PARAMETER 10 TB13A INPUT FUNCTION |
| 51 | ACT PARAMETER 11 TB13B INPUT FUNCTION |
| 52 | ACT PARAMETER 12 TB13C INPUT FUNCTION |
| 53 | ACT PARAMETER 13 TB15 OUTPUT FUNCTION |
| 54 | ACT PARAMETER 14 CONTROL |
| 55 | ACT RESERVED 15 |
| 56 | ACT PARAMETER 16 UNITS EDITING |
| 57 | ACT PARAMETER 17 AVAILABLE DIRECTION |
| 58 | ACT RESERVED 18 |
| 59 | ACT PARAMETER 19 ACCELERATION TIME |
| 60 | ACT PARAMETER 20 DECELERATION TIME |
| 61 | ACT PARAMETER 21 DC BRAKE TIME |
| 62 | ACT PARAMETER 22 DC BRAKE VOLTS |
| 63 | ACT PARAMETER 23 MINIMUM FREQUENCY |
| 64 | ACT PARAMETER 24 MAXIMUM FREQUENCY |
| 65 | ACT PARAMETER 25 CURRENT LIMIT |
| 66 | ACT PARAMETER 26 MOTOR OVERLOAD |
| 67 | ACT PARAMETER 27 BASE FREQUENCY |
| 68 | ACT PARAMETER 28 FIXED BOOST |
| 69 | ACT PARAMETER 29 ACCEL BOOST |
| 70 | ACT PARAMETER 30 SLIP COMPENSATION |
| 71 | ACT PARAMETER 31 PRESET SPEED #1 |
| 72 | ACT PARAMETER 32 PRESET SPEED #2 |
| 73 | ACT PARAMETER 33 PRESET SPEED #3 |
| 74 | ACT PARAMETER 34 PRESET SPEED #4 |
| 75 | ACT PARAMETER 35 PRESET SPEED #5 |
| 76 | ACT PARAMETER 36 PRESET SPEED #6 |
| 77 | ACT PARAMETER 37 PRESET SPEED #7 |
| 78 | ACT PARAMETER 38 SKIP BANDWIDTH |
| 79 | ACT PARAMETER 39 SPEED SCALING |

| ID NO. | PARAMETER | |
|-----------|---------------|--|
| 80 | ACT PARAMETER | 40 TB30 MAX SCALING |
| 81 | ACT RESERVED | 41 TB31 MAX SCALING |
| 82 | ACT PARAMETER | 42 SECOND ACCEL/DECEL TIME |
| 83 | ACT RESERVED | 43 |
| 84 | ACT PARAMETER | 44 PASSWORD |
| 85 - 86 | ACT RESERVED | 45 - 46 |
| 87 | ACT PARAMETER | 47 CLEAR FAULT HISTORY |
| 88 | ACT PARAMETER | 48 FACTORY PARAMETERS |
| 89 | ACT RESERVED | 49 |
| 90 | ACT PARAMETER | 50 READ ONLY: FAULT HISTORY |
| 91 | ACT PARAMETER | 51 READ ONLY: S/W VERSION |
| 92 | ACT PARAMETER | 52 READ ONLY: BUS VOLTAGE |
| 93 | ACT RESERVED | 53 READ ONLY: MOTOR VOLTAGE |
| 94 | ACT PARAMETER | 54 READ ONLY: BUS CURRENT |
| 95 | ACT PARAMETER | 55 READ ONLY: 0-10 VDC ANALOG INPUT |
| 96 | ACT PARAMETER | 56 READ ONLY: 4-20 MA ANALOG INPUT |
| 97 | ACT PARAMETER | 57 READ ONLY: DIGITAL INPUT |
| 98 | ACT PARAMETER | 58 READ ONLY: DIGITAL OUTPUT |
| 99 | ACT PARAMETER | 59 READ ONLY: ANALOG OUTPUT TB30 |
| 100 | ACT PARAMETER | 60 READ ONLY: ANALOG OUTPUT TB31 |
| 101 - 124 | ACT RESERVED | 61 - 84 |
| 125 | ACT PARAMETER | 85 MOTOR NOMINAL SPEED AT RATED FREQUENCY |
| 126 | ACT PARAMETER | 86 MOTOR RATED CURRENT |
| 127 | ACT PARAMETER | 87 MOTOR RATED VOLTAGE |
| 128 | ACT PARAMETER | 88 MOTOR RATED FREQUENCY |
| 129 | ACT PARAMETER | 89 DRIVE RATED CURRENT |
| 130 | ACT PARAMETER | 90 DRIVE RATED VOLTAGE |
| 131 - 139 | ACT RESERVED | 91 - 99 |
| 140 | ACT PARAMETER | C00 DEVICENET NODE ADDRESS |
| 141 | ACT PARAMETER | C01 DEVICENET BAUD RATE |
| 142 | ACT PARAMETER | C02 ACTION ON LOSS OF DEVICENET |
| 143 | ACT PARAMETER | C03 DEVICENET OUTPUT ASSEMBLY SELECTION |
| 144 | ACT PARAMETER | C04 DEVICENET INPUT ASSEMBLY SELECTION |
| 145 | ACT PARAMETER | C05 DEVICENET CUSTOM INPUT ASSEMBLY WORD 0 |
| 146 | ACT PARAMETER | C06 DEVICENET CUSTOM INPUT ASSEMBLY WORD 1 |
| 147 | ACT PARAMETER | C07 DEVICENET CUSTOM INPUT ASSEMBLY WORD 2 |
| 148 | ACT PARAMETER | C08 DEVICENET CUSTOM INPUT ASSEMBLY WORD 3 |
| 149 | ACT PARAMETER | C09 DEVICENET MOTOR TYPE |
| 150 | ACT PARAMETER | C10 DEVICENET DIAGNOSTICS |

GROUP 3 - INSTANCE 3**NAME: "DNET CONFIG"**

| ID NO. | PARAMETER |
|--------|--|
| 140 | ACT PARAMETER C00 DEVICENET NODE ADDRESS |
| 141 | ACT PARAMETER C01 DEVICENET BAUD RATE |
| 142 | ACT PARAMETER C02 ACTION ON LOSS OF DEVICENET |
| 143 | ACT PARAMETER C03 DEVICENET OUTPUT ASSEMBLY SELECTION |
| 144 | ACT PARAMETER C04 DEVICENET INPUT ASSEMBLY SELECTION |
| 145 | ACT PARAMETER C05 DEVICENET CUSTOM INPUT ASSEMBLY WORD 0 |
| 146 | ACT PARAMETER C06 DEVICENET CUSTOM INPUT ASSEMBLY WORD 1 |
| 147 | ACT PARAMETER C07 DEVICENET CUSTOM INPUT ASSEMBLY WORD 2 |
| 148 | ACT PARAMETER C08 DEVICENET CUSTOM INPUT ASSEMBLY WORD 3 |
| 149 | ACT PARAMETER C09 DEVICENET MOTOR TYPE |
| 150 | ACT PARAMETER C10 DEVICENET DIAGNOSTICS |
| 125 | ACT PARAMETER 85 MOTOR NOMINAL SPEED AT RATED FREQUENCY |
| 126 | ACT PARAMETER 86 MOTOR RATED CURRENT |
| 127 | ACT PARAMETER 87 MOTOR RATED VOLTAGE |
| 128 | ACT PARAMETER 88 MOTOR RATED FREQUENCY |
| 129 | ACT PARAMETER 89 DRIVE RATED CURRENT |
| 130 | ACT PARAMETER 90 DRIVE RATED VOLTAGE |
| 17 | DEVICENET BUS OFF ERROR |
| 18 | DEVICENET BUS OFF COUNT |
| 19 | DEVICENET IDLE MODE |
| 35 | COS STATUS |
| 36 | COS MASK |

PARAMETER GROUP CLASS SERVICES

| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
|-----------------|-----------------|----------|----------------------|
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x01 | YES | YES | Get_Attribute_All |

B.5.8 MOTOR DATA OBJECT - CLASS 0x28

| MOTOR DATA CLASS ATTRIBUTES | | | | |
|------------------------------------|-------------|----------------------------------|-----------|------------------------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| 2 | GET | NUMBER OF INSTANCES | UINT | 1 |
| INSTANCE 1 | | | | |
| 1 | GET | NO. OF SUPPORTED ATTRIBUTES | USINT | 7 |
| 2 | GET | ATTRIBUTE LIST | ARRAY | |
| 3 | GET / SET | MOTOR TYPE | USINT | 0 - 10 |
| 6 | GET / SET | RATED CURRENT | UINT | RATED STATOR CURRENT (0.1 A) |
| 7 | GET / SET | RATED VOLTAGE | UINT | RATED BASE VOLTAGE (V) |
| 9 | GET / SET | RATED FREQUENCY | UINT | RATED FREQUENCY (Hz) |
| 15 | GET / SET | NOMINAL SPEED AT RATED FREQUENCY | UINT | NOMINAL SPEED (RPM) |

| MOTOR DATA CLASS SERVICES | | | |
|----------------------------------|-----------------|----------|----------------------|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x10 | NO | YES | Set_Attribute_Single |

B.5.9 CONTROL SUPERVISOR OBJECT - CLASS 0x29

| CONTROL SUPERVISOR CLASS ATTRIBUTES | | | | |
|--|-------------|---------------------|-----------|-------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| 2 | GET | NUMBER OF INSTANCES | UINT | 1 |

| CONTROL SUPERVISOR CLASS ATTRIBUTES | | | | |
|-------------------------------------|-------------|-----------------------------|-----------|---|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 1 | | | | |
| 1 | GET | NO. OF SUPPORTED ATTRIBUTES | USINT | 16 |
| 2 | GET | ATTRIBUTE LIST | ARRAY | |
| 3 | GET / SET | RUNFWD | BOOL | 0 to 1 |
| 4 | GET / SET | RUNREV | BOOL | 0 to 1 |
| 5 | GET / SET | NETCTRL | BOOL | 0 to 1 |
| 6 | GET | STATE | UINT | 3 = Ready 4 = Enabled 7 = Faulted |
| 7 | GET | RUNNINGFWD | BOOL | 0 to 1 |
| 8 | GET | RUNNINGREV | BOOL | 0 to 1 |
| 9 | GET | READY | BOOL | 0 to 1 |
| 10 | GET | FAULTED | BOOL | 0 to 1 |
| 11 | GET | WARNING | UINT | 0 (Not Supported) |
| 12 | GET / SET | FAULTRST | BOOL | 0 to 1 |
| 13 | GET | FAULT CODE | UINT | 0 to 65535 |
| 15 | GET | CTRLFROMNET | USINT | 0 to 1 |
| 16 | GET / SET | ACTION ON LOSS OF DEVICENET | USINT | 0 = Fault 1 = Ignore Comm. Fault 2 = AC Tech Specific |
| 17 | GET / SET | FORCE TRIP | BOOL | 0 to 1 |

The drive shows the "nF" fault on the LED display

If Attribute #5 NET CONTROL is set to 1, the RUN and STOP events are triggered according to the following event table:

| ATTRIBUTE RUN FWD | ATTRIBUTE RUN REV | TRIGGER EVENT | RUN TYPE |
|-------------------|-------------------|---------------|-------------|
| 0 | 0 | STOP | N/A |
| 0-->1 | 0 | RUN | RUN FORWARD |
| 0 | 0-->1 | RUN | RUN REVERSE |
| 0-->1 | 0-->1 | NO ACTION | N/A |
| 1 | 1 | NO ACTION | N/A |
| 1-->0 | 1 | RUN | RUN REVERSE |
| 1 | 1-->0 | RUN | RUN FORWARD |

NOTE: If ACT PARAMETER #17 DIRECTION is set to FORWARD ONLY, the drive will not be able to run in the reverse direction.

Fault Codes used in Attribute #13 FAULT CODE:

| FAULT CODE | FAULT DESCRIPTION |
|------------|--|
| 0x0000 | NO FAULT |
| 0x2220 | "OF" OUTPUT FAULT (OVERCURRENT) |
| 0x4310 | "AF" HIGH TEMPERATURE (OVER TEMPERATURE) |
| 0x3210 | "HF" HIGH BUS VOLTAGE (OVER VOLTAGE) |
| 0x3220 | "LF" LOW BUS VOLTAGE (UNDER VOLTAGE) |
| 0x7122 | "PF" OVERLOAD (MOTOR OVERLOAD) |
| 0x6310 | "CF" CONTROL FAULT (EEPROM FAULT) |
| 0x9000 | "EF" EXTERNAL (EXTERNAL FAULT) |
| 0x6320 | "GF" OEM DEFAULTS CORRUPTED (PARAMETER ERROR) |
| 0x3120 | "UF" START ERROR (POWER LOSS) |
| 0x6100 | "F1" INTERNAL 1 (EEPROM FAILURE) |
| 0x6100 | "F2" INTERNAL 2 |
| 0x6100 | "F3" INTERNAL 3 |
| 0x6100 | "F4" INTERNAL 4 |
| 0x6100 | "F5" INTERNAL 5 |
| 0x6100 | "F6" INTERNAL 6 |
| 0x6010 | "F7" INTERNAL 7 |
| 0x6100 | "F8" INTERNAL 8 |
| 0x6100 | "F9" INTERNAL 9 |
| 0x6100 | "Fo" INTERNAL 10 |
| 0x3130 | "SF" VOLTAGE RIPPLE TOO HIGH - SINGLE PHASE SUPPLY (PHASE FAILURE) |
| 0x6320 | "cF" INCOMPATIBILITY FAULT (PARAMETER ERROR) |
| 0x4200 | "dF" DYNAMIC BRAKE OVERLOAD (DYNAMIC BRAKE OVERHEATED) |
| 0x7503 | "JF" COMMUNICATION LOST (DEVICENET TRANSMIT FAULT) |
| 0x9000 | "nF" DEVICENET TRIGGERED FAULT |
| 0x6100 | " F" UNUSED |

| CONTROL SUPERVISOR CLASS SERVICES | | | |
|--|-----------------|----------|----------------------|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x10 | NO | YES | Set_Attribute_Single |

B.5.10 AC / DC DRIVE OBJECT - CLASS 0x2A

| AC / DC DRIVE CLASS ATTRIBUTES | | | | |
|--------------------------------|-------------|-----------------------------|-----------|--------------------------------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| 2 | GET | NUMBER OF INSTANCES | UINT | 1 |
| INSTANCE 1 | | | | |
| 1 | GET | NO. OF SUPPORTED ATTRIBUTES | USINT | 12 |
| 2 | GET | ATTRIBUTE LIST | ARRAY | |
| 3 | GET | AT REFERENCE | BOOL | Speed At Ref |
| 4 | GET / SET | NET REFERENCE | BOOL | 0 = Local Spd Ref 1 = Net Spd Ref |
| 6 | GET | DRIVE MODE | USINT | 1=Open Loop Spd Control |
| 7 | GET | ACTUAL SPEED | INT | Actual Speed (RPM) |
| 8 | GET / SET | SPEED REFERENCE | INT | Speed Reference (RPM) |
| 9 | GET | MOTOR PHASE CURRENT | INT | Actual Current (0.1 A) |
| 15 | GET | ACTUAL OUTPUT POWER | INT | Actual Power (W) |
| 16 | GET | INPUT VOLTAGE | INT | (V) |
| 17 | GET | OUTPUT VOLTAGE | INT | (V) |
| 29 | GET | STATUS OF SPEED REFERENCE | INT | 0 = Local Spd Ref 1 = Net Spd Ref |

| AC DRIVE CLASS SERVICES | | | |
|-------------------------|-----------------|----------|----------------------|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x10 | NO | YES | Set_Attribute_Single |

B.5.11 ACKNOWLEDGE HANDLER OBJECT - CLASS 0x2B

| ACKNOWLEDGE HANDLER CLASS ATTRIBUTES | | | | |
|--------------------------------------|-------------|------------------------------|-----------|---------------|
| ATTRIBUTE ID | ACCESS RULE | NAME | DATA TYPE | VALUE |
| INSTANCE 0 | | | | |
| 1 | GET | REVISION | UINT | 1 |
| 2 | GET | NUMBER OF INSTANCES | UINT | 1 |
| INSTANCE 1 | | | | |
| 1 | GET / SET | ACKNOWLEDGE TIMER | UINT | 1 to 65535 ms |
| 2 | GET / SET | RETRY LIMIT | USINT | 0 to 255 |
| 3 | GET | COS PRODUCING CONN. INSTANCE | UINT | 4 |

| ACKNOWLEDGE HANDLER SERVICES | | | |
|------------------------------|-----------------|----------|----------------------|
| SERVICE CODE | IMPLEMENTED FOR | | SERVICE NAME |
| | CLASS | INSTANCE | |
| 0x0E | YES | YES | Get_Attribute_Single |
| 0x10 | NO | YES | Set_Attribute_Single |

B.6 DESCRIPTION OF DEVICENET™ PARAMETERS

Parameter ID 40 to 130 (AC Tech parameters 1 to 90) have been described in detail in Section 15.0 - DESCRIPTION OF PARAMETERS.

DNET Par. ID 1 - OUTPUT FREQUENCY (READ ONLY): Actual output frequency to motor (0.1 Hz resolution).

DNET Par. ID 2 - OUTPUT VOLTAGE (READ ONLY): Actual output voltage to the motor (1 Volt resolution).

DNET Par. ID 3 - OUTPUT CURRENT (READ ONLY): Output current to the motor (0.1 Amp resolution).

DNET Par. ID 4 - ESTIMATED OUTPUT POWER (READ ONLY): In Watts (1 Watt resolution).

DNET Par. ID 5 - INPUT VOLTAGE (READ ONLY): In Volts (1 Volt resolution).

NOTE: DNET Parameters 2, 3, 4, and 5 are estimated and their accuracy depends on the accuracy of the following parameters:

DNET ID 126 ACT Par 86 MOTOR RATED CURRENT
 DNET ID 127 ACT Par 87 MOTOR RATED VOLTAGE
 DNET ID 128 ACT Par 88 MOTOR RATED FREQUENCY
 DNET ID 129 ACT Par 89 DRIVE RATED CURRENT
 DNET ID 130 ACT Par 90 DRIVE RATED VOLTAGE

DNET Par. ID 6 - COMMANDED FREQUENCY (READ ONLY): Actual commanded frequency (speed) of the drive (0.1 Hz resolution).

DNET Par. ID 7 - PRESENT FAULT DNET CODE (READ ONLY): Shows the current fault code. Refer to the table in Section B.5.9.

DNET Par. ID 8 - PRESENT FAULT NAME (READ ONLY): See the table below:

| PRESENT FAULT NAME | | | | | |
|--------------------|------------------|-----|----------------|-----|--------------------|
| NO. | FAULT NAME | NO. | FAULT NAME | NO. | FAULT NAME |
| 0 | NO FAULT | 10 | INTERNAL 1 EPM | 20 | SINGLE PHASE INPUT |
| 1 | OUTPUT FAULT | 11 | INTERNAL 2 | 21 | INCOMPATIBLE EPM |
| 2 | HIGH TEMP. | 12 | INTERNAL 3 | 22 | DYNAMIC BRAKE |
| 3 | HIGH BUS VOLTAGE | 13 | INTERNAL 4 | 23 | DEVICENET FAULT |
| 4 | LOW BUS VOLTAGE | 14 | INTERNAL 5 | 24 | DNET TRIGGER FAULT |
| 5 | MOTOR OVERLOAD | 15 | INTERNAL 6 | 25 | RESERVED |
| 6 | CONTROL FAULT | 16 | INTERNAL 7 | 26 | RESERVED |
| 7 | EXTERNAL FAULT | 17 | INTERNAL 8 | 27 | RESERVED |
| 8 | OEM DATA FAILED | 18 | INTERNAL 9 | | |
| 9 | START ERROR | 19 | INTERNAL 10 | | |

DNET Par. ID 9 through 16 - Reserved.

DNET Par. ID 17 - BUS OFF ERROR: Determines how the Communication Section processes a CAN Bus OFF condition.

0 - Hold CAN chip in bus off state when bus off is detected.

1 - Tries to reset the CAN and continue communication.

DNET Par. ID 18 - BUS OFF COUNT: Number of times the CAN peripheral went into bus off state. Counter maximum value is 255. Any write into this parameter resets the counter to 0.

DNET Par. ID 19 - DEVICENET IDLE MODE: This parameter is used to set the action the SCD drive should perform when the connection is closed (set to idle state) and drive is still in DNET control.

0 - STOP the drive if IDLE mode

1 - Hold last state if IDLE mode (**WARNING!** Make sure it is safe to operate this way!)

DNET Par. ID 20 - CONTROL SOURCE: Must be set to NETWORK CONTROL before network RUN FWD or RUN REV will be accepted.

0 - Local control (from SCD terminals)

1 - NETWORK CONTROL (**WARNING!** Make sure it is safe to operate the drive!)

Object Map - Control Supervisor Object 0x29-1-5

If this parameter (attribute) is set, the RUN STOP events are controlled by a combination of RUN FWD and RUN REV attributes (parameters) shown in the table in Section B.5.9.

DNET Par. ID 21 - RUN FORWARD: Request RUN Forward if Control is set to NETWORK

0 - STOP running FORWARD

1 - RUN FORWARD (**WARNING!** Make sure it is safe to operate the drive!)

Object Map - Control Supervisor Object 0x29-1-3

DNET Par. ID 22 - RUN REVERSE: Request RUN Forward if Control is set to NETWORK

0 - STOP running REVERSE

1 - RUN REVERSE (**WARNING!** Make sure it is safe to operate the drive!)

Object Map - Control Supervisor Object 0x29-1-4

WARNING!

Make sure it is safe to operate the SCD Series drive from the network! Damage to equipment and/or injury to personnel can result from unattended/improper operation.

NOTE 1: To run in reverse direction, Parameter #17 - ROTATION must be set to 2 (FORWARD and REVERSE)

NOTE 2: Local stop command (opening connection between terminals 1 and 4) overrides RUN/STOP command from DeviceNet™.

DNET Par. ID 23 - FAULT RESET: Transition from 0->1 clears the SCD fault.

0 - No Action

0 -> 1 - Fault RESET

Object Map - Control Supervisor Object 0x29-1-12

DNET Par. ID 24 - PRESET COMMAND: Allows preset speed reference while in network control.

0 - Local speed reference (keypad, analog)

1 - Preset #1 (ACT parameter #31)

2 - Preset #2 (ACT parameter #32)

3 - Preset #3 (ACT parameter #33)

4 - Preset #4 (ACT parameter #34)

5 - Preset #5 (ACT parameter #35)

6 - Preset #6 (ACT parameter #36)

7 - Preset #7 (ACT parameter #37)

NOTE: Preset speeds are only active when DeviceNet control is set but NOT network reference. If network reference is set, preset speed control is ignored.

DNET Par. ID 25 - SPEED REFERENCE:

0 - Local speed reference (SCD drive speed selection: keypad, presets, analog)

1 - Network speed reference

Object Map - AC Drive Object 0x2A-1-4

NOTE: Parameter IDs 20-25 will reset to 0 when power is cycled or the drive is reset.

DNET Par. ID 26 - NETWORK COMMAND FREQUENCY: Sets the drive command frequency if parameter ID #25 is set to NETWORK REFERENCE (0.1 Hz resolution).

DNET Par. ID 27 - CONTROL SOURCE (READ ONLY)

0 - Local control

1 - Control from the Network

Object Map - Control Supervisor Object 0x29-1-15

DNET Par. ID 28 - SPEED REFERENCE SOURCE (READ ONLY)

0 - Local speed reference

1 - Network speed reference

Object Map - AC Drive Object 0x2A-1-29

DNET Par. ID 29 - DRIVE ACTUAL DIRECTION (READ ONLY)

0 - Forward

1 - Reverse

DNET Par. ID 30 - RUN STATUS (READ ONLY): See table below:

| RUN STATUS | | | | | |
|------------|---------------|-----|--------------|-----|-------------------|
| NO. | STATUS | NO. | STATUS | NO. | STATUS |
| 0 | FAULT LOCKOUT | 4 | DC BRAKE | 8 | DECELERATION |
| 1 | FAULT | 5 | RUN AT 0 Hz | 9 | CURRENT LIMIT |
| 2 | START PENDING | 6 | RUN | 10 | DECEL OVERRIDE |
| 3 | STOP | 7 | ACCELERATION | 11 | LOWER ON SEQUENCE |

DNET Par. ID 31 - SPEED SOURCE (READ ONLY): See table below:

| SPEED SOURCE | | | | | |
|--------------|-----------------|-----|-----------------|-----|-----------|
| NO. | SOURCE | NO. | STATUS | NO. | STATUS |
| 0 | KEYPAD | 5 | PRESET SPEED #3 | 10 | JOG SPEED |
| 1 | 0-10 VDC | 6 | PRESET SPEED #4 | 11 | MOP SPEED |
| 2 | 4-20 mA | 7 | PRESET SPEED #5 | 12 | DEVICENET |
| 3 | PRESET SPEED #1 | 8 | PRESET SPEED #6 | | |
| 4 | PRESET SPEED #2 | 9 | PRESET SPEED #7 | | |

DNET Par. ID 32: Reserved.

DNET Par. ID 33 - AT REFERENCE STATUS (READ ONLY)

- 0 - Actual speed is different than commanded speed.
- 1 - Actual speed is equal to commanded speed (+0.5 Hz).

DNET Par. ID 34: Reserved.

DNET Par. ID 35 - CHANGE OF STATE (COS) STATUS BITS (READ ONLY)

DNET Par. ID 36 - CHANGE OF STATE (COS) MASK BITS

CHANGE OF STATE TRIGGER SETUP: Setting the trigger of the COS I/O connection is performed by specifying the trigger status bits in DeviceNet Parameter ID #35 COS STATUS. The status bits of Parameter #35 that will trigger the COS message are masked with "1" in Parameter #36 COS MASK.

Description of bits for DNET parameters ID #35 COS Status and ID #36 COS MASK:

| DESCRIPTION OF BITS | | | | | |
|---------------------|-------------------|-----|-----------------|-----|----------------|
| BIT | DESCRIPTION | BIT | DESCRIPTION | BIT | DESCRIPTION |
| 0 | FAULTED | 6 | REF. FROM NET. | 12 | ACCELERATION |
| 1 | | 7 | AT REFERENCE | 13 | DECELERATION |
| 2 | RUNNING FORWARD | 8 | SPEED SOURCE 0* | 14 | CURRENT LIMIT |
| 3 | RUNNING REVERSE | 9 | SPEED SOURCE 1* | 15 | DECEL OVERRIDE |
| 4 | READY | 10 | SPEED SOURCE 2* | | |
| 5 | CONTROL FROM NET. | 11 | SPEED SOURCE 3* | | |

* See table below for Speed Source Selection.

| SPEED SOURCE SELECTION | | | | |
|------------------------|--------|-------|-------|-----------------------|
| BIT 11 | BIT 10 | BIT 9 | BIT 8 | SPEED SOURCE |
| 0 | 0 | 0 | 0 | KEYPAD |
| 0 | 0 | 0 | 1 | 0 - 10 VDC |
| 0 | 0 | 1 | 0 | 4 - 20 mA |
| 0 | 0 | 1 | 1 | PRESET SPEED #1 |
| 0 | 1 | 0 | 0 | PRESET SPEED #2 |
| 0 | 1 | 0 | 1 | PRESET SPEED #3 |
| 0 | 1 | 1 | 0 | PRESET SPEED #4 |
| 0 | 1 | 1 | 1 | PRESET SPEED #5 |
| 1 | 0 | 0 | 0 | PRESET SPEED #6 |
| 1 | 0 | 0 | 1 | PRESET SPEED #7 |
| 1 | 0 | 1 | 0 | JOG (PRESET SPEED #2) |
| 1 | 0 | 1 | 1 | MOP* |
| 1 | 1 | 0 | 0 | NETWORK REFERENCE |

*MOP is asserted if TB-13B and TB-13C are both programmed for MOP

DNET Par. ID 37: Reserved.

DNET Par. ID 38 - KEYPAD COMMAND FREQUENCY: Allows the keypad speed (which is normally accessed using the ▲ and ▼ buttons on the front of the drive) to be changed through DeviceNet. This speed can be used as Preset Speed #0 in Output Assembly 103 and Parameter 24.

DNET Par. ID 39: Reserved.

DNET Par. ID 40 - SCD DRIVE PARAMETER VERSION (READ ONLY): Displays the parameter version number of the drive (example: 322). This is the same number that the drive displays when power is applied.

DNET Par. ID 41 through 139: Correspond to ACT Parameters 1 through 90 and are described in Section 15.0 - DESCRIPTION OF PARAMETERS.

DNET Par. ID 140 - DEVICENET NODE ADDRESS (ACT PARAMETER C00): DeviceNet address 0-63. Does not take effect until power to the drive is cycled.

DNET Par. ID 141 - DEVICENET BAUD RATE (ACT PARAMETER C01)

- 0 - 125kbps
- 1 - 250kbps
- 2 - 500kbps

DNET Par. ID 142 - ACTION ON LOSS OF DEVICENET (ACT PARAMETER C02)

- 0 - FAULT & STOP - Trigger the 'JF' Network fault if drive is running.
- 1 - IGNORE (do not do anything)
- 2 - AC TECH specific - Switch OFF control to TERMINAL and do not do anything (if drive was running, it will keep running in terminal mode)

WARNING! For settings 1 and 2, make sure it is safe to operate this way!

Object Map - Control Supervisor Object 0x29-1-16

DNET Par. ID 143 - DEVICENET OUTPUT ASSEMBLY SELECTION (ACT PARAM. C03):

Select the output assembly, consumption size, and path for polled I/O connection.

- | | |
|-----------------------------|---|
| 1 = "1 Basic Contactor" | - ODVA SPECIFIED |
| 2 = "2 Basic Overload" | - ODVA SPECIFIED |
| 3 = "3 Basic Motor Starter" | - ODVA SPECIFIED |
| 4 = "4 Ext. Contactor" | - ODVA SPECIFIED |
| 5 = "5 Ext. Motor Starter" | - ODVA SPECIFIED |
| 6 = "20 Basic Speed Ctrl" | - ODVA SPECIFIED |
| 7 = "21 Ext. Speed Ctrl" | - ODVA SPECIFIED |
| 8 = "100 Ext.Speed Ctrl Hz" | - AC TECH specific (Same as Assembly 21, except speed is in Hz) |
| 9 = "103 Preset Speed Ctrl" | - AC TECH specific |

OUTPUT ASSEMBLY DETAILS:

| 1 BASIC CONTACTOR OUTPUT ASSEMBLY | | | | | | | | |
|--|-------|-------|-------|-------|-------|-------|-------|-------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | | | RUN* |

* Implemented as RUN FORWARD

| 2 BASIC OVERLOAD OUTPUT ASSEMBLY | | | | | | | | |
|---|-------|-------|-------|-------|-------|----------------|-------|-------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | FAULT RESET | | |

| 3 BASIC MOTOR STARTER OUTPUT ASSEMBLY | | | | | | | | |
|--|-------|-------|-------|-------|-------|----------------|-------|-------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | FAULT RESET | | RUN* |

* Implemented as RUN FORWARD

| 4 EXTENDED CONTACTOR OUTPUT ASSEMBLY | | | | | | | | |
|---|-------|-------|-------|-------|-------|-------|------------|------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | | RUN REV | RUN FWD |

| 5 EXTENDED MOTOR STARTER OUTPUT ASSEMBLY | | | | | | | | |
|---|-------|-------|-------|-------|-------|----------------|------------|------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | FAULT RESET | RUN REV | RUN FWD |

| 20 BASIC SPEED CONTROL OUTPUT ASSEMBLY | | | | | | | | |
|---|---------------------------------|-------|-------|-------|-------|----------------|-------|------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | FAULT RESET | | RUN FWD |
| 1 | | | | | | | | |
| 2 | SPEED REFERENCE RPM (LOW BYTE) | | | | | | | |
| 3 | SPEED REFERENCE RPM (HIGH BYTE) | | | | | | | |

| 21 EXTENDED SPEED CONTROL OUTPUT ASSEMBLY | | | | | | | | |
|---|---------------------------------|--------------|-----------------|-------|-------|----------------|------------|------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | NET. REF. | NET. CONTROL | | | FAULT RESET | RUN REV | RUN FWD |
| 1 | | | | | | | | |
| 2 | SPEED REFERENCE RPM (LOW BYTE) | | | | | | | |
| 3 | SPEED REFERENCE RPM (HIGH BYTE) | | | | | | | |

| 100 AC TECH EXTENDED SPEED CONTROL OUTPUT ASSEMBLY | | | | | | | | |
|--|--------------------------------|--------------|-----------------|-------|-------|----------------|------------|------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | NET. REF. | NET. CONTROL | | | FAULT RESET | RUN REV | RUN FWD |
| 1 | | | | | | | | |
| 2 | SPEED REFERENCE Hz (LOW BYTE) | | | | | | | |
| 3 | SPEED REFERENCE Hz (HIGH BYTE) | | | | | | | |

| 103 AC TECH PRESET SPEED CONTROL OUTPUT ASSEMBLY | | | | | | | | |
|--|-------|-------|-------|-------|-------|-----------------|-----------------|-----------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | FAULT RESET | RUN REV | RUN FWD |
| 1 | | | | | | PRESET BIT 2 | PRESET BIT 1 | PRESET BIT 0 |

NOTE 1: Refer to the following table for Frequency Source Bits representation.

| PRESET SPEED BITS REPRESENTATION | | | |
|----------------------------------|-------|-------|------------------------|
| BIT 2 | BIT 1 | BIT 0 | SPEED SOURCE |
| 0 | 0 | 0 | LOCAL (keypad, analog) |
| 0 | 0 | 1 | PRESET SPEED #1 |
| 0 | 1 | 0 | PRESET SPEED #2 |
| 0 | 1 | 1 | PRESET SPEED #3 |
| 1 | 0 | 0 | PRESET SPEED #4 |
| 1 | 0 | 1 | PRESET SPEED #5 |
| 1 | 1 | 0 | PRESET SPEED #6 |
| 1 | 1 | 1 | PRESET SPEED #7 |

NOTE 2: Preset speeds are accepted only when DeviceNet control is set but NOT network reference. If network reference is set, preset speed control is ignored. To simplify setup, refer to the following parameters in the EDS file: Parameter 24 - DeviceNet Preset Command, and Parameter 38 - Keypad Command Frequency.

DNET Par. ID 144 - DEVICENET INPUT ASSEMBLY SELECTION (ACT PARAM. C04):

Select the input assembly, production size, and path for the following I/O connections:

- Polling
- Bit-Strobe
- Change of State
- Cyclic

- | | |
|-----------------------------|--|
| 1 = "50 Basic Overload" | - ODVA SPECIFIED |
| 2 = "51 Extended Overload" | - ODVA SPECIFIED |
| 3 = "52 Basic Motor Ctrl" | - ODVA SPECIFIED |
| 4 = "53 Ext. Motor Ctrl 1" | - ODVA SPECIFIED |
| 5 = "54 Ext. Motor Ctrl 2" | - ODVA SPECIFIED |
| 6 = "70 Basic Speed Ctrl" | - ODVA SPECIFIED |
| 7 = "71 Ext. Speed Ctrl" | - ODVA SPECIFIED |
| 8 = "101 Ext.Speed Ctrl Hz" | - AC TECH specific (same as 71, except speed is in Hz) |
| 9 = "102 Custom Assembly" | - AC TECH specific |
| 10 = "104 Custom Assembly" | - AC TECH specific |
| 11 = "105 Custom Assembly" | - AC TECH specific |

INPUT ASSEMBLY DETAILS:

| 50 BASIC OVERLOAD/CONTACTOR INPUT ASSEMBLY | | | | | | | | |
|--|-------|-------|-------|-------|-------|-------|-------|---------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | | | FAULTED |

| 51 EXTENDED OVERLOAD/CONTACTOR INPUT ASSEMBLY | | | | | | | | |
|---|-------|-------|-------------------|-------|-------|-------|-------|---------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | CONTROL FROM NET. | | | | | FAULTED |

| 52 BASIC MOTOR CONTROL INPUT ASSEMBLY | | | | | | | | |
|---------------------------------------|-------|-------|-------|-------|-------|-----------------|-------|--------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | | | | RUNNING FORWARD | | FAULTED/TRIP |

| 53 EXTENDED MOTOR CONTROL 1 INPUT ASSEMBLY | | | | | | | | |
|--|-------|-------|-------------------|-------|-------|-----------------|-------|--------------|
| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
| 0 | | | CONTROL FROM NET. | READY | | RUNNING FORWARD | | FAULTED/TRIP |

54 EXTENDED MOTOR CONTROL 2 INPUT ASSEMBLY

| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
|------|-------|-------|----------------------|-------|--------------------|--------------------|-------|------------------|
| 0 | | | CONTROL FROM NET. | READY | RUNNING REVERSE | RUNNING FORWARD | | FAULTED/ TRIP |

70 BASIC SPEED CONTROL INPUT ASSEMBLY

| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
|------|------------------------------|-------|-------|-------|-------|--------------------|-------|------------------|
| 0 | | | | | | RUNNING FORWARD | | FAULTED/ TRIP |
| 1 | | | | | | | | |
| 2 | ACTUAL SPEED RPM (LOW BYTE) | | | | | | | |
| 3 | ACTUAL SPEED RPM (HIGH BYTE) | | | | | | | |

71 EXTENDED SPEED CONTROL INPUT ASSEMBLY

| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
|------|------------------------------|-------------------|----------------------|-------|--------------------|--------------------|-------|------------------|
| 0 | AT REF. | REF. FROM NET. | CONTROL FROM NET. | READY | RUNNING REVERSE | RUNNING FORWARD | | FAULTED/ TRIP |
| 1 | | | | | | | | |
| 2 | ACTUAL SPEED RPM (LOW BYTE) | | | | | | | |
| 3 | ACTUAL SPEED RPM (HIGH BYTE) | | | | | | | |

101 AC TECH EXTENDED SPEED CONTROL INPUT ASSEMBLY

| BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
|------|-----------------------------|-------------------|----------------------|-------|--------------------|--------------------|-------|------------------|
| 0 | AT REF. | REF. FROM NET. | CONTROL FROM NET. | READY | RUNNING REVERSE | RUNNING FORWARD | | FAULTED/ TRIP |
| 1 | | | | | | | | |
| 2 | ACTUAL SPEED Hz (LOW BYTE) | | | | | | | |
| 3 | ACTUAL SPEED Hz (HIGH BYTE) | | | | | | | |

102 CUSTOM INPUT ASSEMBLY

| WORD | BYTE | |
|------|------|---|
| 0 | 0 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C05 (Low Byte) |
| | 1 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C05 (High Byte) |
| 1 | 2 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C06 (Low Byte) |
| | 3 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C06 (High Byte) |
| 2 | 4 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C07 (Low Byte) |
| | 5 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C07(High Byte) |
| 3 | 6 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C08 (Low Byte) |
| | 7 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C08 (High Byte) |

104 CUSTOM INPUT ASSEMBLY

| WORD | BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
|------|------|--|---------------|---------------|---------------|-----------------|-----------------|---------|-------------|
| 0 | 0 | FAULT | | DECEL | ACCEL | ROT. DIRECT. | COM. DIRECT. | RUNNING | ENABLED |
| | 1 | FREQ. SRC. | FREQ. SRC. | FREQ. SRC. | FREQ. SRC. | LOCAL | LOCAL | LOCAL | AT SPEED |
| 1 | 2 | ACTUAL SPEED SCALE 0-32767 (LOW BYTE) | | | | | | | |
| | 3 | ACTUAL SPEED SCALE 0-32767 (HIGH BYTE) | | | | | | | |

105 CUSTOM INPUT ASSEMBLY

| WORD | BYTE | BIT 7 | BIT 6 | BIT 5 | BIT 4 | BIT 3 | BIT 2 | BIT 1 | BIT 0 |
|------|------|---|---------------|---------------|---------------|-----------------|-----------------|---------|-------------|
| 0 | 0 | FAULT | | DECEL | ACCEL | ROT. DIRECT. | COM. DIRECT. | RUNNING | ENABLED |
| | 1 | FREQ. SRC. | FREQ. SRC. | FREQ. SRC. | FREQ. SRC. | LOCAL | LOCAL | LOCAL | AT SPEED |
| 1 | 2 | ACTUAL SPEED SCALE 0-32767 (Low Byte) | | | | | | | |
| | 3 | ACTUAL SPEED SCALE 0-32767 (High Byte) | | | | | | | |
| 2 | 4 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C07 (Low Byte) | | | | | | | |
| | 5 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C07 (High Byte) | | | | | | | |
| 3 | 6 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C08 (Low Byte) | | | | | | | |
| | 7 | VALUE OF DNET PARAMETER POINTED BY ACT PARAMETER #C08 (High Byte) | | | | | | | |

NOTE 1: For Rotation and Commanded Direction, 1 = Forward and 0 = Reverse.

NOTE 2: Refer to the following tables for Local Bits and Frequency Source Bits representation.

NOTE 3: Actual Speed Scale: 0 = 0.0 Hz and 32767 = Max. Frequency (DNet ID 64; ACT par. 24).

| LOCAL BITS REPRESENTATION | | | |
|---------------------------|-------|-------|----------|
| BIT 3 | BIT 2 | BIT 1 | CONTROL |
| 0 | 0 | 0 | TERMINAL |
| 0 | 0 | 1 | NETWORK |

| FREQUENCY SOURCE BITS REPRESENTATION | | | | |
|--------------------------------------|-------|-------|-------|----------------------------------|
| BIT 7 | BIT 6 | BIT 5 | BIT 4 | SPEED SOURCE |
| 0 | 0 | 0 | 0 | KEYPAD |
| 0 | 0 | 0 | 1 | PRESET SPEED #1 |
| 0 | 0 | 1 | 0 | PRESET SPEED #2 |
| 0 | 0 | 1 | 1 | PRESET SPEED #3 |
| 0 | 1 | 0 | 0 | PRESET SPEED #4 |
| 0 | 1 | 0 | 1 | PRESET SPEED #5 |
| 0 | 1 | 1 | 0 | PRESET SPEED #6 |
| 0 | 1 | 1 | 1 | PRESET SPEED #7 |
| 1 | 0 | 0 | 0 | TERMINAL REFERENCE (analog, MOP) |
| 1 | 0 | 0 | 1 | NETWORK REFERENCE |

DNET Par. ID 145 - CUSTOM INPUT ASSEMBLY WORD 0 ADDRESS (ACT Param. C05):
DNET parameter ID whose value is placed in bytes 0 and 1 of Custom Input Assembly 102.

DNET Par. ID 146 - CUSTOM INPUT ASSEMBLY WORD 1 ADDRESS (ACT Param. C06):
DNET parameter ID whose value is placed in bytes 2 and 3 of Custom Input Assembly 102.

DNET Par. ID 147 - CUSTOM INPUT ASSEMBLY WORD 2 ADDRESS (ACT Param. C07):
DNET parameter ID whose value is placed in bytes 4 and 5 of Custom Input Assembly 102, and in bytes 4 and 5 of Custom Input Assembly 105.

DNET Par. ID 148 - CUSTOM INPUT ASSEMBLY WORD 3 ADDRESS (ACT Param. C08):
DNET parameter ID whose value is placed in bytes 6 and 7 of Custom Input Assembly 102, and in bytes 6 and 7 of Custom Input Assembly 105.

NOTE: A value of zero in Parameter IDs 145 to 148 defines the end of Assembly 102. A value of zero in Parameter IDs 147 to 148 defines the end of Assembly 105.

DNET Par. ID 149 - DEVICENET MOTOR TYPE (ACT Parameter C09): See table below:

| MOTOR TYPES | | | |
|--------------------|----------------------|-----|-------------------------|
| NO. | DESCRIPTION | NO. | DESCRIPTION |
| 0 | NON-STANDARD MOTOR | 6 | WOUND ROTOR INDUCTION |
| 1 | PM DC MOTOR | 7 | SQUIRREL CAGE INDUCTION |
| 2 | FC DC MOTOR | 8 | STEPPER MOTOR |
| 3 | PM SYNCHRONOUS MOTOR | 9 | SINUSOIDAL PM BL |
| 4 | FC SYNCHRONOUS MOTOR | 10 | TRAPEZOIDAL PM BL |
| 5 | SWITCHED RELUCTANCE | | |

DNET Par. ID 150 - DEVICENET DIAGNOSTICS (ACT Parameter C10) (READ ONLY):

See tables below:

| LEFT DIGIT - CONTROL STATUS | |
|------------------------------------|--|
| NO. | DESCRIPTION |
| 0 | LOCAL CONTROL |
| 1 | NETWORK CONTROL |
| 2 | ACT PARAMETER 14 - CONTROL SET TO "NETWORK ONLY" BUT NETWORK CONTROL IS NOT SET. |

| MIDDLE DIGIT - NETWORK STATUS | | | |
|--------------------------------------|----------------------------|-----|-------------------------------|
| NO. | DESCRIPTION | NO. | DESCRIPTION |
| 0 | NETWORK OFF | 5 | NETWORK CONNECTED |
| 1 | NETWORK NOT CONNECTED | 6 | |
| 2 | NETWORK CONNECTION TIMEOUT | 7 | |
| 3 | COMMUNICATION FAULTED | 8 | DUPLICATE MAC ID FAILURE |
| 4 | | 9 | NETWORK CRITICAL LINK FAILURE |

| RIGHT DIGIT - I/O STATUS | | | |
|---------------------------------|---------------------------|-----|--------------------|
| NO. | DESCRIPTION | NO. | DESCRIPTION |
| 0 | I/O CONNECTION OFF | 5 | I/O ACTIVE |
| 1 | I/O CONNECTION IDLE STATE | 6 | |
| 2 | | 7 | |
| 3 | I/O FAULTED | 8 | |
| 4 | | 9 | I/O CRITICAL ERROR |

B.7 NETWORK TROUBLESHOOTING

To aid in troubleshooting parameter number C10 can be accessed without entering PASSWORD. Simply press the MODE button twice to "skip" over the PASSWORD prompt and "P50" will be displayed. Then use the ▲ and ▼ buttons to scroll to C10 which displays the status of the DeviceNet™ connection.

| NETWORK TROUBLESHOOTING | | |
|--|--|--|
| SYMPTOM | POSSIBLE CAUSE | REMEDY |
| SCD Drive cannot be accessed from network; C10 code is "083". | <ul style="list-style-type: none"> - Duplicate DeviceNet address | <ul style="list-style-type: none"> - Ensure SCD drive address is unique. - Reset SCD drive by cycling power. - Use Faulted Node Recovery utility. |
| SCD Drive cannot be accessed from network; C10 code is "093". | <ul style="list-style-type: none"> - Communication section is not receiving power. - Network was not powered up before the SCD drive. - Invalid baud rate. | <ul style="list-style-type: none"> - Check DeviceNet connections and power. - Check the baud rate. - Ensure bias resistors were placed correctly. - Reset SCD drive by cycling power. - Contact AC Tech Service Dept. |
| SCD drive cannot be accessed from network; C10 code is different than 090 or "093". | <ul style="list-style-type: none"> - Communication section is not receiving power. - Connection problem; shorted signal wires for example. - Scanner device failure. | <ul style="list-style-type: none"> - Check DeviceNet connections and power. - Check the scanner device. |
| SCD drive stops and "JF" fault is displayed; C10 code is "x3x" or "xx3" (x = any number except 9). | <ul style="list-style-type: none"> - SCD communication has been lost and the Watchdog Timer shut down the drive. - Communication was lost after the Master established communication. - Scanner device failure. | <ul style="list-style-type: none"> - Check the Master device. - Change expected packet rate if Master cannot handle the update rate. - Re-establish communication and clear the fault. |
| SCD drive stops without a fault; C10 code is "111". | <ul style="list-style-type: none"> - Master device closed established connection when SCD drive was in Network Control Mode, and Parameter ID #19 DeviceNet Idle Mode is set to 0 ("Stop the Drive"). | <ul style="list-style-type: none"> - Switch Off Network Control before established connection is closed. - Set the DeviceNet Parameter ID #19 DeviceNet Idle Mode to 1 ("Hold Last State"). - Re-establish connection and re-start the SCD drive. |
| SCD drive stops and "nF" fault is displayed; C10 code is "xxx" (x = any number). | <ul style="list-style-type: none"> - Master device forced Network fault; Control Supervisor Object 0x29-1-17 "Force Fault Trip". | <ul style="list-style-type: none"> - Check Master device control logic. |

EC DECLARATION OF CONFORMITY

In accordance with EN45014:1998

Applied Council Directive(s): EMC Directive 89/336/EEC, as amended: 92/31/EEC
and Low Voltage Directive 73/23/EEC, as amended: 93/68/EEC

We, Manufacturer:

AC Technology Corporation
660 Douglas Street
Uxbridge, MA 01569
U.S.A.

Authorized Representative:

AC Technology Europe
4 Shackleton Way
Bowbrook
Shrewsbury, Shropshire SY3 8SW U.K.

declare under our sole responsibility that the products to which this Declaration relates, are in conformity with the relevant provisions of the following standards, provided that installations are carried out in accordance with manufacturer's instructions.

PRODUCTS RELATED TO DECLARATION

SCD Series AC Variable Frequency Motor Drives Models:

| | | | | | |
|--------|--------|--------|--------|--------|--------|
| SD203Y | SD250Y | SD275 | SD415 | SD4150 | SD550 |
| SD205Y | SD210 | SD2100 | SD420 | SD4200 | SD575 |
| SD210Y | SD215 | SD2150 | SD430 | SD4250 | SD5100 |
| SD215Y | SD220 | SD2200 | SD450 | SD510 | SD5150 |
| SD220Y | SD230 | SD405 | SD475 | SD520 | SD5200 |
| SD230Y | SD250 | SD410 | SD4100 | SD530 | SD5250 |

NOTE: Model numbers may be followed by: "F" (through-hole mount), "F1" (through-hole mount without heatsink), "P" (PI setpoint), and/or "V" (high frequency output)

RELEVANT EUROPEAN STANDARDS

EN 50081-2* Electromagnetic compatibility

– Generic emission standard – Part 2: Industrial environment

EN 50082-2* Electromagnetic compatibility

– Generic immunity standard – Part 2: Industrial environment

EN 50178:1998 Electronic equipment for use in power installations

* with suitable line filters that are properly installed.

YEAR OF CE Marking (Low Voltage Directive): 2002

Signature:


Jim Reinwald, Compliance Manager

Date:

3 January 2002

AC Technology Corporation

660 Douglas Street, Uxbridge MA 01569

Sales: 800-217-9100, FAX: 508-278-7873

Service: 508-278-9100 ext 125, FAX: 508-278-6620

www.actechdrives.com